# WILKINS a ZURNo company

# Model 350ADA Double Check Detector Assembly

Designed for installation on potable water lines connections in fire sprinkler systems to protect against both backsiphonage and backpressure of polluted water into the potable water supply. Model 350ADA shall provide protection where a potential health

hazard does not exist. Incorporates metered by-pass to detect

STANDARDS COMPLIANCE (HORIZONTAL & VERTICAL)

Approved by the Foundation for Cross Connection

Control and Hydraulic Research at the University of

AWWA Compliant C510 (with gates only)

# SPECIFICATION SUBMITTAL SHEET

leaks and unauthorized water use.

ASSE® Listed 1048

UL® Classified C-UL® Classified FM® Approved

CSA® Certified (4" - 8")

Southern California

NYC MEA 221-04M-2 (2 1/2" - 8")

APPLICATION

•

•





(with OS&Y gates)

(with BGVIC valves)

## FEATURES

Sizes:		2 1/2'	* 🛛	3"*		4"		6"	□ 8"	<b>□</b> 10"
Maximu	m w	orking	wate	r pres	sure			1	75 PSI	
Maximu	m w	orking	wate	r temp	perat	ure		1	40°F	
Hydrost	atic f	test pre	essur	е				3	50 PSI	
End connections (Grooved for steel pipe) AWWA C606									606	
			(Flar	ged)				A	NSI B16	5.1
								С	lass 12	5

\*2 1/2" & 3" sizes use 4" body & reducer couplings

# OPTIONS

(Suffixes can be combined)

- with flanged end OS & Y gate valves (standard)
- L less shut-off valves (grooved body connections)
- LM less water meter
- with remote reading meter
- with gpm meter (standard)
- with cu ft/min meter
- G with grooved end OS&Y gate valves
- □ FG with flanged inlet gate connection and grooved outlet gate connection
- □ PI with Post Indicator Gate Valves (4"-10")
- □BGVIC with grooved end butterfly valves valves with integral supervisory switches

# ACCESSORIES

- Repair kit (rubber only)
- Thermal expansion tank (Model XT)
- OS & Y Gate valve tamper switch (OSY-40)
- Test Cock Lock (Model TCL24)

# DIMENSIONS & WEIGHTS (do not include pkg.)

MODEL 350ADA SIZE			WEIGHT										
		WITHOUT GATES			OS&Y S (GXF)		H OS&Y S (GXG)	WITH BUTTERFLY VALVES (GXG)					
in.	mm	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg				
2 1/2	65	105	47.5	207	94	199	90.3	123.8	56.2				
3	80	104	104 47		224 101.5		97	124.4	56.5				
4	100	91	41.3	245	111	219	99.4	123	55.8				
6	150	141	64	377	171	347	158	193	87.6				
8	200	302	137	778	353.2	754	342.3	410	186				
10	250	355	161	1040	472.7	918	416.5	527	239.3				

MOL	DEL		DIMENSION (approximate)																		
350 A SIZ		A	L	A W BUTTE VAL\	RFLY	B LE GAT VALV	E	С	;	D	1	E OS&Y (		E OS& CLOS		E WIT BUTTEF VALVE	RFLY	F	:	Ģ	;
in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm
2 1/2	65	35 1/8	892	32 1/8	816	20 1/8	511	4 1/2	114	9	229	16 3/8	416	13 7/8	352	8	203	6	152	7 1/4	184
3	80	36 1/8	918	33	838	20 1/8	511	4 1/2	114	9	229	18 7/8	479	15 5/8	397	8	203	6	152	7 1/4	184
4	100	38 1/4	972	33 1/4	845	19 7/8	505	4 1/2	114	9	229	22 3/4	578	18 1/4	464	9 1/8	232	6	152	8	203
6	150	47 1/4	1200	40 1/4	1022	25 7/8	657	5 1/2	140	10 1/2	267	30 1/8	765	23 3/4	603	10 1/8	257	7	178	10	254
8	200	62	1575	55	1397	38 1/2	978	10	254	12	305	37 3/4	959	29 1/4	743	11 15/16	303	8 1/2	216	11	279
10	250	64 5/8	1642	58 1/2	1485	38 1/2	978	10	254	12	305	45 3/4	1162	35 3/8	899	13 5/16	338	81/2	216	12	305

Attention: Model 350ADA (grooved body) and Model 350DA (flange body) have different lay lengths.

(Patent No. 5,913,331)

#### DOCUMENT #: BF-350ADA

REVISION: 3/12

Page 1 of 2

MATERIALS

Main valve body

Fasteners & springs

Access covers


Coatings

Internals

Elastomers

Polymers

MODEL 350ADA with OS&Y option



Ductile Iron ASTM A 536 Grade 4

Ductile Iron ASTM A 536 Grade 4

Stainless steel, 300 Series

Stainless Steel, 300 Series


Buna Nitrile (FDA approved)

NORYL™, NSF Listed

EPDM (FDA approved)

NORYL™, NSF Listed


FDA Approved electrostatic epoxy finish



MODEL 350ADA with BGVIC option

# **FLOW CHARACTERISTICS**


#### MODEL 350ADA 2 1/2", 3" & 4" (STANDARD & METRIC)

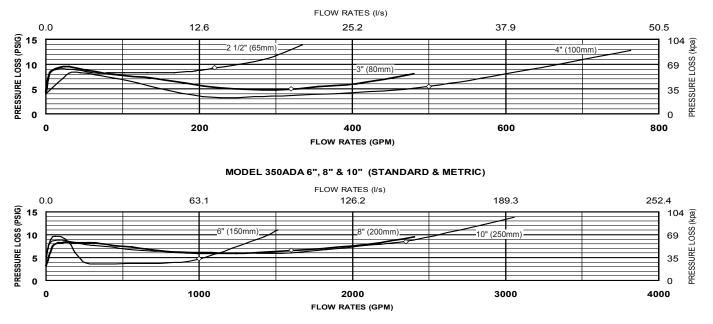


♦ Rated Flow (Established by approval agencies)

### TYPICAL INSTALLATION

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

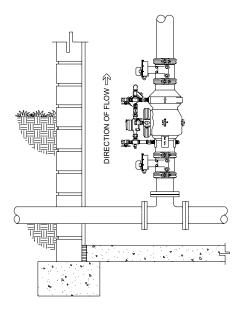

Capacity thru Schedule 40 Pipe (GPM)										
Pipe size	5 ft/sec	7.5 ft/sec	10ft/sec	15 ft/sec						
2 1/2"	75	112	149	224						
3"	115	173	230	346						
4"	198	298	397	595						
6"	450	675	900	1351						
8"	780	1169	1559	2339						
10"	1229	1843	2458	3687						
12"	1763	2644	3525	5288						



# MODEL 350ADABGVIC (VERTICAL INSTALLATION)

#### **SPECIFICATIONS**

The Double Check Detector Backflow Prevention Assembly shall be ASSE® Listed 1048, and supplied with full port gate valves. The main body and access cover shall be epoxy coated ductile iron (ASTM A 536 Grade 4), the seat ring and check valve shall be NoryI<sup>™</sup> (NSF Listed), the stem shall be stainless steel (ASTM A 276) and the seat disc elastomers shall be EPDM. The first and second check valves shall be accessible for maintenance without removing the device from the line. The Double Check Detector Backflow Prevention Assembly shall be a WILKINS Model 350ADA.

WILKINS a Zurn company, 1747 Commerce Way, Paso Robles, CA 93446 Phone:805/238-7100 Fax:805/238-5766 IN CANADA: ZURN INDUSTRIES LIMITED, 3544 Nashua Dr., Mississauga, Ontario L4V 1L2 Phone:905/405-8272 Fax:905/405-1292 Product Support Help Line: 1-877-BACKFLOW (1-877-222-5356) • Website: http://www.zurn.com