





## COMMERCIAL SINGLE PACKAGE ROOFTOP GAS HEATING/ELECTRIC COOLING UNITS

**Model 580F**  
**The DuraPac Series**  
**Sizes 036-150**  
3 to 12<sup>1</sup>/<sub>2</sub> Tons

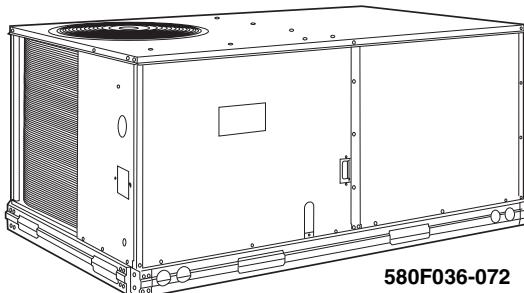

580F036-072

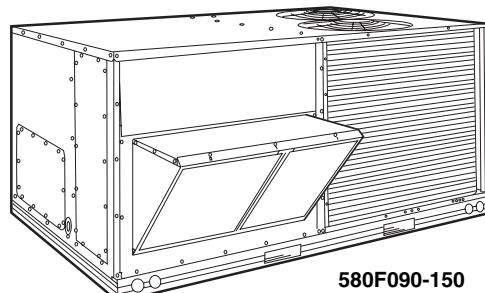

580F090-150

### Standard-Efficiency Rooftop Units with:

- Exclusive integrated gas control board with diagnostics
- Alumagard™ heat exchanger coating
- Induced-draft fan for gas combustion
- Tubular, dimpled heat exchangers
- Pre-painted galvanized steel cabinet for long life and quality appearance
- Commercial strength base rails with built-in rigging capability
- Convertible design for vertical or horizontal supply/return
- Non-corrosive, sloped condensate drain pan, meets ASHRAE 62 (IAQ)
- Two-inch return-air filters (IAQ)
- A wide assortment of factory-installed options available, including high static drives that provide additional performance range
- High and low (loss-of-charge) pressure switches and freezestat
- Refrigerant filter drier

### FEATURES/BENEFITS

Every compact one-piece unit arrives fully assembled, charged, tested, and ready to run.

**INTEGRATED GAS CONTROLLER (IGC)** — All ignition components are contained in the compact IGC which is easily accessible for servicing. The IGC control board provides built-in diagnostic capability. An LED (light-emitting diode) simplifies troubleshooting by providing visual fault notification and system status confirmation.

The IGC also contains an exclusive anti-cycle protection for gas heat operation. After 4 continuous cycles on the unit high-temperature limit switch, the gas heat operation is disabled, and an error code is issued. This feature greatly improves reliability of the rooftop unit.

The IGC also contains burner control logic for accurate and dependable gas ignition. The LED is visible without removing the unit control box access panel. This LED fault-notification system reduces service person troubleshooting time and minimizes service costs. The IGC also maximizes heating efficiency by controlling indoor-fan on and off delays.

**QUIET, EFFICIENT OPERATION AND DEPENDABLE PERFORMANCE** — Compressors have vibration isolators for quiet operation. Efficient fan and motor design permits operation at low sound levels and all 580F units are mounted either on

mounting plate (036-072) or on an exclusive polycore plate (090-150).

The 580F090-150 units offer lower utility costs through part-load operation using 2 stages of cooling.

Quiet and efficient operation is provided by two-speed direct-drive evaporator fans on sizes 036-060 and by belt-driven evaporator fans (on all units). The belt-driven evaporator-fans are equipped with variable-pitch pulleys which allow adjustment within the rpm ranges of the factory-supplied pulleys.

Increased operating efficiency is achieved through computer-designed coils featuring staggered internally enhanced copper tubes. Fins are ripple-edged for strength, lanced, and double waved for higher heat transfer.

Tubular, dimpled gas heat exchangers optimize heat transfer for improved efficiency. The tubular design permits hot gases to make multiple passes across the path of the supply air. The dimpled design creates a turbulent gas flow to maximize heating efficiency.

The California Air Quality Management Districts NO<sub>x</sub> requirement of 40 nanograms/joule or less is met on 036-060 size Low NO<sub>x</sub> models.

The extra thick Alumagard™ heat exchanger coating provides corrosion resistance and ensures long life. Low NO<sub>x</sub> models have 409 stainless steel firing tubes.

The unsightly appearance of flue stacks is eliminated and the effects of wind on heating operations are diminished by the induced draft combustion system. The inducer fan draws hot combustion gas through the heat exchanger at the optimum rate for the most effective heat transfer. The heat exchanger operates under negative pressure, preventing flue gas leakage into the indoor supply air.

During the Heating mode, the evaporator-fan relay automatically starts the evaporator fan after the heat exchanger warms up to a suitable temperature. The 30-second fan delay prevents cold air from entering the supply duct system when the conditioned space is calling for heat to maximize efficiency and comfort.

The direct-spark ignition system saves operating expense when compared to pilot ignition systems. No crossover tube is required, therefore no sooting or pilot fouling problems can occur.

All 580F standard units are designed for natural gas, but an accessory LP (liquid propane) conversion kit is available.

**SAFETY IS BUILT IN** — All 580F units have a flame rectification sensor to quickly sense the burner flame and ignite burners almost immediately. Fast shutdown is a certainty since the sensor reacts quickly to any flame outage or system failure. In the event of a shutdown, an error code is issued at the IGC board.

Safety is also assured due to the heating safety controls which will shut down the unit if there is a problem. If excessive temperatures develop, limit switches shut off the gas valve. After 4 continuous short cycles of the high-temperature limit switch, the IGC board locks out the gas heat cycle to prevent any further short cycles. The rollout switch also deenergizes the gas valve in the event of a flame rollout.

**DURABLE, DEPENDABLE CONSTRUCTION** — Designed for durability in any climate, the weather-resistant cabinets are constructed of galvanized steel and bonderized, and all exterior panels are coated with a prepainted baked enamel finish. The paint finish is non-chalking, and is capable of withstanding ASTM B117 500-hour Salt Spray Test. All internal cabinet panels are primed, permitting longer life and a more attractive appearance for the entire unit.

In addition, all 580F units are designed with a single, continuous top piece to eliminate any possible leaks. Totally enclosed condenser-fan motors and permanently lubricated bearings provide additional unit dependability.

**EASY INSTALLATION AND CONVERSION** — All units are shipped in the vertical duct configuration for fit-up to standard roof curbs. (Two different curb sizes fit unit sizes 036-072 and 090-150, respectively.) The contractor can order and install the roof curb early in the construction stage, before decisions on size requirements are made.

All units feature roll-formed base rail design with forklift slots and rigging holes for easier maneuvering. (Forklift slots are found on 3 sides.) The 580F036-060 base units have operating weights under 500 lb and durable packaging protects all units during shipment and storage.

The units can be easily converted from a vertical to a horizontal duct configuration by relocating the panels supplied with the unit.

The non-corrosive sloped condensate pan permits either an external horizontal side condensate drain (outside the roof curb) or an internal vertical bottom drain (inside the roof curb). Both options require an external, field-supplied P-trap.

The 580F units were designed with service technicians in mind. The single-row condenser coils on the 580F036 and 090 units simplify the cleaning process. The efficient in-shot burners and all ignition components are contained in an easily removable, compact assembly.

The 580F units also have a standard filter access panel, which permits tool-less filter changes, even on units with horizontal economizers.

**SIMPLE ELECTRICAL CONNECTIONS** — Terminal boards, located in the base unit control box, facilitate connections to room thermostat, outdoor thermostat(s), and economizer. Service panels are quickly removed, permitting easy servicing.

Thru-the-bottom utility connection capability allow power, control wiring, and gas to be routed through unit base pan, minimizing roof penetrations. Gas, power, and control connections are made on the same side of the unit to simplify installation.

In addition, color-coded wires permit easy tracing and diagnostics.

**PROVEN COMPRESSOR RELIABILITY** — Design techniques feature computer-programmed balance between compressor, condenser, and evaporator. Bryant-specified hermetic compressors are equipped with compressor overcurrent and overtemperature protection to ensure dependability.

All 580F units have a fixed orifice metering device which precisely controls refrigerant flow, preventing slugging and

flood-back, while maintaining optimum unit performance. High and low (loss-of-charge) pressure switches, freezestat and refrigerant filter driers are standard.

**INTEGRATED ECONOMIZERS AND OUTDOOR AIR** — Optional economizers and manual outdoor-air dampers introduce outdoor air which mixes with the conditioned air, improving indoor-air quality and often reducing energy consumption.

During a first stage call for cooling, if the outdoor-air temperature is below the economizer control changeover set point, the discharge-air sensor modulates the economizer outdoor-air damper open to take advantage of free cooling provided by the outside air. When second-stage cooling is called for, the compressor is energized in addition to the economizer. If the outdoor-air temperature is above the changeover set point, the first stage of compression is activated and the economizer stays at vent position. Durablade economizer operation is controlled by a dry-bulb thermostat that senses outdoor-air temperature.

Accessory upgrade kits allow for either outdoor air enthalpy changeover or for more precise differential enthalpy control.

The Durablade economizer (option or accessory) has a reliable sliding plate damper which is easily adjusted for 100% outdoor air, 100% return air, or any proportions of mixed air.

The 580F units can also utilize the factory or field-installed EconoMi\$er. The EconoMi\$er is microprocessor controlled and incorporates a parallel, opposed-blade gear driven damper system. In addition, it has a spring return built into the damper actuator to provide reliable close-on-power-loss. The EconoMi\$er comes equipped with up to 90% barometric relief capability for high outdoor airflow applications. EconoMi\$er operation is controlled by a dry-bulb thermostat that senses outdoor air temperature.

Accessory upgrade kits allow for either outdoor air enthalpy changeover or for more precise differential enthalpy control.

In addition, the EconoMi\$er two-stage power exhaust accessory can be utilized to help maintain proper building pressure.

For units without economizer, year-round ventilation is enhanced by a manual outdoor-air damper (ordered as an accessory or an option). The damper can be preset to admit up to 50% outdoor air.


**INDOOR-AIR QUALITY BEGINS WITH BRYANT ROOF-TOPS** — Sloped condensate pans minimize biological growth in rooftop units in accordance with ASHRAE (American Society of Heating, Refrigeration, and Air Conditioning Engineers) Standard 62. Two-inch filters with optional dirty filter indicator switch provide for greater particle reduction in the return air. The face-split evaporator coils (090-150) improve the dehumidification capability of standard units, maximize building humidity control.

Optional proportional reacting CO<sub>2</sub> sensor is available to work with the EconoMi\$er to aid IAQ benefits.

## TABLE OF CONTENTS

	Page
Features/Benefits . . . . .	1,2
Model Number Nomenclature . . . . .	3
ARI Capacity Ratings . . . . .	4
Physical Data . . . . .	5-8
Options and Accessories . . . . .	9-11
Base Unit Dimensions . . . . .	12,13
Accessory Dimensions . . . . .	14,15
Selection Procedure . . . . .	16
Performance Data . . . . .	17-50
Electrical Data . . . . .	51-54
Typical Piping and Wiring . . . . .	55
Controls . . . . .	56
Application Data . . . . .	57
Typical Wiring Schematic . . . . .	58,59
Guide Specifications . . . . .	60-62

## MODEL NUMBER NOMENCLATURE

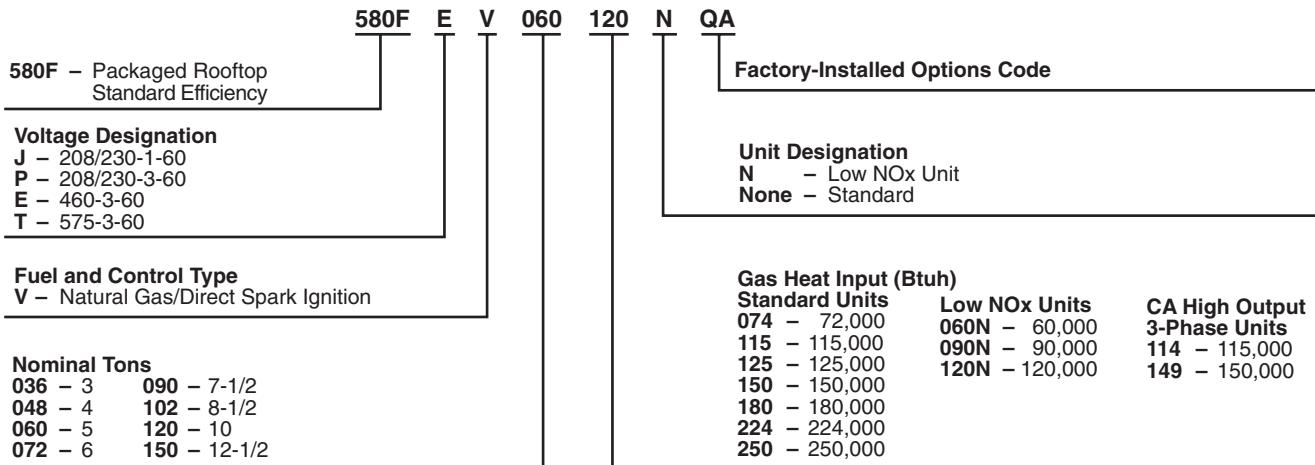

**NOTE:** The example model number 558FEV060120NQA designates a 5 ton 460-3-60 volt Low NO<sub>x</sub>, gas/electric rooftop unit with 120,000 Btuh natural gas heat, Durablade economizer and alternate drive. Low NO<sub>x</sub> units must show the "N" designation in the model number.

## ARI\* CAPACITY RATINGS

UNIT 580F	NOMINAL TONS	STANDARD CFM	NET COOLING CAPACITY (Btu/h)	TOTAL kW	SEER†		SOUND RATING (dB)
					Belt Drive	Direct Drive	
036	3	1200	35,000	4.0	10.0	9.7	81
048	4	1600	47,000	5.5	10.0	9.7	81
060	5	2000	57,000	6.7	10.0	9.7	81

UNIT 580F	NOMINAL TONS	STANDARD CFM	NET COOLING CAPACITY (Btu/h)	TOTAL kW	EER	SOUND RATING (dB)	IPLV
072	6	2100	72,000	8.0	9.0	81	**
090	7½	2800	85,000	9.6	8.9	87	9.35
102	8½	3000	99,000	11.0	9.0	87	9.00
120	10	4000	117,000	13.0	9.0	88	9.35
150	12½	4500	145,000	16.1	9.0	87	9.20

### LEGEND

**dB** — Sound Levels (decibels)  
**db** — Dry Bulb  
**EER** — Energy Efficiency Ratio  
**IPLV** — Integrated Part-Load Values  
**SEER** — Seasonal Energy Efficiency Ratio  
**wb** — Wet Bulb

\*Air Conditioning and Refrigeration Institute.

†Applies only to units with capacity of 65,000 Btu/h or less.

\*\*The IPLV applies only to two-stage cooling units.

### NOTES:

1. Rated in accordance with ARI Standards 210/240, latest revision (for sizes 036-120) or 360, latest revision (for size 150) and 270, latest revision.

2. ARI ratings are net values, reflecting the effects of circulating fan heat.

3. Ratings are based on:

**Cooling Standard:** 80 F db, 67 F wb indoor entering-air temperature and 95 F db air entering outdoor unit.

**IPLV Standard:** 80 F db, 67 F wb indoor entering-air temperature and 80 F db outdoor entering-air temperature.



## HEATING CAPACITIES AND EFFICIENCIES

UNIT 580F	HEATING INPUT (Btu/h) Stage 2/Stage 1	OUTPUT CAPACITY (Btu/h)	TEMPERATURE RISE (F)	AFUE (%)	STEADY-STATE EFFICIENCY (%)
036074	—/ 72,000	59,200	25-55	80.0	80.0
036114*	—/115,000	92,000	55-85	80.0	80.0
036115†	115,000/ 82,000	92,000	55-85	80.0	80.0
036060N**	—/ 60,000	49,000	20-50	80.0	80.0
036090N**	—/ 90,000	73,000	30-60	80.0	80.0
048074	—/ 72,000	59,200	25-55	80.0	80.0
048115	—/115,000	92,000	35-65	80.0	80.0
048149*	—/150,000	120,000	50-80	80.0	80.0
048150†	150,000/120,000	120,000	50-80	80.0	80.0
048060N**	—/ 60,000	49,000	20-50	80.0	80.0
048090N**	—/ 90,000	73,000	30-60	80.0	80.0
048120N**	—/120,000	98,000	40-70	80.0	80.0
060074	—/ 72,000	59,200	25-55	80.0	80.0
060115	—/115,000	92,000	35-65	80.0	80.0
060149*	—/150,000	120,000	50-80	80.0	80.0
060150†	150,000/120,000	120,000	50-80	80.0	80.0
060060N**	—/ 60,000	49,000	20-50	80.0	80.0
060090N**	—/ 90,000	73,000	30-60	80.0	80.0
060120N**	—/120,000	98,000	40-70	80.0	80.0
072074	—/ 72,000	59,200	25-55	80.0	80.0
072115	—/115,000	92,000	35-65	80.0	80.0
072150	150,000/120,000	120,000	50-80	80.0	80.0
090125	—/125,000	100,000	20-50	80.0	80.0
090180	180,000/120,000	144,000	35-65	80.0	80.0
090224	224,000/180,000	179,200	45-75	80.0	80.0
102125	—/125,000	100,000	20-50	80.0	80.0
102180	180,000/120,000	144,000	35-65	80.0	80.0
102224	224,000/180,000	179,200	45-75	80.0	80.0
120180	180,000/120,000	144,000	35-65	80.0	80.0
120224	224,000/180,000	179,200	35-65	80.0	80.0
120250	250,000/200,000	200,000	40-70	80.0	80.0
150224	224,000/180,000	179,200	35-65	80.0	80.0
150250	250,000/200,000	200,000	40-70	80.0	80.0

### LEGEND

**AFUE** — Annual Fuel Utilization Efficiency

\*California compliant three-phase high heat models.

†Three-phase standard high heat models have heating input values as shown. Single-phase standard high heat models have one-stage heating with heating input values as follows:

580FJV036115, 115,000 Btuh

580FJV048150, 150,000 Btuh

580FJV060150, 150,000 Btuh

\*\*California SCAQMD compliant Low NO<sub>x</sub> models have combustion products that are controlled to 40 nanograms per joule or less.

# PHYSICAL DATA — 580F036-072

UNIT SIZE 580F	036	048	060	072
<b>NOMINAL CAPACITY (tons)</b>	3	4	5	6
<b>OPERATING WEIGHT (lb)</b>				
Unit				
Al/Al*	460	470	490	565
Al/Cu*	465	476	497	576
Cu/Cu*	468	482	505	587
Economizer				
Durablade	34	34	34	34
EconoMi\$er	47	47	47	47
Roof Curb†	115	115	115	115
<b>COMPRESSOR</b>		Reciprocating		Scroll
Quantity	1	1	1	1
No. Cylinders (per Circuit)	2	2	2	—
Oil (oz)	50	50	50	54
<b>REFRIGERANT TYPE</b>		R-22		
Expansion Device		Fixed Orifice Metering Device		
Operating Charge (lb-oz)				
Circuit 1	4-4	6-6	6-14	9-0
Circuit 2	—	—	—	—
<b>CONDENSER COIL</b>		Enhanced Copper Tubes, Aluminum Lanced Fins		
Rows...Fins/in.	1...17	2...17	2...17	2...17
Total Face Area (sq ft)	8.36	8.36	10.42	10.42
<b>CONDENSER FAN</b>		Propeller Type		
Nominal Cfm	3500	4000	4000	4000
Quantity...Diameter (in.)	1...22.0 1/4...1100 325	1...22.0 1/4...1100 325	1...22.0 1/4...1100 325	1...22.0 1/4...1100 325
Motor Hp...Rpm				
Watts Input (Total)				
<b>EVAPORATOR COIL</b>		Enhanced Copper Tubes, Aluminum Double-Wavy Fins		
Rows...Fins/in.	2...15	2...15	3...15	4...15
Total Face Area (sq ft)	4.17	5.5	5.5	5.5
<b>EVAPORATOR FAN</b>		Centrifugal Type		
Quantity...Size (in.)	Std Alt High-Static	1...10 x 10 1...10 x 10 1...10 x 10	1...10 x 10 1...10 x 10 1...11 x 10	1...11 x 10 1...10 x 10 1...10 x 10
Type Drive	Std Alt High-Static	Direct Belt Belt	Direct Belt Belt	Direct Belt Belt
Nominal Cfm	1200	1600	2000	2400
Maximum Continuous Bhp	Std .34 Alt 1.00	.75 1.00	1.20 2.40	2.40
Motor Frame Size	High-Static 2.40 Std 48 Alt 48 High-Static 56	2.40 48 48 56	2.90 48 56 56	2.90 56 — 56
Nominal Rpm High/Low	Std 860/800 Alt 1620 High-Static 1725	1075/970 1620 1725	1075/970 1725 1725	1725 — 1725
Fan Rpm Range	Std — Alt 760-1000 High-Static 1075-1455	— 835-1185 Ball	— 1075-1455 Ball	— 900-1300 Ball
Motor Bearing Type				
Maximum Allowable Rpm				
Motor Pulley Pitch Diameter Min/Max (in.)	Std — Alt 1.9/2.9 High-Static 2.8/3.8	— 1.9/2.9 2.8/3.8	— 2.4/3.4 3.4/4.4	— 2.8/3.8 3.4/4.4
Nominal Motor Shaft Diameter (in.)	Std 1/2 Alt 1/2 High-Static 5/8	1/2 5/8 5/8	1/2 5/8 5/8	5/8 — 5/8
Fan Pulley Pitch Diameter (in.)	Std — Alt 4.5 High-Static 4.5	— 4.0 4.5	— 4.5 4.5	— 4.5 4.5
Belt, Quantity...Type...Length (in.)	Std — Alt 1...A...34 High-Static 1...A...39	— 1...A...34 1...A...39	— 1...A...39 1...A...40	— 1...A...40 1...A...40
Pulley Center Line Distance (in.)	Std — Alt 10.0-12.4 High-Static 10.0-12.4	— 10.0-12.4 10.0-12.4	— 14.7-15.5 14.7-15.5	— 14.7-15.5 14.7-15.5
Speed Change per Full Turn of Movable Pulley Flange (rpm)	Std — Alt 48 High-Static 65	— 70 65	— 80 60	— 80 60
Movable Pulley Maximum Full Turns From Closed Position	Std — Alt 5 High-Static 6	— 5 6	— 5 5	— 5 5
Factory Setting	Std — Alt 3 High-Static 3 1/2	— 3 3 1/2	— 3 3 1/2	— 3 3 1/2
Factory Speed Setting (rpm)	Std — Alt 856 High-Static 1233	— 975 1233	— 1060 1396	— 1225 1396
Fan Shaft Diameter at Pulley (in.)	Std 5/8 Alt — High-Static 5/8	5/8	5/8	5/8

## LEGEND

**Al** — Aluminum  
**Bhp** — Brake Horsepower  
**Cu** — Copper

\*Evaporator coil fin material/condenser coil fin material. Contact your local representative for details about coated fins.

†Weight of 14-in. roof curb.

\*\*Single phase/three-phase.

††Rollout switch lockout is manually reset by interrupting power to unit or resetting thermostat.

## PHYSICAL DATA — 580F036-072 (cont)

UNIT SIZE 580F		036	048	060	072
<b>FURNACE SECTION</b>					
Rollout Switch Cutout					
Temp (F)††		195	195	195	195
Burner Orifice Diameter (in. ...drill size)					
Natural Gas	Std	.074 114/115 149/150 060N 090N 120N	.113...33 .113...33 — .102...38 .102...38 —	.113...33 .113...33 .129...30 .102...38 .102...38 .116...32	.113...33 .113...33 .129...30 .102...38 .102...38 —
Liquid Propane	Alt	.074 114/115 149/150 060N 090N 120N	.089...43 .089...43 .089...43 .082...45 .082...45 —	.089...43 .089...43 .102...38 .082...45 .082...45 .094...42	.089...43 .089...43 .102...38 — — —
Thermostat Heat Anticipator Setting (amps)					
208/230 v and 575	Stage 1		.14	.14	.14
	Stage 2		.14	.14	.14
460 v	Stage 1		.14	.14	.14
	Stage 2		.14	.14	.14
Gas Input (Btuh)	Stage 2/Stage 1	114II 149II 074 115*** 150*** 060N††† 090N††† 120N†††	—/115,000 —/150,000 —/72,000 115,000/82,000 — 150,000/120,000 —/60,000 —/90,000 —	—/150,000 —/72,000 —/115,000 —/115,000 150,000/120,000 —/60,000 —/90,000 —/120,000	—/150,000 —/72,000 —/115,000 —/115,000 150,000/120,000 —/60,000 —/90,000 —/120,000
Efficiency (Steady State) (%)			80	80	80
Temperature Rise Range		074 114/115 149/150 060N 090N 120N	25-55 55-85 — 20-50 30-60 —	25-55 35-65 50-80 20-50 30-60 40-70	25-55 35-65 50-80 — — —
Manifold Pressure (in. wg)					
Natural Gas	Std		3.5	3.5	3.5
Liquid Propane	Alt		3.5	3.5	3.5
Gas Valve Quantity			1	1	1
Gas Valve Pressure Range					
Psig			0.180-0.487	0.180-0.487	0.180-0.487
in. wg			5.0-13.5	5.0-13.5	5.0-13.5
Field Gas Connection Size (in.)			1/2	1/2	1/2
<b>HIGH-PRESSURE SWITCH (psig)</b>					
Standard Compressor				450 ± 50	500 ± 50
Internal Relief (Differential)				428	428
Cutout				320	320
Reset (Auto.)				7 ± 3 22 ± 7	
<b>LOSS-OF-CHARGE (LOW-PRESSURE SWITCH) (psig)</b>					
Cutout				7 ± 3	
Reset (Auto.)				22 ± 7	
<b>FREEZE PROTECTION THERMOSTAT (F)</b>					
Opens				30 ± 5	
Closes				45 ± 5	
<b>OUTDOOR-AIR INLET SCREENS</b>					
Quantity...Size (in.)				Cleanable	
				1...20 x 24 x 1	
<b>RETURN-AIR FILTERS</b>					
Quantity...Size (in.)				Throwaway	
				2...16 x 25 x 2	

### LEGEND

Al — Aluminum  
Bhp — Brake Horsepower  
Cu — Copper

\*Evaporator coil fin material/condenser coil fin material. Contact your local representative for details about coated fins.

†Weight of 14-in. roof curb.

\*\*Single phase/three-phase.

††Rollout switch lockout is manually reset by interrupting power to unit or resetting thermostat.

||California compliant three-phase high heat models.

\*\*\*Three-phase standard high heat models have heating input values as shown.  
Single-phase standard high heat models have one-stage heating with heating input values as follows:

580FJV036115, 115,000 Btuh

580FJV048150, 150,000 Btuh

580FJV060150, 150,000 Btuh

†††California SCAQMD compliant Low NO<sub>x</sub> models have combustion products that are controlled to 40 nanograms per joule or less..

## PHYSICAL DATA — 580F090-150

UNIT SIZE 580F	090	102	120	150
NOMINAL CAPACITY (tons)	7 <sup>1</sup> / <sub>2</sub>	8 <sup>1</sup> / <sub>2</sub>	10	12 <sup>1</sup> / <sub>2</sub>
OPERATING WEIGHT (lb)				
Unit				
Al/Al*	870	880	1035	1050
Al/Cu*	881	896	1057	1077
Cu/Cu*	893	907	1080	1100
Economizer				
Durablade	44	44	44	44
EconoMi\$er	62	62	62	62
Roof Curb†	143	143	143	143
COMPRESSOR	Reciprocating	Reciprocating	Reciprocating	Scroll
Quantity	2	2	2	2
No. Cylinders (per Circuit)	2	2	2	—
Oil (oz)	42 ea	65 ea	54 ea	54 ea
REFRIGERANT TYPE	R-22			
Expansion Device				
Operating Charge (lb-oz)				
Circuit 1	4-13	6-14	7- 3	8-10
Circuit 2	4-14	9- 2	7-13	8- 6
CONDENSER COIL				
Rows...Fins/in.	1...17	2...17	2...17	2...17
Total Face Area (sq ft)	20.50	18.00	20.47	25.00
CONDENSER FAN				
Nominal Cfm	6400	6400	7000	7000
Quantity...Diameter (in.)	2...22	2...22	2...22	2...22
Motor Hp...Rpm	1 <sup>1</sup> / <sub>4</sub> ...1100			
Watts Input (Total)	600	600	600	600
EVAPORATOR COIL				
Rows...Fins/in.	3...15	3...15	3...15	4...15
Total Face Area (sq ft)	8.0	8.0	10.0	11.1
EVAPORATOR FAN				Centrifugal Type
Quantity...Size (in.)	Std	1...15 x 15	1...15 x 15	1...15 x 15
	Alt	1...15 x 15	—	1...15 x 15
Type Drive	High-Static	1...15 x 15	1...15 x 15	—
	Std	Belt	Belt	Belt
	Alt	Belt	—	Belt
	High-Static	Belt	Belt	Belt
Nominal Cfm	3000	3100	4000	5000
Maximum Continuous Bhp	Std	2.40	2.40	2.40
	Alt	2.40	—	2.90
	High-Static	3.70	3.70	5.25
Motor Frame Size	Std	56	56	56
	Alt	56	—	56
	High-Static	56	56	56
Nominal Rpm High/Low	Std	—	—	—
	Alt	—	—	—
	High-Static	1725	1725	1725
Fan Rpm Range	Std	590-840	685-935	685-935
	Alt	685-935	—	835-1085
	High-Static	860-1080	860-1080	830-1130
Motor Bearing Type		Ball	Ball	Ball
Maximum Allowable Rpm		2100	2100	2100
Motor Pulley Pitch Diameter Min/Max (in.)	Std	2.4/3.4	2.8/3.8	2.8/3.8
	Alt	2.8/3.8	—	3.4/4.4
	High-Static	4.0/5.0	4.0/5.0	2.8/3.8
Nominal Motor Shaft Diameter (in.)	Std	5 <sup>1</sup> / <sub>8</sub>	5 <sup>1</sup> / <sub>8</sub>	7 <sup>1</sup> / <sub>8</sub>
	Alt	1 <sup>1</sup> / <sub>2</sub>	—	7 <sup>1</sup> / <sub>8</sub>
	High-Static	7 <sup>1</sup> / <sub>8</sub>	7 <sup>1</sup> / <sub>8</sub>	—
Fan Pulley Pitch Diameter (in.)	Std	7.0	7.0	7.0
	Alt	7.0	—	7.0
	High-Static	8.0	8.0	5.8
Belt, Quantity...Type...Length (in.)	Std	1...A...49	1...A...49	1...A...49
	Alt	1...A...49	—	1...A...49
	High-Static	1...A...55	1...A...55	1...BX...46
Pulley Center Line Distance (in.)	Std	16.75-19.25	16.75-19.25	15.85-17.50
	Alt	16.75-19.25	—	15.85-17.50
	High-Static	16.75-19.25	16.75-19.25	15.85-17.50
Speed Change per Full Turn of Movable Pulley Flange (rpm)	Std	50	50	44
	Alt	50	—	50
	High-Static	60	60	—
Movable Pulley Maximum Full Turns From Closed Position	Std	5	5	5
	Alt	5	—	6
	High-Static	5	5	—
Factory Setting	Std	5	5	5
	Alt	5	—	5
	High-Static	5	5	—
Factory Speed Setting (rpm)	Std	590	665	685
	Alt	685	—	835
	High-Static	860	860	887
Fan Shaft Diameter at Pulley (in.)		1	1	1

### LEGEND

Al — Aluminum  
 Bhp — Brake Horsepower  
 Cu — Copper

\*Evaporator coil fin material/condenser coil fin material. Contact your local representative for details about coated fins.

†Weight of 14-in. roof curb.

\*\*Rollout switch lockout is manually reset by interrupting power to unit or resetting thermostat.

NOTE: High-static motor not available on size 150 units.

## PHYSICAL DATA — 580F090-150 (cont)

UNIT SIZE 580F	HEAT	090	102	120	150
<b>FURNACE SECTION</b>					
Rollout Switch Cutout					
Temp (F)**		195	195	195	195
Burner Orifice Diameter (in. ...drill size)					
Natural Gas	Std	Lo .120...31 Med .120...31 Hi .120...31	.120...31 .120...31 .120...31	.120...31 .120...31 .129...30	.120...31 .129...30
Liquid Propane	Alt	Lo .096...41 Med .096...41 Hi .096...41	.096...41 .096...41 .096...41	.096...41 .096...41 .102...38	.096...41 .102...38
Thermostat Heat Anticipator Setting (amps)					
208/230 v and 575 Stage 1		.14	.14	.14	.14
Stage 2		.20	.20	.20	.20
460 v		.14	.14	.14	.14
Stage 1		.20	.20	.20	.20
Gas Input (Btuh) Stage 2/Stage 1	Lo Med Hi	—/125,000 180,000/120,000 224,000/180,000	—/125,000 180,000/120,000 224,000/180,000	180,000/120,000 224,000/180,000 250,000/200,000	224,000/180,000 250,000/200,000 —/—
Efficiency (Steady State) (%)		80	80	80	80
Temperature Rise Range	Lo Med Hi	20-50 35-65 45-75	20-50 35-65 45-75	35-65 35-65 40-70	35-65 40-70
Manifold Pressure (in. wg)					
Natural Gas	Std	3.5	3.5	3.5	3.5
Liquid Propane	Alt	3.5	3.5	3.5	3.5
Gas Valve Quantity		1	1	1	1
Gas Valve Pressure Range					
Psig		0.180-0.487	0.180-0.487	0.180-0.487	0.180-0.487
in. wg		5.0-13.5	5.0-13.5	5.0-13.5	5.0-13.5
Field Gas Connection Size (in.)		1/2 / 3/4 / 3/4	1/2 / 3/4 / 3/4	3/4 / 3/4 / 3/4	3/4 / 3/4
<b>HIGH-PRESSURE SWITCH (psig)</b>					
Standard Compressor			450 ± 50		500 ± 50
Internal Relief (Differential)					
Cutout			428		428
Reset (Auto.)			320		320
<b>LOSS-OF-CHARGE (LOW-PRESSURE) SWITCH (psig)</b>					
Cutout				7 ± 3	
Reset (Auto.)				22 ± 7	
<b>FREEZE PROTECTION THERMOSTAT (F)</b>					
Opens				30 ± 5	
Closes				45 ± 5	
<b>OUTDOOR-AIR INLET SCREENS</b>					
Quantity...Size (in.)				Cleanable	
				1...20 x 24 x 1 1...16 x 25 x 1	
<b>RETURN-AIR FILTERS</b>					
Quantity...Size (in.)		4...16 x 20 x 2	4...16 x 20 x 2	4...20 x 20 x 2	4...20 x 20 x 2
<b>LEGEND</b>					
Al	—	Aluminum			
Bhp	—	Brake Horsepower			
Cu	—	Copper			

\*Evaporator coil fin material/condenser coil fin material. Contact your local representative for details about coated fins.

†Weight of 14-in. roof curb.

\*\*Rollout switch lockout is manually reset by interrupting power to unit or resetting thermostat.

NOTE: High-static motor not available on size 150 units.

## OPTIONS AND ACCESSORIES

ITEM	OPTION*	ACCESSORY†
High-Static Motor and Drive	X	
EconoMi\$er (Vertical only)	X	X
EconoMi\$er with Power Exhaust (Vertical only)		X
Power Exhaust for EconoMi\$er (Vertical/Horizontal)		X
EconoMi\$er (Horizontal)		X
Durablade Integrated Economizer (Includes Hood)	X	X
Manual Outdoor-Air Damper	X	X
Alternate Drive (090)	X	
Alternate Motor and Drive (036-060,090,120,150)	X	
Unit-Mounted Non-Fused Disconnect**	X	
Convenience Outlet	X	
LP (Liquid Propane) Conversion Kit		X
Electronic Programmable Thermostat		X
Thermostats and Subbases		X
Light Commercial Thermidistat		X
25% Open Two-Position Damper		X
100% Open Two-Position Damper		X
Roof Curbs (Vertical and Horizontal Discharge)		X
Motormaster® IV Head Pressure Control (Cycle Control)		X
Time Guard® II Control Circuit		X
Thru-the-Bottom Utility Connections		X
Condenser Coil Hail Guard Assembly		X
Condenser Coil Grille		X
Flue Shield		X
Flue Discharge Deflector		X
Fan/Filter Status		X
Outdoor Air Enthalpy Sensor (EconoMi\$er Only)		X
Return Air Enthalpy Sensor (EconoMi\$er Only)		X
Return Air Temperature Sensor (EconoMi\$er Only)		X
Indoor Air Quality (CO <sub>2</sub> ) Sensor (EconoMi\$er Only)		X

\*Factory-installed.


†Field-installed.

\*\*Cannot be used if unit electrical rating exceeds 80 amperes.


NOTE: Refer to 580F price pages or contact your local representative for accessory/and option package information.

### Low Ambient Controls

The 580F standard units are designed to operate in cooling at outdoor temperatures down to 25 F. With accessory Motormaster IV control (condenser-fan cycling) units can operate at outdoor temperatures down to -20 F. The head pressure controls, which mount in the condenser section, control the condenser-fan motor to maintain correct condensing temperature.

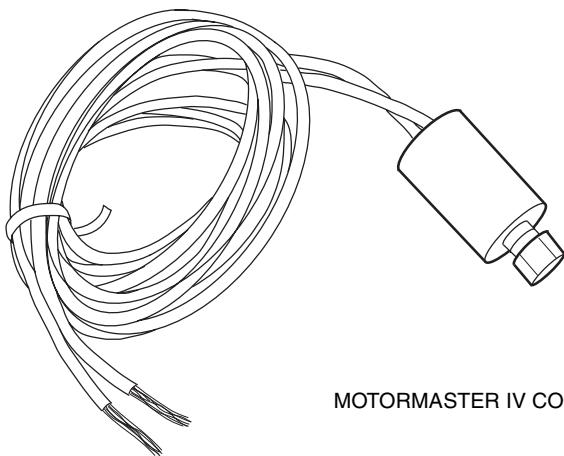

MOTORMASTER IV CONTROL

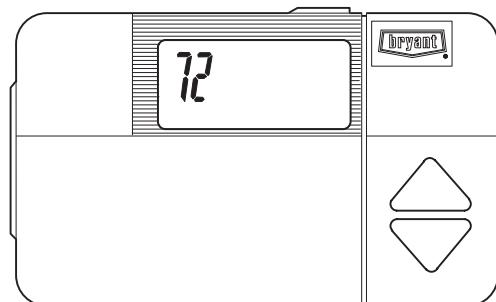

Bryant Commercial Programmable Thermostat

Designed specifically for use with Bryant commercial systems, this Bryant programmable thermostat features LED occupied/unoccupied displays and setback mode which can override continuous fan operation.

### Bryant Light Commercial Thermidistat


The light commercial thermidistat combines temperature control and humidity display in one device and provides continuous fan operation in occupied mode.

### Time Guard II Control

Time Guard II control automatically prevents compressor from restarting for at least 5 minutes after a shutdown. Accessory prevents short cycling of compressor if thermostat is changed rapidly. Time Guard II control mounts in the control compartment of unit.

## OPTIONS AND ACCESSORIES (cont)


### Liquid Propane (LP) Conversion Kits

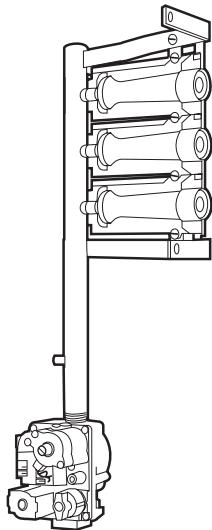

**036-072 SHOWN**


The LP conversion kit allows the unit to utilize a liquid propane fuel supply in areas where natural gas is unavailable, and permits the unit to be converted from natural gas to LP gas use. The kit contains the orifices required for LP operation.

### Durablade® Economizer

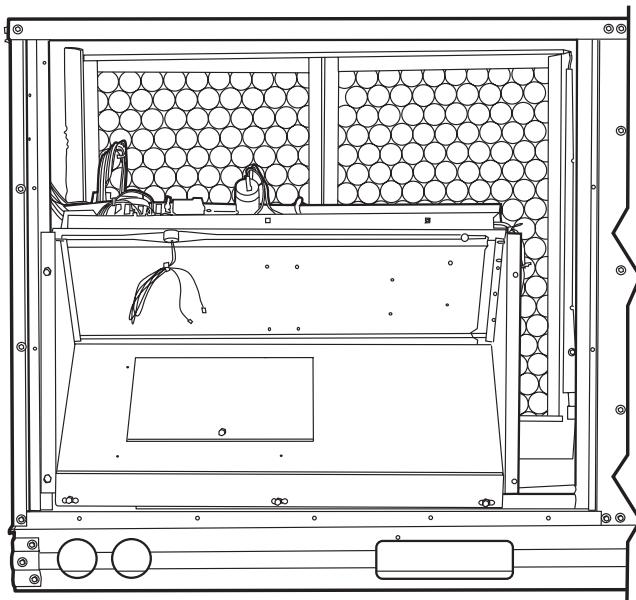

Exclusive Durablade economizer damper design saves energy while providing economical and reliable cooling. A sliding plate on the face of the economizer controls the amount of outdoor air entering the system. Closed, it provides a leakproof seal which prevents ambient air from seeping in or conditioned air from seeping out. It can be adjusted easily for 100% outdoor air or any proportions of mixed air. Like the base unit, the economizer is converted easily for horizontal discharge applications.

### EconoMi\$er

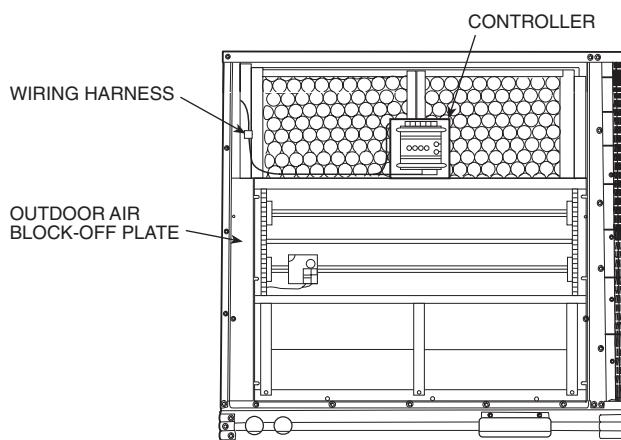


Factory-installed EconoMi\$er utilizes a microprocessor-based control, gear drive damper system, low pressure drop characteristics, built-in spring return (for close upon power loss), and an integral barometric damper.

**NOTE:** EconoMi\$er is available for vertical ductwork applications factory installed.

A vertical EconoMi\$er, two-stage power exhaust and dedicated horizontal EconoMi\$er is available for field installation.


## OPTIONS AND ACCESSORIES (cont)

**Convenience Outlet**

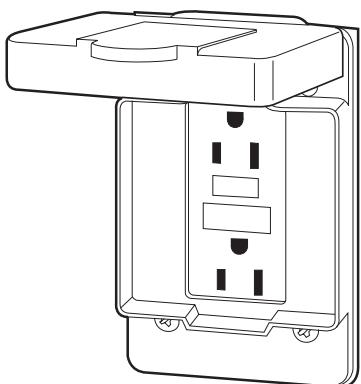

Factory-installed, internally mounted and externally accessible 115-v female receptacle. Includes 15-amp GFI (Ground Fault Interrupter) receptacle with independent fuse protection. Voltage required to operate convenience outlet is provided by a factory-installed transformer.


**Unit Mounted Disconnect**

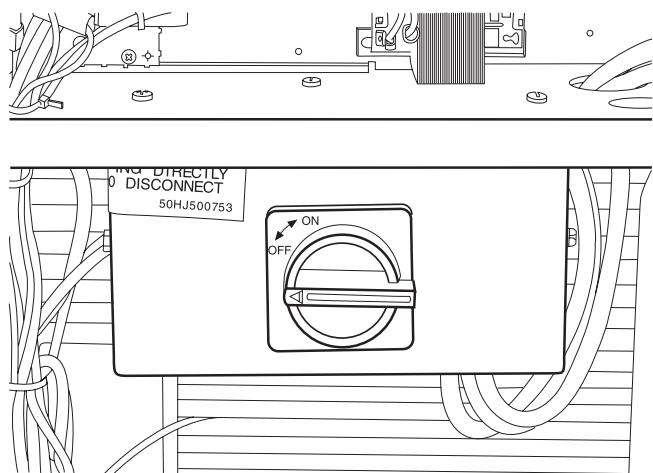

Factory-installed, internally-mounted, NEC (National Electrical Code) and UL (Underwriters' Laboratories) approved non-fused switch provides unit power shutoff with disconnect lockout protection capability. The switch is accessible from outside the unit. (Cannot be used if rooftop electrical rating exceeds 80 amperes.)

## **BASE UNIT DIMENSIONS — 580F036-072**

THREADED CONDUIT SIZE	WIRE USE	REQUIRED HOLE SIZES (MAX.)
1/2"	24 V Power	7/8" [22.2]
3/4"	Gas	1 1/8" [28.4]
1 1/2"		1 1/4" [31.8]

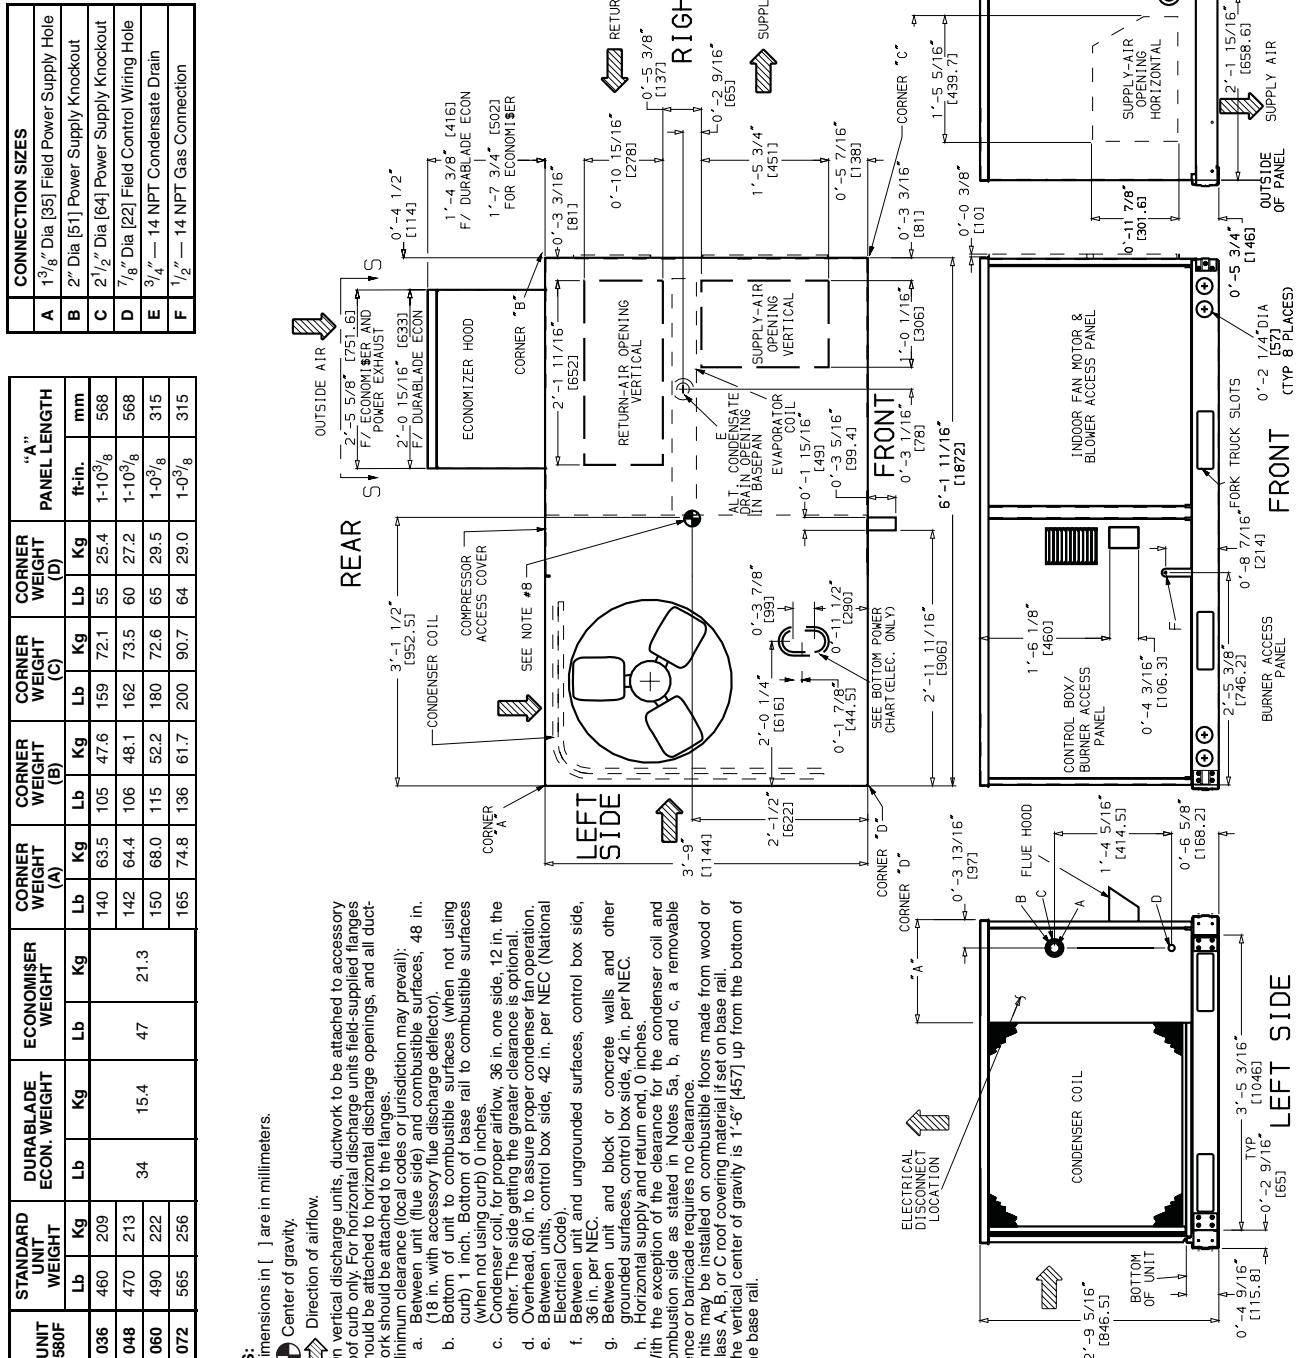

**NOTES:** 1. Dimensions in [ ] are in millimeters.

- 2. Center of gravity.
  - 3. Direction of airflow.
  - 4. On vertical discharge units, ductwork to be attached to accessory roof curb only. For horizontal discharge units field-supplied flanges should be attached to horizontal discharge openings, and all duct-work should be attached to the flanges.
  - 5. Minimum clearances (local codes or jurisdiction may prevail):
    - a. Between unit (flue side) and combustible surfaces, 48 in. (18 in. with accessory flue discharge deflector).
    - b. Bottom of unit to combustible surfaces (when not using curb) 1 inch. Bottom of base rail to combustible surfaces (when not using curb) 0 inches.
    - c. Condenser coil, for proper airflow, 36 in. one side, 12 in. the other. The side getting the greater clearance is optional.
    - d. Overhead 60 in. to assure proper condenser fan operation.
    - e. Between units, control box side, 42 in. per NEC (National Electrical Code).
    - f. Between unit and ungrounded surfaces, control box side, 36 in. per NEC.
    - g. Between unit and block or concrete walls and other grounded surfaces, control box side, 42 in. per NEC.
    - h. Horizontal supports and return end, 0 inches.
  - 6. With the exception of the clearance for the condenser coil and combustion side as stated in Notes 5a, b, and c, a removable fence or barricade requires no clearance.
  - 7. Units may be installed on combustible floors made from wood or Class A, B, or C roof covering material if set on base rail.
  - 8. The vertical center of gravity is 1'-6" [457] up from the bottom of the base rail.

# BASE UNIT DIMENSIONS — 580F090-150

UNIT	STANDARD UNIT WEIGHT		DURABLEBLADE ECONOMIZER WEIGHT		ECONOMISER WEIGHT		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		"H"		"J"		"K"		"L"	
	Lb	Kg	Lb	Kg	Lb	Kg	Lb	Kg	Lb	Kg	Lb	Kg	Lb	Kg	ft-in.	[mm]	ft-in.	[mm]	ft-in.	[mm]	ft-in.	[mm]
580F090	870	395	44	20	62	28	189	86	161	73	239	109	280	127	1-27/8	[378]	3-55/16	[1050]	2-911/16	[856]	2-27/16	[672]
580F102	880	399	44	20	62	28	191	87	163	74	242	110	284	129	3-37/8	[1013]	3-55/16	[1050]	2-911/16	[856]	2-27/16	[672]
580F120	1035	469	44	20	62	28	225	102	192	87	285	129	333	151	2-57/8	[759]	4-15/16	[1253]	3-03/8	[924]	2-107/16	[875]
580F150	1050	476	44	20	62	28	228	103	195	88	289	131	338	153	1-27/8	[378]	4-15/16	[1253]	3-03/8	[924]	2-107/16	[875]

CONNECTION SIZES	
A	1 <sup>3</sup> / <sub>8</sub> " Dia [35] Field Power Supply Hole
B	2 <sup>1</sup> / <sub>2</sub> " Dia [64] Power Supply Knockout
C	1 <sup>3</sup> / <sub>4</sub> " Dia [44] Charging Port Hole
D	7/8" Dia [22] Field Control Wiring Hole
E	3/4"-14 NPT Condensate Drain
F	1/2"-14 NPT Gas Connection 125 MBH, Input Units 3/4"-14 NPT Gas Connection 180 MBH, 224 MBH, and 250 MBH Input Units
G	2" Dia [51] Power Supply Knockout

BOTTOM POWER CHART, THESE HOLES REQUIRED FOR USE WITH ACCESSORY PACKAGES —

CRBTMPWR001A00, 3A00 (1<sup>1</sup>/<sub>2</sub>", 3/4")


OR CRBTMPWR002A00, 4A00 (1<sup>1</sup>/<sub>2</sub>", 1<sup>1</sup>/<sub>4</sub>')

THREADED CONDUIT SIZE	WIRE USE	REQUIRED HOLE SIZES (MAX.)
1 <sup>1</sup> / <sub>2</sub> "	24 V	7/8" [22.2]
3/4"	Power*	1 <sup>1</sup> / <sub>8</sub> " [28.4]
1 <sup>1</sup> / <sub>4</sub> "	Power*	1 <sup>3</sup> / <sub>4</sub> " [44.4]
(003) 1 <sup>1</sup> / <sub>4</sub> " FPT	Gas	1 <sup>1</sup> / <sub>4</sub> " [31.8]
(004) 3/4" FPT	Gas	1 <sup>5</sup> / <sub>8</sub> " [41.3]


\*Select either 3/4" or 1<sup>1</sup>/<sub>4</sub>" for power, depending on wire size.

## NOTES:

- Dimensions in [ ] are in millimeters.
- Center of gravity.
- Direction of airflow.
- On vertical discharge units, ductwork to be attached to accessory roof curb only. For horizontal discharge units field-supplied flanges should be attached to horizontal discharge openings, and all ductwork should be attached to the flanges.
- Minimum clearance (local codes or jurisdiction may prevail):
  - Between unit (flue side) and combustible surfaces, 48 inches.
  - Bottom of unit to combustible surfaces (when not using curb) 1 inch. Bottom of base rail to combustible surfaces (when not using curb) 0 inches.
  - Condenser coil, for proper airflow, 36 in. one side, 12 in. the other. The side getting the greater clearance is optional.
  - Overhead, 60 in. to assure proper condenser fan operation.
  - Between units, control box side, 42 in. per NEC (National Electrical Code).
  - Between unit and ungrounded surfaces, control box side, 36 in. per NEC.
  - Between unit and block or concrete walls and other grounded surfaces, control box side, 42 in. per NEC.
  - Horizontal supply and return end, 0 inches.
- With the exception of the clearance for the condenser coil and combustion side as stated in Notes 5a, b, and c, a removable fence or barricade requires no clearance.
- Units may be installed on combustible floors made from wood or Class A, B, or C roof covering material if set on base rail.
- The vertical center of gravity is 1'-7" [483] for 090 and 102, 1'-11" [584] for 120 and 150 up from the bottom of the base rail.

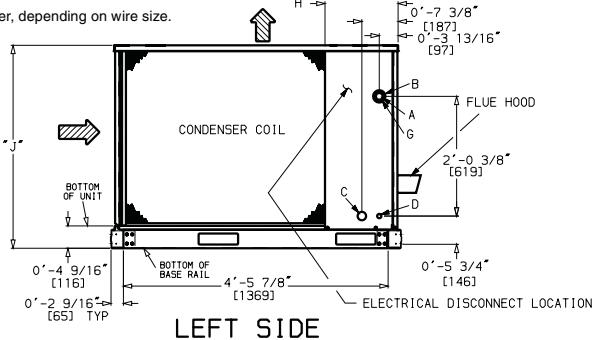

LEFT SIDE

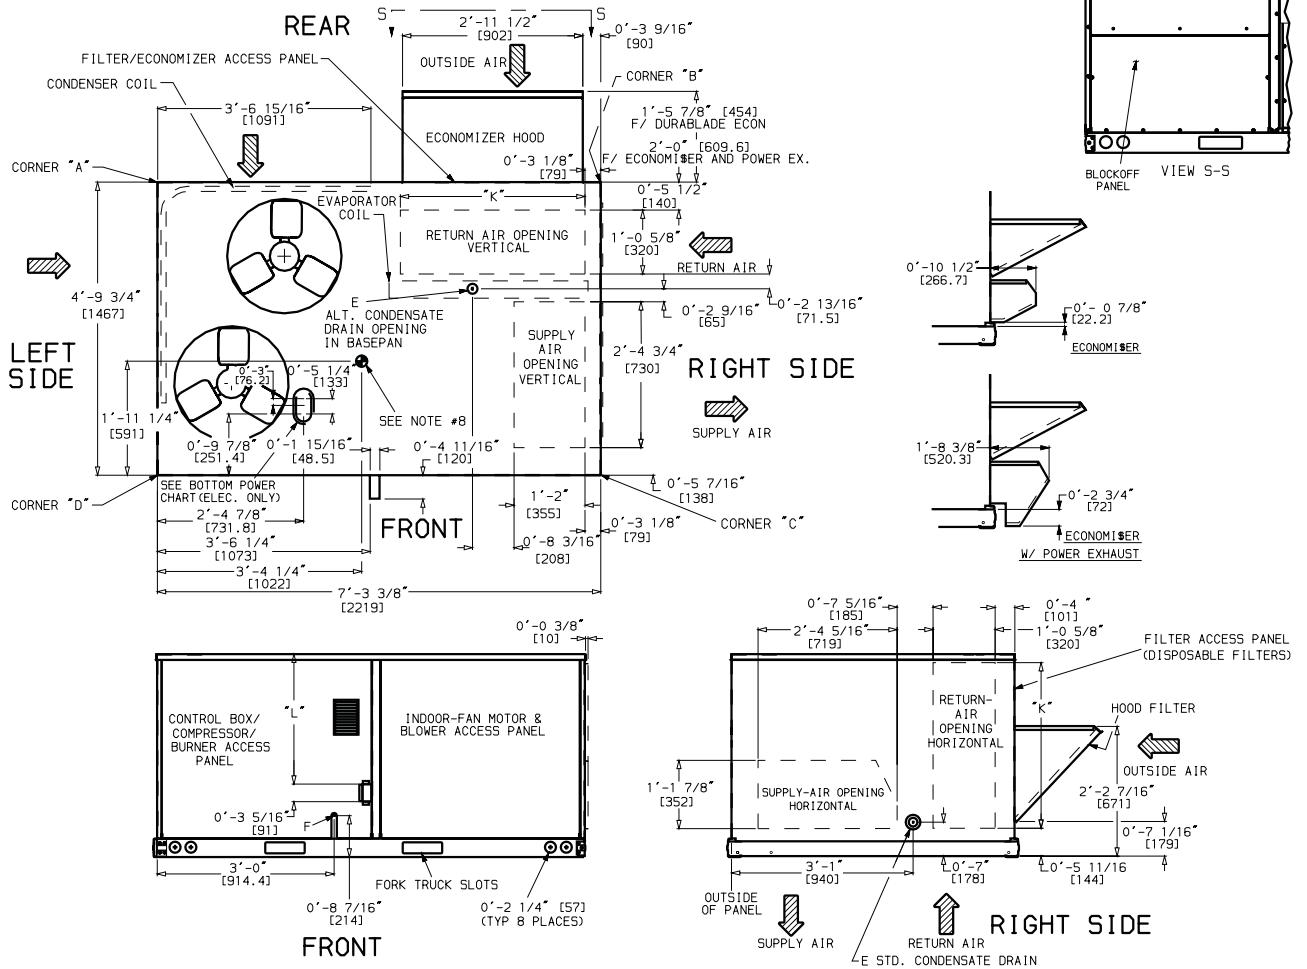


## ACCESSORY DIMENSIONS

**NOTES:**

1. Roof curb accessory is shipped disassembled.
2. Insulated panels.
3. Dimensions in [ ] are in millimeters.
4. Root curb, galvanized steel.
5. Attach ductwork to curb (flanges of duct rest on curb).
6. Service clearance: 4 ft on each side.

ROOF CURB ACCESSORY	A	UNIT SIZE
CRRFCURB001A00	1'-2" [356]	580F036-072
CRRFCURB002A00	2'-0" [610]	

CONNECTOR PKG. ACCY.		
B	C	D ALT DRAIN HOLE
1'-9 11/16" [55.1]	1'-4" [406]	1 3/4" [44.5]
		1/2" [12.7]
		3/4" [19] NPT
		1 1/4" [31.7]
		1/2" [12.7] NPT
		3/4" [19] NPT
		1 1/4" [31.7]

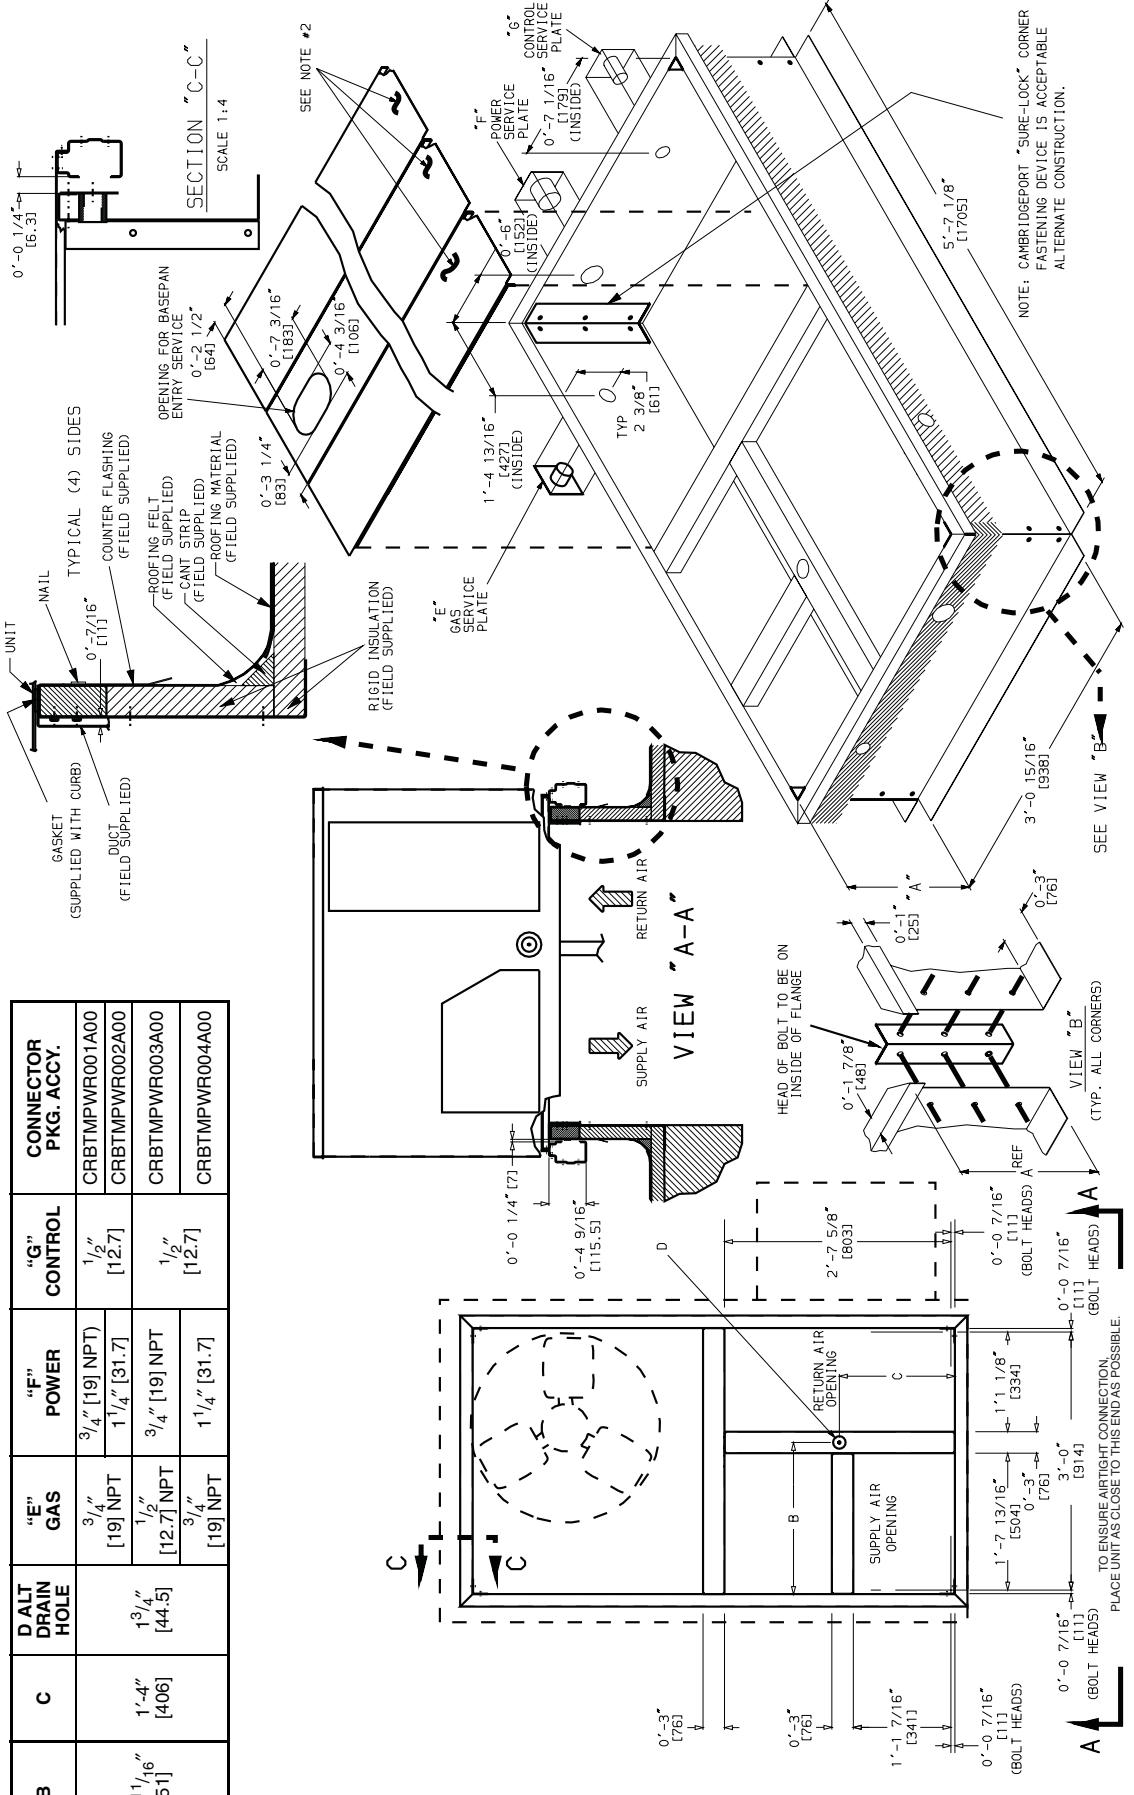







## ACCESSORY DIMENSIONS (cont)

CONNECTOR PKG. ACCY.	B	C	D ALT DRAIN HOLE	"E" GAS	"F" POWER	"G" CONTROL
CRBTMPWR001A00				$\frac{3}{4}$ " [19] NPT	$\frac{3}{4}$ " [19] NPT	$\frac{1}{2}$ " [12.7]
CRBTMPWR002A00					$1\frac{1}{4}$ " [31.7]	
CRBTMPWR003A00				$\frac{1}{2}$ " [12.7] NPT	$\frac{3}{4}$ " [19] NPT	
CRBTMPWR004A00				$\frac{3}{4}$ " [19] NPT	$1\frac{1}{4}$ " [31.7]	$\frac{1}{2}$ " [12.7]

ROOF CURB ACCESSORY	"A"	UNIT SIZE 580F
CRRFCURB003A00	1'-2" [356]	
CRRFCURB004A00	2'-0" [610]	090-150

**NOTES:**

1. Roof curb accessory is shipped disassembled.
2. Insulated panels: 1-in. thick polyurethane foam,  $1\frac{3}{4}$  lb density.
3. Dimensions in [ ] are in millimeters.
4. Roof curb: 16-gage steel.
5. Attach ductwork to curb (flanges of duct rest on curb).
6. Service clearance 4 ft on each side.
7. Direction of airflow.
8. Connector packages CRBTMPWR001A00 and 002A00 are for thru-the-curb type. Packages CRBTMPWR003A00 and 004A00 are for thru-the-bottom type connections.

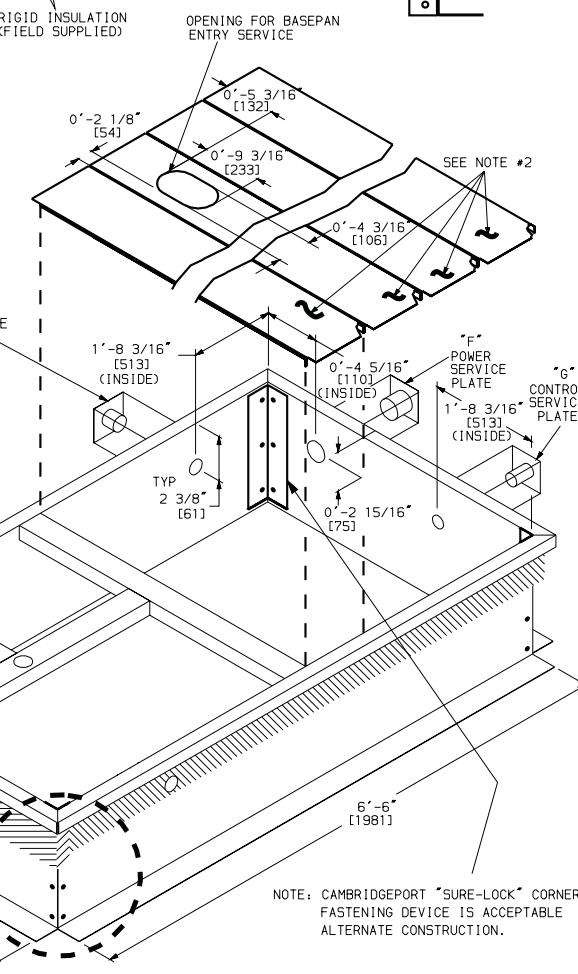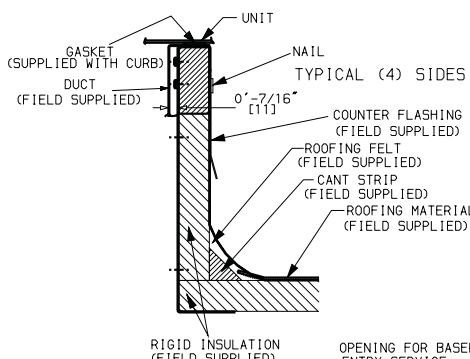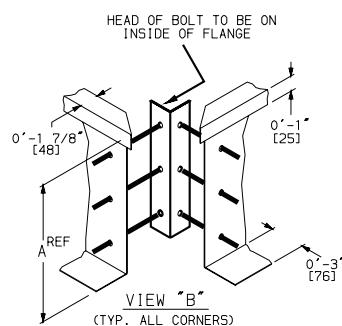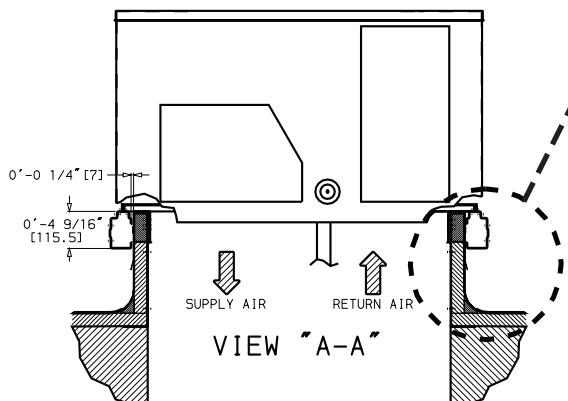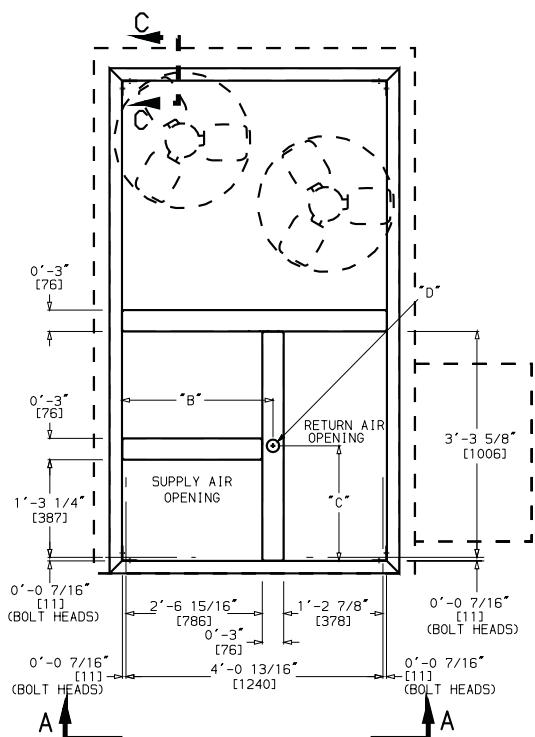

**Roof Curb — 580F090-150**

## SELECTION PROCEDURE (with 580F060 example)

### I DETERMINE COOLING AND HEATING REQUIREMENTS AT DESIGN CONDITIONS.

Given:

Required Cooling Capacity (TC)..... 55,000 Btuh  
Sensible Heat Capacity (SHC) ..... 40,000 Btuh  
Required Heating Capacity..... 60,000 Btuh  
Condenser Entering Air Temp..... 95 F (Summer)  
Evaporator Entering Air Temp..... 80 F edb,  
67 F ewb  
Evaporator Air Quantity ..... 2,000 cfm  
External Static Pressure ..... 0.6 in. wg  
Electrical Characteristics (V-Ph-Hz) ..... 230-3-60  
Vertical discharge unit with optional EconoMi\$er required.  
edb — Entering dry-bulb  
ewb — Entering wet-bulb

### II SELECT UNIT BASED ON REQUIRED COOLING CAPACITY.

Enter Cooling Capacities table for 580F060 (page 17) at condenser entering temperature 95 F, evaporator air entering at 2,000 cfm and 67 F wb. The 580F060 unit will provide a total cooling capacity of 60,900 Btuh and a sensible heating capacity of 45,300 Btuh. For air entering evaporator at temperatures other than 80 F edb, calculate sensible heat capacity correction as required using the formula in the notes following the Cooling Capacities tables.

**NOTE:** Unit ratings are gross capacities and do not include the effect of evaporator-fan motor heat. To calculate net capacities, see Step V.

### III SELECT HEATING CAPACITY OF UNIT TO PROVIDE DESIGN CONDITION REQUIREMENTS.

In the Heating Capacities and Efficiencies table (page 4) note that the 580F060 074 will provide an output capacity of 59,200 Btuh, which is adequate for the given application.

### IV DETERMINE FAN SPEED AND POWER REQUIREMENTS AT DESIGN CONDITIONS.

Before entering the Fan Performance tables, calculate the total static pressure required based on unit components. From the given and the Accessory/FIOP Static Pressure table on page 47 find:

External static pressure	0.60 in. wg
EconoMi\$er static pressure	0.27 in. wg
Total Static	0.87 in. wg

Enter standard motor the Fan Performance table 580F060 Vertical Discharge (page 23) at 2,000 cfm and 0.87 in. wg external static pressure. The standard motor cannot provide 0.87 in. wg external static pressure. Enter the alternate motor Fan Performance table for 580F060, vertical discharge. At 2,000 cfm and 0.87 in. wg external static pressure, find that the rpm is 1248, the Bhp is 1.46, and the watts are 1492 (interpolation required).

### V DETERMINE NET COOLING CAPACITY.

Cooling capacities are gross capacities and do not include indoor (evaporator) fan motor (IFM) heat. Use the watts input power to the motor calculated in Section IV above.

IFM Watts = 1492

Determine net cooling capacity using the following formula:

$$\begin{aligned} \text{Net capacity} &= \text{Gross capacity} - \text{IFM heat} \\ &= 60,900 \text{ Btuh} - 1492 \text{ Watts} \\ &\quad (3.412 \frac{\text{Btuh}}{\text{Watts}}) \\ &= 60,900 \text{ Btuh} - 5091 \text{ Btuh} \\ &= 55,809 \text{ Btuh} \end{aligned}$$

$$\begin{aligned} \text{Net sensible capacity} &= 45,300 \text{ Btuh} - 5091 \text{ Btuh} \\ &= 40,209 \text{ Btuh} \end{aligned}$$

The calculations show that a 580F060 unit with the alternate motor and drive is the correct selection for the given conditions.

## PERFORMANCE DATA

## **COOLING CAPACITIES**

580F036 (3 TONS)		Air Entering Evaporator — Cfm/BF								
Temp (F) Air Entering Condenser (Edb)	900/0.11			1200/0.14			1500/0.17			
	Air Entering Evaporator — Ewb (F)									
	72	67	62	72	67	62	72	72	67	62
75	TC SHC kW	42.8 20.0 2.91	38.9 24.5 2.81	35.0 28.7 2.70	44.8 21.8 2.99	40.8 27.5 2.88	37.0 32.8 2.78	45.8 23.0 3.02	41.9 30.0 2.92	38.2 36.0 2.82
85	TC SHC kW	40.8 19.4 3.14	36.9 23.7 3.01	33.3 27.9 2.90	42.5 21.0 3.20	38.7 26.8 3.08	35.0 31.8 2.97	43.6 22.6 3.24	39.9 29.7 3.14	36.1 35.1 3.02
95	TC SHC kW	38.7 18.6 3.35	34.9 29.9 3.21	31.4 27.0 3.09	40.4 20.3 3.42	36.6 26.0 3.29	33.0 30.9 3.16	41.4 22.0 3.47	37.6 28.8 3.35	34.1 34.0 3.22
105	TC SHC kW	36.5 17.8 3.55	32.8 22.1 3.41	29.2 25.9 3.27	38.1 19.6 3.63	34.3 25.2 3.49	30.9 29.8 3.35	39.0 21.2 3.68	35.2 28.0 3.54	32.4 32.3 3.43
115	TC SHC kW	34.3 17.0 3.76	30.7 21.3 3.60	26.9 24.8 3.45	35.7 19.0 3.84	32.1 24.4 3.68	28.8 28.8 3.54	36.5 20.5 3.88	32.9 27.1 3.74	30.6 30.6 3.64

580F060 (5 TONS)		Air Entering Evaporator — Cfm/BF								
Temp (F) Air Entering Condenser (Edb)	1500/0.07			2000/0.09			2500/0.12			
	Air Entering Evaporator — Ewb (F)									
	72	67	62	72	67	62	72	67	62	62
75	TC SHC kW	71.0 33.9 5.04	63.8 41.5 4.82	55.4 47.9 4.62	74.5 37.4 5.20	67.2 47.4 4.97	59.2 55.8 4.76	76.5 40.6 5.29	69.7 52.8 5.06	62.1 61.8 4.87
85	TC SHC kW	69.2 33.4 5.50	61.0 40.5 5.27	54.2 47.3 5.02	72.9 37.0 5.66	65.6 46.9 5.41	57.2 54.9 5.18	75.2 40.1 5.75	68.1 52.3 5.50	61.5 61.3 5.29
95	TC SHC kW	65.5 32.1 5.88	56.6 38.8 5.62	50.4 45.6 5.37	69.4 35.8 6.01	60.9 45.3 5.76	53.1 52.6 5.53	71.2 39.1 6.12	63.3 50.9 5.87	57.8 57.8 5.67
105	TC SHC kW	61.9 30.8 6.25	53.1 37.5 5.99	47.1 44.1 5.72	65.4 34.5 6.38	56.6 43.7 6.13	50.5 50.2 5.91	67.1 37.9 6.50	58.8 49.3 6.23	54.5 54.5 6.06
115	TC SHC kW	58.2 29.5 6.63	49.7 36.1 6.35	43.7 42.5 6.08	61.4 33.2 6.75	52.3 42.1 6.49	47.8 47.8 6.29	63.0 36.7 6.88	54.3 47.6 6.59	51.2 51.2 6.46

## Standard Ratings

## **LEGEND**

- BF** — Bypass Factor  
**Edb** — Entering Dry-Bulb  
**Ewb** — Entering Wet-Bulb  
**kW** — Compressor Motor Power Input  
**Ldb** — Leaving Dry-Bulb  
**Lwb** — Leaving Wet-Bulb  
**SHC** — Sensible Heat Capacity (1000 Btuh) Gross  
**TC** — Total Capacity (1000 Btuh) Gross

## **NOTES:**

1. Direct interpolation is permissible. Do not extrapolate.
  2. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

$t_{lwB}$  = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil ( $h_{lwB}$ )

$$h_{lw} = h_{ew} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where:  $h_{ewh}$  = Enthalpy of air entering evaporator coil.

3. The SHC is based on 80 F edb temperature of air entering evaporator coil.

Below 80 F edb, subtract (corr factor x cfm) from SHC.

Above 80 F edb, add (corr factor x cfm) to SHC.

Correction Factor =  $1.10 \times (1 - BF) \times (edb - 80)$ .

580F072 (6 TONS)													
Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Cfm/BF											
		1800/0.06			2100/0.08			2400/0.09			3000/0.11		
		Air Entering Evaporator — Ewb (F)											
72	67	62	72	67	62	72	72	67	62	72	67	62	
75	TC SHC kW	86.6 42.2 5.48	80.0 52.3 5.33	73.6 62.2 5.21	87.8 43.0 5.69	80.3 53.9 5.50	73.2 65.5 5.32	90.8 46.5 5.59	84.1 59.6 5.44	77.2 71.6 5.29	93.2 50.1 5.66	86.6 66.4 5.51	79.7 78.7 5.35
85	TC SHC kW	84.1 41.4 6.17	77.4 51.3 6.00	71.0 61.1 5.85	84.0 41.7 6.21	77.2 53.1 6.04	69.5 64.0 5.83	87.8 45.5 6.27	81.2 58.6 6.11	74.5 70.3 5.94	90.1 49.4 6.35	83.5 65.4 6.19	77.3 76.7 6.02
95	TC SHC kW	81.6 40.6 6.86	74.7 50.3 6.67	68.5 60.0 6.49	81.0 40.8 6.78	73.5 51.8 6.54	66.3 62.8 6.33	84.8 44.6 6.95	78.2 57.6 6.77	71.8 69.1 6.59	87.0 48.7 7.03	80.4 64.5 6.86	74.8 74.7 6.69
105	TC SHC kW	78.4 39.4 7.60	71.8 49.2 7.39	65.6 58.7 7.20	76.8 39.4 7.30	69.7 50.3 7.05	62.5 61.1 6.80	81.6 43.5 7.72	74.9 56.4 7.50	68.9 67.4 7.31	83.3 47.4 7.77	76.9 63.1 7.59	72.1 72.0 7.41
115	TC SHC kW	75.1 38.1 8.36	68.7 47.9 8.14	62.5 57.2 7.93	72.5 37.9 7.81	65.5 48.7 7.53	58.7 58.7 7.27	78.0 42.3 8.49	71.5 55.1 8.25	66.1 65.5 8.06	79.5 46.3 8.55	73.3 61.6 8.33	69.3 69.2 8.18

## PERFORMANCE DATA (cont)

### COOLING CAPACITIES (cont)

#### 580F090 (7½ TONS)

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Cfm/BF												
	2250/0.07			2800/0.09			3000/0.10			3750/0.12			
	Air Entering Evaporator — Ewb (F)												
	72	67	62	72	67	62	72	67	62	72	67	62	
75	TC SHC kW	102.8 49.4 7.14	94.8 61.8 6.82	86.2 73.2 6.50	105.8 52.6 7.28	98.2 67.8 6.98	90.0 81.6 6.68	106.4 53.6 7.32	99.0 69.8 7.04	90.8 84.0 6.72	109.2 58.2 7.46	101.6 77.4 7.18	93.6 92.2 6.86
85	TC SHC kW	98.2 48.0 7.66	90.2 60.2 7.34	81.6 71.2 7.00	101.8 51.6 7.82	93.6 66.4 7.50	85.2 79.6 7.18	102.6 52.8 7.86	94.4 68.6 7.54	86.0 82.0 7.22	104.6 56.8 7.98	96.8 76.0 7.68	89.6 89.4 7.40
95	TC SHC kW	93.8 46.4 8.18	85.2 58.2 7.84	76.6 68.8 7.48	97.0 50.2 8.36	88.4 64.6 8.00	80.0 77.2 7.64	97.6 51.4 8.40	89.0 66.8 8.04	81.2 79.0 7.70	99.4 55.6 8.50	91.2 74.4 8.16	85.2 85.2 7.92
105	TC SHC kW	88.4 44.6 8.68	79.8 56.2 8.30	70.8 66.0 7.98	91.0 48.2 8.80	82.8 62.6 8.46	74.6 74.2 8.14	91.6 49.4 8.86	83.4 64.8 8.50	76.0 75.6 8.20	93.8 54.2 8.98	85.4 72.4 8.64	80.6 80.6 8.42
115	TC SHC kW	82.8 42.6 9.16	73.8 53.8 8.78	66.0 63.2 8.42	85.2 46.4 9.30	76.8 60.4 8.92	69.6 69.6 8.64	85.6 47.8 9.34	77.4 62.6 8.96	71.0 62.6 8.72	87.6 52.8 9.48	79.4 70.4 9.10	76.0 75.8 8.94

#### 580F102 (8½ TONS)

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Cfm/BF												
	2550/0.08			3000/0.10			3400/0.11			4250/0.135			
	Air Entering Evaporator — Ewb (F)												
	72	67	62	72	67	62	72	67	62	72	67	62	
75	TC SHC kW	116.6 71.9 7.77	108.4 61.9 7.57	99.0 75.9 7.38	119.2 75.2 7.86	111.3 65.1 7.44	101.8 80.5 7.89	120.1 68.0 6.72	112.8 85.6 7.51	103.6 32.7 7.97	122.3 73.9 7.80	114.8 94.4 7.60	106.3
85	TC SHC kW	113.3 54.0 8.46	104.2 67.7 8.22	94.0 80.4 7.96	115.7 56.3 5.54	106.9 72.5 8.31	97.0 87.1 8.04	117.2 58.2 8.60	108.7 76.4 8.38	98.8 92.5 8.12	120.1 62.9 8.72	111.0 84.2 8.48	101.8 101.0 8.23
95	TC SHC kW	109.1 52.6 8.90	99.3 65.9 8.97	87.3 77.4 8.68	111.2 55.0 8.99	102.0 70.9 9.06	91.4 84.9 8.79	112.5 57.1 9.06	103.6 75.1 9.12	93.7 90.3 8.86	115.3 62.2 4.76	105.8 83.2 9.24	107.4 97.3 9.00
105	TC SHC kW	103.3 50.5 9.74	94.0 54.0 9.43	81.4 74.5 9.08	105.9 53.5 9.85	96.3 69.1 9.54	84.6 81.4 9.21	107.4 55.8 9.92	97.7 73.1 9.60	87.9 86.6 9.29	109.4 60.4 9.03	99.9 81.4 9.72	92.8 92.8 9.48
115	TC SHC kW	97.7 48.7 10.33	87.9 61.7 9.97	75.9 71.9 9.61	99.9 51.8 10.46	90.4 66.9 10.10	78.8 78.1 9.75	101.3 54.0 10.54	91.8 71.2 10.18	82.4 82.3 9.88	102.9 72.3 10.61	93.8 58.5 10.30	88.3 88.2 10.10

Standard Ratings

#### LEGEND

<b>BF</b>	— Bypass Factor
<b>Edb</b>	— Entering Dry-Bulb
<b>Ewb</b>	— Entering Wet-Bulb
<b>kW</b>	— Compressor Motor Power Input
<b>Ldb</b>	— Leaving Dry-Bulb
<b>Lwb</b>	— Leaving Wet-Bulb
<b>SHC</b>	— Sensible Heat Capacity (1000 Btuh) Gross
<b>TC</b>	— Total Capacity (1000 Btuh) Gross

#### NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{l\text{db}} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

$$t_{l\text{wb}} = \frac{\text{Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (}h_{l\text{wb}}\text{)}}{h_{l\text{wb}}}$$

$$h_{l\text{wb}} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where:  $h_{ewb}$  = Enthalpy of air entering evaporator coil.

3. The SHC is based on 80 F edb temperature of air entering evaporator coil.

Below 80 F edb, subtract (corr factor x cfm) from SHC.

Above 80 F edb, add (corr factor x cfm) to SHC.

Correction Factor =  $1.10 \times (1 - BF) \times (edb - 80)$ .

## PERFORMANCE DATA (cont)

### COOLING CAPACITIES (cont)

580F120 (10 TONS)										
Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Cfm/BF								
		3000/0.095			4000/0.125			5000/0.15		
		Air Entering Evaporator — Ewb (F)								
72	67	62	72	67	62	72	67	62	72	67
75	TC SHC kW	135.8 66.8 9.76	124.8 82.6 9.41	112.0 97.4 9.10	142.4 73.2 10.00	130.6 93.4 9.61	119.8 112.7 9.27	146.5 79.7 10.17	134.2 104.4 9.75	123.7 123.1 9.41
85	TC SHC kW	130.0 64.3 10.41	119.6 80.5 10.07	104.0 93.8 9.74	136.0 71.1 10.67	125.0 91.7 10.28	114.5 110.2 9.94	140.0 77.5 10.84	127.9 101.8 10.41	118.8 118.7 10.09
95	TC SHC kW	124.1 62.2 11.13	113.7 78.4 10.78	96.7 90.0 10.40	129.5 69.1 11.38	118.9 89.8 10.99	106.9 105.9 10.63	132.8 74.9 11.52	122.0 100.1 11.14	114.1 114.0 10.83
105	TC SHC kW	118.1 60.4 11.93	104.6 74.9 11.52	87.9 85.2 11.10	122.7 66.9 12.13	111.8 87.7 11.74	98.5 98.5 11.41	126.0 73.1 12.27	115.1 98.3 11.89	108.0 108.0 11.65
115	TC SHC kW	115.0 59.4 12.26	98.0 72.4 11.82	84.2 83.4 11.40	120.0 66.4 12.48	103.8 84.8 12.06	93.4 93.4 11.78	122.6 72.8 12.60	109.8 96.9 12.20	102.8 102.8 12.00

580F150 (12½ TONS)													
Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Cfm/BF											
		3750/0.08			4500/0.09			5000/0.10			6250/0.12		
		Air Entering Evaporator — Ewb (F)											
72	67	62	72	67	62	72	67	62	72	67	62		
75	TC SHC kW	175.6 85.7 11.16	162.2 107.3 10.85	149.2 128.0 10.57	181.0 91.4 11.32	167.5 116.2 11.00	154.2 140.3 10.69	182.9 94.2 11.37	170.2 122.2 11.07	156.4 146.5 10.73	187.2 102.1 11.49	174.7 135.3 11.19	161.8 160.7 10.87
85	TC SHC kW	169.3 83.9 12.15	155.7 104.8 11.78	140.6 124.0 11.42	174.2 89.6 12.31	160.7 113.9 11.94	147.0 137.0 11.58	176.9 92.7 12.39	163.0 119.7 12.01	149.7 143.6 11.63	181.5 100.9 12.53	167.3 133.4 12.14	155.8 155.6 11.82
95	TC SHC kW	161.9 81.4 13.12	148.9 102.0 12.72	132.0 119.8 12.28	166.8 87.0 13.30	153.5 111.1 12.89	139.1 133.2 12.46	169.5 90.7 13.40	155.7 117.3 12.97	142.8 140.2 12.56	173.2 98.3 13.54	159.5 130.8 13.11	149.6 149.6 12.78
105	TC SHC kW	154.9 79.0 14.16	141.3 99.2 13.66	123.0 115.5 13.17	158.8 84.5 14.31	145.4 108.2 13.82	130.2 128.1 13.35	160.9 87.8 14.38	147.6 114.3 13.91	135.0 134.9 13.48	165.3 96.6 14.58	151.2 127.8 14.07	143.2 143.1 13.77
115	TC SHC kW	146.2 76.1 15.09	132.2 95.7 14.57	113.1 110.3 14.07	150.5 81.7 15.30	137.0 105.2 14.76	122.4 122.3 14.25	152.3 85.0 15.37	139.4 111.6 14.87	127.8 127.7 14.43	155.2 92.9 15.49	142.7 125.0 15.02	136.0 135.8 14.73

Standard Ratings

#### LEGEND

**BF** — Bypass Factor  
**Edb** — Entering Dry-Bulb  
**Ewb** — Entering Wet-Bulb  
**kW** — Compressor Motor Power Input  
**Ldb** — Leaving Dry-Bulb  
**Lwb** — Leaving Wet-Bulb  
**SHC** — Sensible Heat Capacity (1000 Btuh) Gross  
**TC** — Total Capacity (1000 Btuh) Gross

#### NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{l_{db}} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

$t_{l_{wb}} = \text{Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h}_{l_{wb})}$

$$h_{l_{wb}} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where:  $h_{ewb}$  = Enthalpy of air entering evaporator coil.

3. The SHC is based on 80 F edb temperature of air entering evaporator coil.

Below 80 F edb, subtract (corr factor x cfm) from SHC.

Above 80 F edb, add (corr factor x cfm) to SHC.

Correction Factor =  $1.10 \times (1 - BF) \times (edb - 80)$ .

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS

580F036 (3 TONS) — STANDARD MOTOR (DIRECT DRIVE)												
Airflow (Cfm)	Low Speed						High Speed					
	208 V			230, 460, 575 V			208 V			230, 460, 575 V		
	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts
900	0.49	0.21	253	0.50	0.23	277	0.51	0.26	307	0.55	0.31	363
1000	0.42	0.23	270	0.43	0.25	292	0.43	0.27	321	0.51	0.32	374
1100	0.37	0.24	287	0.38	0.26	307	0.39	0.28	335	0.46	0.33	385
1200	0.33	0.26	304	0.33	0.27	323	0.34	0.29	349	0.40	0.34	397
1300	0.27	0.27	321	0.28	0.29	338	0.28	0.31	364	0.34	0.34	408
1400	0.20	0.29	338	0.23	0.30	354	0.25	0.32	378	—	—	—
1500	0.16	0.30	355	0.18	0.31	369	0.20	0.33	392	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**Esp** — External Static Pressure (in. wg)  
**FIONP** — Factory-Installed Option

#### NOTES:

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIONP static pressure information.

- Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for Additional information.

- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.

580F036 (3 TONS) — ALTERNATE MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.1			0.2			0.3			0.4			0.5			0.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	<b>581</b>	0.12	119	673	0.18	179	736	0.22	219	805	0.25	249	865	0.29	288	911	0.34	338
1000	<b>644</b>	0.19	189	709	0.22	219	782	0.28	279	835	0.30	298	900	0.35	348	937	0.38	378
1100	<b>687</b>	0.22	219	<b>746</b>	0.26	259	806	0.30	298	867	0.35	348	929	0.40	398	964	0.40	398
1200	<b>733</b>	0.26	259	785	0.32	318	843	0.35	348	903	0.41	408	960	0.47	467	994	0.50	497
1300	<b>754</b>	0.29	288	826	0.38	378	891	0.43	428	942	0.48	477	991	0.53	527	<b>1047</b>	0.60	597
1400	810	0.35	348	868	0.45	448	937	0.51	507	984	0.57	567	<b>1032</b>	0.62	617	<b>1067</b>	0.67	666
1500	841	0.42	418	911	0.53	527	985	0.61	607	<b>1029</b>	0.66	656	<b>1073</b>	0.72	716	1109	0.77	766

580F036 (3 TONS) — ALTERNATE MOTOR (BELT DRIVE)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.7			0.8			0.9			1.0			1.1			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	957	0.39	388	988	0.43	428	<b>1039</b>	0.47	448	1061	0.51	487	1083	0.54	527	1105	0.58	567
1000	992	0.44	438	<b>1039</b>	0.49	487	<b>1061</b>	0.55	507	1088	0.60	547	1111	0.66	587	1136	0.72	627
1100	<b>1013</b>	0.49	487	<b>1068</b>	0.55	547	<b>1091</b>	0.61	577	1109	0.66	607	1127	0.73	637	1145	0.80	666
1200	<b>1045</b>	0.56	557	<b>1090</b>	0.64	637	<b>1109</b>	0.68	647	1156	0.73	676	1203	0.81	706	1250	0.86	736
1300	<b>1075</b>	0.64	637	1122	0.70	696	<b>1152</b>	0.76	716	1190	0.82	756	<b>1228</b>	0.87	796	1266	0.94	836
1400	<b>1110</b>	0.73	726	1160	0.78	766	1181	0.83	806	1237	0.88	845	1293	0.94	885	<b>1349</b>	0.99	925
1500	1150	0.78	816	1190	0.84	855	1225	0.89	895	1271	0.95	945	1317	1.00	995	1383	1.05	1044

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIONP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 760 to 1000 rpm. All other rpms require a field-supplied drive.

#### NOTES:

- Boldface** indicates field-supplied drive is required.
- Indicates field-supplied motor and drive are required.

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIONP static pressure information.
- Maximum continuous bhp is 1.0 and the maximum continuous watts are 1000. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
- Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F036 (3 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	673	0.18	179	805	0.25	249	911	0.34	338	988	0.43	428	1061	0.47	487
1000	709	0.22	219	835	0.30	298	937	0.38	378	1039	0.49	487	1086	0.55	547
1100	746	0.26	259	867	0.35	348	964	0.40	398	1068	0.55	547	1109	0.61	607
1200	785	0.32	318	903	0.41	408	994	0.50	497	1090	0.64	637	1156	0.68	676
1300	826	0.38	378	942	0.48	477	1047	0.60	597	1122	0.70	696	1190	0.76	756
1400	868	0.45	448	984	0.57	567	1067	0.67	666	1160	0.84	766	1237	0.85	845
1500	911	0.53	527	1029	0.66	656	1109	0.77	766	1190	1.00	855	1271	0.95	945

580F036 (3 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	1105	0.57	567	1140	0.63	622	1170	0.68	674	1198	0.73	723	1224	0.77	771
1000	1136	0.63	627	1172	0.69	688	1203	0.75	745	1232	0.80	799	1258	0.86	852
1100	1145	0.67	666	1181	0.73	731	1213	0.80	792	1242	0.85	850	1268	0.91	906
1200	1210	0.74	736	1248	0.81	808	1282	0.88	875	1312	0.94	939	1340	1.01	1000
1300	1266	0.84	836	1306	0.92	917	1341	1.00	993	1373	1.07	1066	1402	1.14	1136
1400	1349	0.93	925	1391	1.02	1015	1429	1.11	1100	1463	1.19	1180	1494	1.26	1257
1500	1383	1.05	1044	1426	1.15	1146	1465	1.25	1242	1500	1.34	1332	1532	1.43	1419

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1075 to 1455 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

3. Maximum continuous bhp is 2.4 and the maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
4. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
5. Interpolation is permissible. Do not extrapolate.

### 580F048 (4 TONS) — STANDARD MOTOR (DIRECT DRIVE)

Airflow (Cfm)	Low Speed						High Speed					
	208 V			230, 460, 575 V			208 V			230, 460, 575 V		
	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts
1200	0.68	0.41	458	0.74	0.45	506	0.74	0.51	572	0.85	0.56	632
1300	0.61	0.42	471	0.67	0.46	521	0.66	0.52	589	0.78	0.58	651
1400	0.53	0.45	503	0.59	0.49	556	0.59	0.54	616	0.70	0.60	681
1500	0.45	0.47	536	0.51	0.52	593	0.52	0.56	631	0.63	0.62	698
1600	0.36	0.49	557	0.42	0.54	616	0.45	0.58	654	0.56	0.64	723
1700	0.26	0.52	584	0.32	0.57	646	0.37	0.60	678	0.48	0.66	750
1800	0.15	0.54	610	0.22	0.60	674	0.30	0.62	698	0.41	0.68	772
1900	0.04	0.56	629	0.11	0.62	696	0.23	0.64	720	0.34	0.70	796
2000	—	—	—	—	—	—	0.16	0.66	744	0.26	0.73	823

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**Esp** — External Static Pressure (in. wg)  
**FIOP** — Factory-Installed Option

#### NOTES:

1. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

2. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
3. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F048 (4 TONS) — ALTERNATE MOTOR (BELT DRIVE)*																					
Airflow (Cfm)	External Static Pressure (in. wg)																				
	0.1			0.2			0.3			0.4			0.6			0.7			0.8		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1200	596	0.20	210	665	0.25	263	722	0.31	320	779	0.36	378	872	0.48	504	915	0.54	567	957	0.60	630
1300	633	0.24	252	699	0.30	315	754	0.36	378	809	0.42	441	902	0.55	578	943	0.61	641	984	0.67	704
1400	672	0.30	315	735	0.36	378	788	0.42	441	840	0.48	504	933	0.62	651	972	0.69	720	1011	0.75	788
1500	711	0.35	368	770	0.42	441	822	0.49	510	873	0.55	578	963	0.69	725	1002	0.77	804	1041	0.84	858
1600	751	0.42	441	835	0.49	515	871	0.56	588	907	0.63	662	993	0.77	787	1033	0.85	869	1072	0.93	950
1700	791	0.49	515	873	0.57	599	907	0.65	678	941	0.72	757	1024	0.87	889	1064	0.96	976	1103	1.04	1063
1800	831	0.58	609	881	0.66	693	929	0.74	772	976	0.81	851	1057	0.97	991	1095	1.06	1078	1132	1.14	1165
1900	872	0.67	704	919	0.75	788	965	0.84	877	1011	0.92	967	1091	1.08	1104	1127	1.17	1191	1162	1.25	1277
2000	913	0.77	809	958	0.86	904	1002	0.95	993	1046	1.03	1082	1125	1.21	1237	1160	1.30	1323	1195	1.38	1410

### 580F048 (4 TONS) — ALTERNATE MOTOR (BELT DRIVE)\* (cont)

Airflow (Cfm)	External Static Pressure (in. wg)																				
	0.9			1.0			1.1			1.2			1.4			1.6			1.8		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1200	993	0.65	678	1028	0.69	725	1056	0.72	751	1083	0.74	778	1134	0.80	935	1185	0.88	965	1331	0.99	1000
1300	1021	0.74	772	1058	0.80	841	1090	0.85	888	1121	0.89	935	1171	0.94	988	1219	1.00	999	1268	1.10	1029
1400	1049	0.82	837	1086	0.89	885	1120	0.96	950	1153	1.00	976	1210	1.12	1071	1257	1.17	1105	1307	1.25	1190
1500	1077	0.92	922	1113	0.99	985	1147	1.06	1054	1180	1.13	1081	1241	1.27	1215	1295	1.37	1294	1339	1.43	1350
1600	1107	1.00	998	1141	1.09	1084	1174	1.17	1134	1207	1.25	1196	1269	1.40	1339	1326	1.54	1454	1376	1.65	1558
1700	1137	1.12	1128	1171	1.20	1194	1203	1.29	1278	1235	1.37	1310	1296	1.53	1463	1354	1.70	1605	1407	1.84	1738
1800	1167	1.23	1239	1202	1.32	1313	1233	1.41	1398	1263	1.49	1425	1323	1.67	1597	1381	1.85	1747	1436	2.02	1907
1900	1197	1.35	1360	1232	1.45	1442	1263	1.54	1532	1294	1.63	1559	1351	1.81	1731	1408	2.00	1889	1463	2.19	2068
2000	1229	1.48	1491	1262	1.58	1572	1294	1.68	1671	1325	1.78	1702	1362	1.97	1884	1436	2.16	2040	1489	2.36	2229

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 835 to 1185 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2.  indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 1.0 and the maximum continuous watts are 1000. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

Airflow (Cfm)	External Static Pressure (in. wg)																				
	0.2			0.4			0.6			0.8			1.0								
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts			
1200	665	0.25	263	779	0.36	378	872	0.48	504	957	0.60	630	1028	0.69	725	1058	0.80	841	1086	0.89	885
1300	699	0.30	315	809	0.42	441	902	0.55	578	984	0.67	704	1029	0.75	788	1086	0.89	985	1113	0.99	1084
1400	735	0.36	378	840	0.48	504	933	0.62	651	1011	0.75	788	1086	0.89	885	1141	1.09	1171	1202	1.32	1313
1500	770	0.42	441	873	0.55	578	963	0.69	725	1041	0.84	858	1113	1.04	950	1141	1.09	1171	1220	1.37	1367
1600	815	0.49	515	907	0.63	662	993	0.77	787	1072	0.93	950	1171	1.20	1194	1220	1.45	1442	1262	1.58	1572
1700	853	0.57	599	941	0.72	757	1024	0.87	889	1103	1.04	1063	1257	1.37	1339	1326	1.65	1558	1420	1.81	1805
1800	881	0.66	693	976	0.81	851	1057	0.97	991	1132	1.14	1165	1325	1.45	1442	1382	1.57	1564	1455	1.82	2013
1900	919	0.75	788	1011	0.92	967	1091	1.08	1104	1162	1.25	1277	1322	1.45	1442	1420	1.57	1564	1482	2.22	2210
2000	958	0.86	904	1046	1.03	1082	1125	1.21	1237	1195	1.38	1410	1262	1.58	1572	1325	1.78	1702	1362	2.02	2229

Airflow (Cfm)	External Static Pressure (in. wg)																				
	1.2			1.4			1.6			1.8			2.0								
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts			
1200	1083	0.74	778	1134	0.80	935	1185	0.88	965	1331	0.99	1000	1374	1.09	1083	1309	1.21	1203	1349	1.37	1367
1300	1121	0.89	935	1171	0.94	988	1219	1.00	999	1268	1.10	1029	1309	1.21	1203	1349	1.37	1367	1382	1.57	1564
1400	1153	1.00	967	1210	1.12	1071	1257	1.17	1105	1307	1.25	1190	1376	1.45	1442	1420	1.81	1805	1455	2.02	2013
1500	1180	1.13	1081	1241	1.27	1215	1295	1.37	1294	1339	1.43	1350	1407	1.84	1738	1452	2.02	1482	2.22	2210	2229
1600	1207	1.25	1196	1269	1.40	1339	1326	1.54	1454	1376	1.65	1558	1420	1.81	1805	1455	2.02	1482	2.22	2210	2229
1700	1235	1.37	1310	1296	1.53	1463	1354	1.70	1605	1407	1.84	1738	1452	2.02	1907	1482	2.22	1482	2.22	2210	2229
1800	1263	1.																			

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F060 (5 TONS) — STANDARD MOTOR (DIRECT DRIVE)																		
Airflow (Cfm)	Low Speed						Medium Speed						High Speed					
	208 V			230,460,575 V			208 V			230,460,575 V			208 V			230,460,575 V		
	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts
1500	0.69	0.67	750	1.01	0.71	791	1.00	0.70	782	1.20	0.76	845	1.22	0.79	875	1.28	0.85	949
1600	0.49	0.70	780	0.85	0.74	824	0.85	0.74	821	1.06	0.79	883	1.09	0.82	913	1.17	0.89	988
1700	0.29	0.73	810	0.70	0.77	857	0.70	0.77	861	0.93	0.83	921	0.97	0.85	950	1.06	0.92	1027
1800	0.09	0.75	839	0.54	0.80	891	0.55	0.81	900	0.80	0.86	959	0.84	0.89	988	0.95	0.96	1066
1900	—	—	—	0.39	0.83	924	0.40	0.84	940	0.67	0.90	997	0.72	0.92	1025	0.84	0.99	1105
2000	—	—	—	0.23	0.86	957	0.25	0.88	979	0.54	0.93	1035	0.59	0.95	1063	0.73	1.03	1144
2100	—	—	—	0.08	0.89	990	0.10	0.91	1018	0.41	0.96	1073	0.46	0.99	1101	0.62	1.06	1183
2200	—	—	—	—	—	—	—	—	—	0.28	1.00	1111	0.34	1.02	1138	0.51	1.10	1222
2300	—	—	—	—	—	—	—	—	—	0.15	1.03	1149	0.21	1.06	1176	0.40	1.13	1261
2400	—	—	—	—	—	—	—	—	—	0.02	1.07	1187	0.09	1.09	1213	0.29	1.17	1300
2500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	0.18	1.20	1340

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**Esp** — External Static Pressure (in. wg)  
**FIOP** — Factory-Installed Option

#### NOTES:

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

- Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for Additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.

## 580F060 (5 TONS) — ALTERNATE MOTOR (BELT DRIVE)\*

Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.1			0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1500	729	0.36	368	788	0.42	429	896	0.56	572	981	0.69	705	1070	0.85	869	1144	1.01	1032
1600	770	0.42	429	826	0.49	501	930	0.64	654	1015	0.78	797	1098	0.94	961	1173	1.11	1134
1700	811	0.50	511	864	0.57	582	964	0.72	736	1051	0.88	899	1124	1.03	1053	1203	1.21	1237
1800	852	0.58	593	903	0.66	674	999	0.82	838	1085	0.98	1001	1155	1.13	1155	1231	1.32	1349
1900	893	0.68	695	942	0.76	777	1035	0.92	940	1119	1.10	1124	1191	1.26	1288	1288	1.43	1461
2000	935	0.78	797	982	0.87	889	1070	1.04	1063	1153	1.22	1247	1227	1.40	1431	1287	1.57	1604
2100	977	0.89	910	1022	0.99	1012	1107	1.17	1196	1187	1.35	1380	1260	1.54	1574	1323	1.72	1758
2200	1019	1.02	1042	1063	1.12	1145	1144	1.30	1328	1222	1.49	1523	1294	1.70	1737	1359	1.89	1931
2300	1061	1.16	1185	1104	1.26	1288	1182	1.47	1502	1258	1.65	1686	1328	1.80	1901	1393	2.07	2115
2400	1103	1.30	1328	1145	1.41	1441	1220	1.61	1645	1293	1.80	1860	1362	2.03	2074	1426	2.26	2310
2500	1145	1.46	1492	1186	1.57	1604	1259	1.78	1819	1329	2.00	2044	1397	2.22	2269	1460	2.45	2504

## 580F060 (5 TONS) — ALTERNATE MOTOR (BELT DRIVE)\* (cont)

Airflow (Cfm)	External Static Pressure (in. wg)								
	1.2			1.4			1.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1500	1226	1.19	1216	1301	1.46	1492	1380	1.69	1757
1600	1242	1.28	1308	1318	1.49	1523	1392	1.78	1800
1700	1270	1.39	1420	1335	1.58	1615	1408	1.80	1850
1800	1300	1.52	1553	1361	1.71	1747	1423	1.91	1952
1900	1329	1.64	1676	1391	1.80	1891	1448	2.05	2095
2000	1355	1.77	1809	1420	1.99	2034	1477	2.21	2258
2100	1381	1.91	1952	1449	2.14	2167	—	—	—
2200	1413	2.08	2126	1474	2.30	2350	—	—	—
2300	1449	2.26	2310	—	—	—	—	—	—
2400	1485	2.47	2524	—	—	—	—	—	—
2500	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 900 to 1300 rpm. All other rpms require a field-supplied drive.

#### NOTES:

- Boldface** indicates field-supplied drive is required.
- indicates field-supplied motor and drive are required.

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
- Maximum continuous bhp is 1.30 for single-phase units and 2.40 for 3-phase units and the maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
- Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F060 (5 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1500	<b>808</b>	0.42	429	<b>914</b>	0.56	572	<b>1001</b>	0.69	705	<b>1084</b>	0.85	869	<b>1168</b>	1.01	1032
1600	<b>846</b>	0.49	501	<b>950</b>	0.64	645	<b>1034</b>	0.78	797	<b>1111</b>	0.94	961	<b>1194</b>	1.11	1134
1700	<b>884</b>	0.57	592	<b>983</b>	0.72	736	<b>1068</b>	0.88	899	<b>1145</b>	1.03	1053	<b>1218</b>	1.21	1237
1800	<b>942</b>	0.66	674	<b>1018</b>	0.82	838	<b>1105</b>	0.98	1001	<b>1179</b>	1.13	1155	<b>1246</b>	1.32	1349
1900	<b>965</b>	0.78	777	<b>1057</b>	0.92	940	<b>1143</b>	1.10	1124	<b>1212</b>	1.26	1288	<b>1280</b>	1.43	1481
2000	<b>1008</b>	0.87	889	<b>1096</b>	1.04	1063	<b>1177</b>	1.22	1247	<b>1247</b>	1.40	1431	1300	1.57	1604
2100	<b>1051</b>	0.99	1012	<b>1136</b>	1.17	1196	<b>1210</b>	1.35	1380	<b>1284</b>	1.54	1574	1347	1.72	1758
2200	<b>1095</b>	1.12	1145	<b>1173</b>	1.30	1328	<b>1245</b>	1.49	1523	<b>1322</b>	1.70	1737	<b>1380</b>	1.89	1931
2300	<b>1140</b>	1.28	1288	<b>1210</b>	1.47	1502	<b>1284</b>	1.65	1686	<b>1356</b>	1.80	1901	<b>1418</b>	2.07	2115
2400	<b>1185</b>	1.41	1441	<b>1249</b>	1.61	1645	<b>1323</b>	1.80	1860	<b>1389</b>	2.03	2074	<b>1456</b>	2.26	2310
2500	<b>1231</b>	1.57	1604	<b>1289</b>	1.78	1819	<b>1363</b>	2.00	2044	<b>1424</b>	2.22	2269	<b>1500</b>	2.45	2504

580F060 (5 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1500	<b>1199</b>	1.19	1216	<b>1126</b>	1.46	1492	<b>1250</b>	1.69	1757	<b>1301</b>	1.91	1944	<b>1349</b>	2.12	2164
1600	<b>1263</b>	1.28	1308	<b>1275</b>	1.49	1523	<b>1299</b>	1.78	1800	<b>1352</b>	2.01	2047	<b>1401</b>	2.23	2280
1700	<b>1295</b>	1.39	1420	1351	1.58	1615	1352	1.80	1850	1407	2.03	2070	1459	2.26	2305
1800	1319	1.52	1553	1389	1.71	1747	1453	1.91	1952	1494	2.15	2197	1548	2.40	2446
1900	1343	1.64	1676	1415	1.80	1891	1478	2.05	1095	1538	2.31	2358	1594	2.57	2625
2000	1374	1.77	1809	1438	1.99	2034	1505	2.21	2258	1566	2.49	2542	1624	2.77	2830
2100	1409	1.91	1952	1465	2.14	2167	1533	2.45	2501	1596	2.77	2821	<b>1654</b>	3.08	3141
2200	1442	2.08	2126	1498	2.30	2350	1568	2.64	2688	<b>1632</b>	2.97	3031	1691	3.31	3375
2300	1475	2.26	2310	1554	2.64	2698	<b>1627</b>	3.03	3091	<b>1693</b>	3.42	3486	1755	3.81	3881
2400	1565	2.47	2524	1649	2.89	2948	1726	3.31	3379	—	—	—	—	—	—
2500	<b>1596</b>	2.95	3010	1682	3.45	3522	1760	3.96	4036	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1300 to 1685 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2.  indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.9 and the maximum continuous watts are 2562. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F072 (6 TONS) — STANDARD MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.1			0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	942	<b>0.70</b>	646	978	0.66	700	1063	0.82	771	1147	0.97	891	1248	1.20	1081	1322	1.33	1190
1900	982	<b>0.80</b>	739	1023	<b>0.78</b>	779	1097	0.91	843	1175	1.11	1006	1266	1.29	1156	1356	1.47	1310
2000	1022	<b>0.91</b>	835	1068	<b>0.90</b>	867	1132	1.01	924	1218	1.23	1106	1303	1.41	1258	1397	1.52	1353
2100	1063	<b>0.99</b>	916	1115	1.00	998	1180	1.17	1056	1261	1.35	1207	1340	1.53	1361	1428	1.66	1473
2200	1104	1.13	1039	1159	1.15	1081	1214	1.28	1148	1310	1.52	1353	1375	1.63	1447	1459	1.80	1595
2300	1130	1.26	1156	1202	1.29	1140	1248	1.38	1233	1358	1.69	1499	1410	1.72	1526	<b>1488</b>	<b>1.93</b>	<b>1709</b>
2400	1174	1.37	1258	1237	1.41	1224	1292	1.55	1378	1392	1.81	1604	1460	1.90	1683	<b>1532</b>	<b>2.14</b>	<b>1892</b>
2500	1201	1.48	1361	1272	1.53	1335	1335	1.71	1517	1427	1.94	1718	<b>1518</b>	<b>2.16</b>	<b>1910</b>	<b>1575</b>	<b>2.35</b>	<b>2076</b>
2600	1246	1.62	1491	1320	1.68	1482	1368	1.81	1604	1458	2.06	1823	1562	2.42	2136	1620	2.59	2283
2700	1285	1.75	1613	1361	1.82	1595	1400	1.91	1691	<b>1490</b>	<b>2.19</b>	<b>1936</b>	1602	2.64	2326	1666	2.85	2504
2800	1304	1.87	1726	1402	1.95	1639	1439	2.08	1840	1543	2.43	2145	1642	2.86	2512	—	—	—
2900	1345	2.07	1910	1446	2.16	1814	<b>1477</b>	<b>2.16</b>	<b>1989</b>	1585	2.65	2335	—	—	—	—	—	—
3000	1378	2.26	2084	<b>1489</b>	<b>2.36</b>	<b>2032</b>	1529	2.52	2223	1598	2.73	2444	—	—	—	—	—	—

580F072 (6 TONS) — STANDARD MOTOR (BELT DRIVE)* (cont)									
Airflow (Cfm)	External Static Pressure (in.wg)								
	1.2			1.4			1.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	1395	1.46	1301	1475	<b>1.56</b>	<b>1387</b>	1542	1.71	1517
1900	1430	1.58	1404	1504	<b>1.69</b>	<b>1499</b>	1556	<b>1.82</b>	1613
2000	1459	1.67	1482	1532	<b>1.82</b>	<b>1613</b>	1588	1.97	1744
2100	<b>1489</b>	<b>1.80</b>	<b>1595</b>	<b>1567</b>	<b>1.99</b>	<b>1761</b>	1626	<b>2.16</b>	<b>1910</b>
2200	<b>1528</b>	<b>1.95</b>	<b>1726</b>	<b>1603</b>	2.17	<b>1919</b>	1666	2.37	<b>2093</b>
2300	<b>1561</b>	<b>2.13</b>	<b>1884</b>	<b>1637</b>	<b>2.35</b>	<b>2076</b>	<b>1710</b>	<b>2.54</b>	<b>2272</b>
2400	<b>1584</b>	<b>2.28</b>	<b>2015</b>	<b>1671</b>	2.55	2249	<b>1756</b>	2.70	<b>2467</b>
2500	1633	2.53	2232	<b>1698</b>	2.72	2405	—	—	—
2600	1675	2.77	2436	—	—	—	—	—	—
2700	—	—	—	—	—	—	—	—	—
2800	—	—	—	—	—	—	—	—	—
2900	—	—	—	—	—	—	—	—	—
3000	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1070 to 1460 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2.  indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.40 and the maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F072 (6 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	<b>978</b>	<b>0.66</b>	700	<b>1063</b>	<b>0.82</b>	771	<b>1147</b>	<b>0.97</b>	891	<b>1248</b>	<b>1.20</b>	1081	1322	1.33	1190
1900	<b>1023</b>	<b>0.78</b>	779	<b>1097</b>	<b>0.91</b>	843	<b>1175</b>	<b>1.11</b>	1006	<b>1266</b>	<b>1.29</b>	1156	1356	1.47	1310
2000	<b>1068</b>	<b>0.90</b>	867	<b>1132</b>	<b>1.01</b>	924	<b>1218</b>	<b>1.23</b>	1106	1303	1.41	1258	1397	1.52	1353
2100	<b>1115</b>	<b>1.00</b>	988	<b>1180</b>	<b>1.17</b>	1056	<b>1261</b>	<b>1.35</b>	1207	1340	1.53	1361	1428	1.66	1473
2200	<b>1159</b>	<b>1.15</b>	1081	<b>1214</b>	<b>1.28</b>	1148	1310	1.52	1353	1375	1.63	1447	1459	1.80	1595
2300	<b>1202</b>	<b>1.29</b>	1140	<b>1248</b>	<b>1.38</b>	1233	1358	1.69	1499	1410	1.72	1526	1488	1.93	1709
2400	<b>1237</b>	<b>1.41</b>	1224	<b>1292</b>	<b>1.55</b>	1378	1392	1.81	1604	1460	1.90	1683	1532	2.14	1892
2500	<b>1272</b>	<b>1.53</b>	1335	1335	1.71	1517	1427	1.94	1718	1518	2.16	1910	1575	2.35	2076
2600	1320	1.68	1482	1368	1.81	1604	1458	2.06	1823	1562	2.42	2136	1620	2.59	2283
2700	1361	1.82	1595	1400	1.91	1691	1490	2.19	1936	1602	2.64	2326	1666	2.85	2504
2800	1402	1.95	1639	1439	2.08	1840	1543	2.43	2145	1642	2.86	2512	1775	3.62	3290
2900	1446	2.16	1814	1477	2.16	1989	1585	2.65	2335	1753	3.58	3262	—	—	—
3000	1489	2.36	2032	1529	2.52	2223	1598	2.73	2444	1767	3.69	3360	—	—	—

580F072 (6 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	1395	1.46	1301	1475	1.56	1387	1542	1.71	1517	1607	1.94	1761	1667	2.16	1967
1900	1430	1.58	1404	1504	1.69	1499	1556	1.82	1613	1621	2.06	1874	1682	2.30	2093
2000	1459	1.67	1482	1532	1.82	1613	1588	1.97	1744	1655	2.23	2029	<b>1717</b>	<b>2.49</b>	<b>2266</b>
2100	1489	1.80	1595	1567	1.99	1761	1626	2.16	1910	<b>1694</b>	<b>2.44</b>	<b>2224</b>	<b>1758</b>	<b>2.73</b>	<b>2485</b>
2200	1528	1.95	1726	1603	2.17	1919	1666	2.37	2093	<b>1736</b>	<b>2.68</b>	<b>2441</b>	—	—	—
2300	1561	2.13	1884	1637	2.35	2076	<b>1710</b>	<b>2.54</b>	<b>2272</b>	<b>1782</b>	<b>2.87</b>	<b>2616</b>	—	—	—
2400	1584	2.28	2015	1671	2.55	2249	<b>1756</b>	<b>2.70</b>	<b>2467</b>	—	—	—	—	—	—
2500	1633	2.53	2232	<b>1698</b>	<b>2.72</b>	<b>2405</b>	1779	3.13	2848	—	—	—	—	—	—
2600	1675	2.77	2436	<b>1768</b>	<b>3.26</b>	<b>2964</b>	—	—	—	—	—	—	—	—	—
2700	<b>1776</b>	<b>3.45</b>	<b>3141</b>	—	—	—	—	—	—	—	—	—	—	—	—
2800	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
2900	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1300 to 1685 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **Gray** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.9 and the maximum continuous watts are 2562. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F090 (7½ TONS) — STANDARD MOTOR AND DRIVE AND ALTERNATE DRIVE (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	<b>514</b>	<b>0.55</b>	<b>562</b>	593	0.76	723	662	0.99	907	724	1.22	1097	781	1.78	1318
2300	<b>521</b>	<b>0.57</b>	<b>577</b>	600	0.79	747	668	1.02	932	730	1.26	1131	786	1.50	1335
2400	<b>536</b>	<b>0.63</b>	<b>623</b>	613	0.85	795	680	1.09	989	741	1.34	1199	796	1.59	1413
2500	<b>551</b>	<b>0.69</b>	<b>669</b>	626	0.93	859	693	1.17	1056	753	1.43	1275	808	1.69	1499
2550	<b>559</b>	<b>0.72</b>	<b>692</b>	634	0.97	891	700	1.21	1089	759	1.48	1318	814	1.74	1543
2600	<b>567</b>	<b>0.75</b>	<b>716</b>	641	1.00	916	706	1.25	1123	764	1.52	1353	819	1.79	1587
2700	<b>582</b>	<b>0.83</b>	<b>779</b>	655	1.08	981	719	1.34	1199	776	1.61	1430	831	1.89	1674
2800	598	0.90	835	670	1.17	1056	732	1.43	1275	789	1.71	1517	<b>842</b>	<b>2.00</b>	<b>1770</b>
2900	614	0.98	899	684	1.25	1123	745	1.53	1361	802	1.81	1604	<b>854</b>	<b>2.11</b>	<b>1866</b>
3000	630	1.07	973	699	1.35	1207	759	1.63	1447	815	1.92	1700	<b>866</b>	<b>2.23</b>	<b>1971</b>
3100	646	1.16	1047	714	1.45	1292	773	1.74	1543	828	2.04	1805	<b>878</b>	<b>2.35</b>	<b>2076</b>
3200	662	1.26	1131	729	1.55	1378	787	1.86	1648	<b>841</b>	<b>2.16</b>	<b>1910</b>	891	2.48	2188
3300	679	1.36	1216	744	1.66	1473	801	1.98	1753	<b>854</b>	<b>2.29</b>	<b>2023</b>	904	2.61	2300
3400	695	1.47	1310	759	1.78	1578	816	2.10	1858	867	2.42	2136	917	2.75	2420
3500	712	1.59	1413	774	1.90	1683	830	2.23	1971	881	2.56	2257	930	2.90	2546
3600	729	1.71	1517	790	2.03	1796	<b>845</b>	<b>2.37</b>	<b>2093</b>	895	2.71	2386	943	3.05	2670
3700	745	1.84	1630	805	2.17	1919	860	2.52	2223	909	2.87	2521	956	3.22	2807
3750	754	1.91	1691	813	2.24	1980	868	2.59	2283	917	2.95	2587	963	3.30	2870

580F090 (7½ TONS) — STANDARD MOTOR AND DRIVE AND ALTERNATE DRIVE (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	841	1.81	1604	902	<b>2.25</b>	<b>1989</b>	939	2.60	2292	—	—	—	—	—	—
2300	<b>843</b>	<b>1.83</b>	<b>1621</b>	905	<b>2.28</b>	<b>2015</b>	943	2.62	2309	—	—	—	—	—	—
2400	<b>849</b>	<b>1.88</b>	<b>1665</b>	910	<b>2.31</b>	<b>2041</b>	952	2.74	2411	—	—	—	—	—	—
2500	<b>859</b>	<b>1.96</b>	<b>1735</b>	912	<b>2.31</b>	<b>2050</b>	963	2.81	2470	—	—	—	—	—	—
2550	<b>864</b>	<b>2.01</b>	<b>1779</b>	915	<b>2.34</b>	<b>2067</b>	968	2.81	2479	—	—	—	—	—	—
2600	<b>869</b>	<b>2.06</b>	<b>1823</b>	918	<b>2.37</b>	<b>2093</b>	973	2.81	2487	—	—	—	—	—	—
2700	<b>880</b>	<b>2.17</b>	<b>1919</b>	927	2.47	2180	976	2.84	2495	—	—	—	—	—	—
2800	<b>892</b>	<b>2.29</b>	<b>2023</b>	938	2.58	2275	983	2.92	2562	—	—	—	—	—	—
2900	903	2.42	2136	949	2.71	2386	993	3.03	2653	—	—	—	—	—	—
3000	915	2.54	2240	961	2.85	2504	1003	3.17	2767	—	—	—	—	—	—
3100	926	2.67	2352	972	3.00	2629	1015	3.32	2886	—	—	—	—	—	—
3200	938	2.81	2470	983	3.14	2743	1026	3.47	3002	—	—	—	—	—	—
3300	950	2.95	2587	995	3.30	2870	—	—	—	—	—	—	—	—	—
3400	963	3.10	2710	1007	3.45	2987	—	—	—	—	—	—	—	—	—
3500	976	3.25	2831	—	—	—	—	—	—	—	—	—	—	—	—
3600	988	3.41	2956	—	—	—	—	—	—	—	—	—	—	—	—
3700	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3750	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Standard drive range is 590 to 840 rpm. Alternate drive range is 685 to 935 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates alternate or field-supplied drive is required.
2. **Gray** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.40 and the maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F090 (7½ TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	514	0.55	562	593	0.76	723	662	0.99	907	724	1.22	1097	781	1.48	1318	841	1.81	1604
2300	521	0.57	577	600	0.79	747	668	1.02	932	730	1.26	1131	786	1.50	1335	843	1.83	1621
2400	536	0.63	623	613	0.85	795	680	1.09	989	741	1.34	1199	796	1.59	1413	849	1.88	1665
2500	551	0.69	689	626	0.93	859	693	1.17	1056	753	1.43	1275	808	1.69	1499	859	1.96	1735
2550	559	0.72	692	634	0.97	891	700	1.21	1089	759	1.48	1318	814	1.74	1543	864	2.01	1779
2600	567	0.75	716	641	1.00	916	706	1.25	1123	764	1.52	1353	819	1.79	1587	869	2.06	1823
2700	582	0.83	779	655	1.08	981	719	1.34	1199	776	1.61	1430	831	1.89	1674	880	2.17	1919
2800	598	0.90	835	670	1.17	1056	732	1.43	1275	789	1.71	1517	842	2.00	1770	892	2.29	2023
2900	614	0.98	899	684	1.25	1123	745	1.53	1361	802	1.81	1604	854	2.11	1866	903	2.42	2136
3000	630	1.07	973	699	1.35	1207	759	1.63	1447	815	1.92	1700	866	2.23	1971	915	2.54	2240
3100	646	1.16	1047	714	1.45	1292	773	1.74	1543	828	2.04	1805	878	2.35	2076	926	2.67	2352
3200	662	1.26	1131	729	1.55	1378	787	1.86	1648	841	2.16	1910	891	2.48	2188	938	2.81	2470
3300	697	1.36	1216	744	1.66	1473	801	1.98	1753	854	2.29	2023	904	2.61	2300	950	2.95	2587
3400	695	1.47	1310	759	1.79	1578	816	2.10	1858	867	2.42	2136	917	2.75	2420	963	3.10	2710
3500	712	1.59	1413	774	1.90	1683	830	2.23	1971	881	2.56	2257	930	2.90	2546	976	3.25	2831
3600	729	1.71	1517	780	2.03	1796	845	2.37	2093	895	2.71	2386	943	3.05	2670	988	3.41	2956
3700	745	1.84	1630	805	2.17	1919	860	2.52	2223	909	2.87	2521	956	3.22	2807	1019	3.90	3431
3750	754	1.91	1691	813	2.24	1980	868	2.59	2283	917	2.95	2587	963	3.30	2870	1026	4.00	3517

580F090 (7½ TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	1.4			1.6			1.8			2.0			2.2			2.4		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	902	2.25	1989	939	2.60	2292	979	2.94	2589	1015	3.29	2892	—	—	—	—	—	—
2300	905	2.28	2015	943	2.62	2309	983	2.96	2609	1020	3.31	2914	—	—	—	—	—	—
2400	910	2.31	2041	952	2.74	2411	992	3.10	2729	1029	3.46	3048	—	—	—	—	—	—
2500	912	2.31	2050	963	2.81	2470	1004	3.18	2798	1041	3.55	3126	—	—	—	—	—	—
2550	915	2.34	2067	968	2.81	2479	1009	3.18	2798	1047	3.55	3126	—	—	—	—	—	—
2600	918	2.37	2093	973	2.81	2487	1014	3.18	2798	1052	3.55	3126	—	—	—	—	—	—
2700	927	2.47	2180	976	2.84	2495	1017	3.21	2828	1055	3.59	3159	—	—	—	—	—	—
2800	938	2.58	2275	983	2.92	2562	1024	3.30	2908	1063	3.69	3248	—	—	—	—	—	—
2900	949	2.71	2386	993	3.03	2653	1035	3.43	3017	1074	3.83	3370	—	—	—	—	—	—
3000	961	2.85	2504	1003	3.17	2767	1045	3.59	3157	1084	4.01	3526	—	—	—	—	—	—
3100	972	3.00	2629	1015	3.32	2886	1058	3.76	3306	1097	4.20	3693	—	—	—	—	—	—
3200	983	3.14	2743	1026	3.47	3002	1069	3.83	3456	—	—	—	—	—	—	—	—	—
3300	995	3.30	2870	1043	3.80	3341	—	—	—	—	—	—	—	—	—	—	—	—
3400	1007	3.45	2987	1056	3.97	3493	—	—	—	—	—	—	—	—	—	—	—	—
3500	1030	3.82	3362	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3600	1043	4.01	3528	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3700	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3750	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 860 to 1080 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2.  indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 3.7 and the maximum continuous watts are 3313. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F102 (8½ TONS) — STANDARD MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	559	0.72	692	634	0.97	891	700	1.21	1089	759	1.48	1318	814	1.74	1543
2600	567	0.75	716	641	1.00	916	706	1.25	1123	764	1.52	1353	819	1.79	1587
2700	582	0.83	779	655	1.08	981	719	1.34	1199	776	1.61	1430	831	1.89	1674
2800	598	0.90	835	670	1.17	1056	732	1.43	1275	789	1.71	1517	842	2.00	1770
2900	614	0.98	899	684	1.25	1123	745	1.53	1361	802	1.81	1604	854	2.11	1866
3000	630	1.07	973	690	1.35	1207	759	1.63	1447	815	1.92	1700	866	2.23	1971
3100	646	1.16	1047	714	1.45	1292	773	1.74	1543	828	2.04	1805	878	2.35	2076
3200	662	1.26	1131	729	1.55	1378	787	1.86	1648	841	2.16	1910	891	2.48	2188
3300	679	1.36	1216	744	1.66	1473	801	1.98	1753	854	2.29	2023	904	2.61	2300
3400	695	1.47	1310	759	1.78	1578	816	2.10	1858	867	2.42	2136	917	2.75	2420
3500	712	1.59	1413	774	1.90	1683	830	2.23	1971	881	2.56	2257	930	2.90	2546
3600	729	1.71	1517	790	2.03	1796	845	2.37	2093	895	2.71	2386	943	3.05	2670
3700	745	1.84	1630	805	2.17	1919	860	2.52	2223	909	2.87	2521	956	3.22	2807
3750	754	1.91	1691	813	2.24	1980	868	2.59	2283	917	2.95	2587	963	3.30	2870
3800	762	1.98	1753	821	2.31	2041	875	2.66	2343	924	3.03	2653	970	3.38	2933
3900	779	2.12	1875	836	2.46	2171	890	2.82	2479	938	3.19	2783	—	—	—
4000	796	2.27	2006	852	2.61	2300	905	2.98	2612	953	3.37	2925	—	—	—
4100	813	2.42	2136	868	2.78	2445	920	3.15	2751	—	—	—	—	—	—
4200	830	2.59	2283	884	2.95	2587	935	3.33	2894	—	—	—	—	—	—
4250	839	2.68	2360	890	3.04	2661	—	—	—	—	—	—	—	—	—

580F102 (8½ TONS) — STANDARD MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	864	2.01	1779	915	2.34	2067	968	2.81	2479	—	—	—	—	—	—
2600	869	2.06	1823	918	2.37	2093	973	2.81	2487	—	—	—	—	—	—
2700	880	2.17	1919	927	2.47	2180	976	2.84	2495	—	—	—	—	—	—
2800	892	2.29	2023	938	2.58	2275	983	2.92	2562	—	—	—	—	—	—
2900	903	2.42	2136	949	2.71	2386	993	3.03	2653	—	—	—	—	—	—
3000	915	2.54	2240	961	2.85	2504	1003	3.17	2767	—	—	—	—	—	—
3100	926	2.67	2352	972	3.00	2629	1016	3.32	2886	—	—	—	—	—	—
3200	938	2.81	2470	983	3.14	2743	1026	3.47	3002	—	—	—	—	—	—
3300	950	2.95	2587	995	3.30	2870	—	—	—	—	—	—	—	—	—
3400	963	3.10	2710	1007	3.45	2987	—	—	—	—	—	—	—	—	—
3500	976	3.25	2831	—	—	—	—	—	—	—	—	—	—	—	—
3600	988	3.41	2956	—	—	—	—	—	—	—	—	—	—	—	—
3700	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3750	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3800	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3900	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4100	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4200	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4250	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

Bhp — Brake Horsepower Input to Fan  
 FIOP — Factory-Installed Option  
 Watts — Input Watts to Motor

\*Motor drive range is 685 to 935 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **■** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.4 and the maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

**PERFORMANCE DATA (cont)**  
**FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)**

580F102 (8 <sup>1</sup> / <sub>2</sub> TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	559	0.72	692	634	0.97	891	700	1.21	1089	759	1.48	1318	814	1.74	1543
2600	567	0.75	716	641	1.00	916	706	1.25	1123	764	1.52	1353	819	1.79	1587
2700	582	0.83	779	655	1.08	981	719	1.34	1199	776	1.61	1430	831	1.89	1674
2800	598	0.90	835	670	1.17	1056	732	1.43	1275	789	1.71	1517	842	2.00	1770
2900	614	0.98	899	684	1.25	1123	745	1.53	1361	802	1.81	1604	854	2.11	1866
3000	630	1.07	973	690	1.35	1207	759	1.63	1447	816	1.92	1700	866	2.23	1971
3100	646	1.16	1047	714	1.45	1292	773	1.74	1543	828	2.04	1805	878	2.35	2076
3200	662	1.26	1131	729	1.55	1378	787	1.86	1648	841	2.18	1910	891	2.48	2188
3300	679	1.36	1216	744	1.66	1473	801	1.98	1753	854	2.29	2023	904	2.61	2300
3400	695	1.47	1310	759	1.76	1578	816	2.10	1858	867	2.42	2136	917	2.75	2420
3500	712	1.59	1413	744	1.90	1683	830	2.23	1971	881	2.56	2257	930	2.90	2546
3600	729	1.71	1517	790	2.03	1796	845	2.37	2093	895	2.71	2386	943	3.05	2670
3700	745	1.84	1630	805	2.17	1919	860	2.52	2223	909	2.87	2521	956	3.22	2807
3750	754	1.91	1691	813	2.24	1980	868	2.59	2283	917	2.95	2587	963	3.30	2870
3800	762	1.98	1753	821	2.31	2041	875	2.66	2343	924	3.03	2653	970	3.38	2933
3900	779	2.12	1875	836	2.46	2171	890	2.82	2479	938	3.19	2783	981	3.65	3209
4000	796	2.27	2006	852	2.61	2300	905	2.98	2612	953	3.37	2925	996	3.85	3390
4100	813	2.42	2136	868	2.78	2445	920	3.15	2751	974	3.74	3294	—	—	—
4200	830	2.59	2283	884	2.95	2587	935	3.33	2894	990	3.96	3482	—	—	—
4250	839	2.68	2360	890	3.04	2661	965	3.88	3412	—	—	—	—	—	—

580F102 (8 <sup>1</sup> / <sub>2</sub> TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	864	2.01	1779	915	2.34	2067	968	2.81	2479	991	3.02	2654	1012	3.21	2827
2600	869	2.06	1823	918	2.37	2093	973	2.81	2487	996	3.02	2654	1017	3.21	2827
2700	880	2.17	1919	927	2.47	2180	976	2.84	2495	999	3.05	2682	1021	3.25	2857
2800	892	2.29	2023	938	2.58	2275	983	2.92	2562	1006	3.13	2758	1028	3.34	2938
2900	903	2.42	2136	949	2.71	2386	993	3.03	2653	1017	3.25	2862	1038	3.46	3048
3000	915	2.54	2240	961	2.85	2504	1003	3.17	2767	1027	3.40	2994	1049	3.62	3189
3100	926	2.67	2352	972	3.00	2629	1016	3.32	2886	1040	3.65	3136	1062	3.80	3340
3200	938	2.81	2470	983	3.14	2743	1026	3.47	3002	1050	3.72	3277	1073	3.97	3491
3300	950	2.95	2587	995	3.30	2870	1022	3.58	3146	1046	3.84	3377	1069	4.09	3597
3400	963	3.10	2710	1007	3.45	2987	1034	3.74	3289	1059	4.01	3530	—	—	—
3500	976	3.25	2831	1007	3.56	3137	1034	3.86	3399	1058	4.15	3648	—	—	—
3600	988	3.41	2956	1019	3.74	3292	1047	4.05	3566	—	—	—	—	—	—
3700	992	3.59	3161	1023	3.94	3467	—	—	—	—	—	—	—	—	—
3750	999	3.68	3240	1030	4.04	3554	—	—	—	—	—	—	—	—	—
3800	1006	3.77	3318	1038	4.14	3640	—	—	—	—	—	—	—	—	—
3900	1017	4.07	3580	—	—	—	—	—	—	—	—	—	—	—	—
4000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4100	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4200	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4250	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

**LEGEND**

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 860 to 1080 rpm. All other rpms require a field-supplied drive.

**NOTES:**

1. **Boldface** indicates field-supplied drive is required.
2. **■** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 3.7 and the maximum continuous watts are 3313. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F120 (10 TONS)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3000	592	0.76	723	661	0.93	859	722	1.09	989	779	1.26	1131	829	1.42	1267	880	1.58	1404
3100	607	0.83	779	676	1.01	924	734	1.17	1056	791	1.34	1199	840	1.51	1344	890	1.68	1491
3200	622	0.90	835	690	1.09	989	746	1.25	1123	803	1.43	1275	852	1.60	1422	900	1.77	1569
3300	638	0.98	899	705	1.17	1056	759	1.33	1190	815	1.52	1353	864	1.70	1508	910	1.88	1665
3400	653	1.06	965	719	1.26	1131	772	1.43	1275	826	1.62	1439	876	1.81	1604	921	1.98	1753
3500	669	1.15	1039	733	1.35	1207	786	1.53	1361	838	1.72	1526	888	1.91	1691	933	2.10	1858
3600	684	1.24	1114	747	1.44	1284	800	1.64	1456	850	1.82	1613	900	2.03	1796	945	2.22	2014
3700	700	1.33	1190	760	1.54	1370	814	1.75	1552	863	1.92	1700	912	2.14	1892	957	2.34	2117
3800	715	1.43	1275	774	1.64	1456	828	1.86	1648	875	2.04	1805	924	2.26	1997	969	2.47	2230
3900	731	1.54	1370	787	1.74	1543	843	1.98	1753	888	2.16	1910	936	2.38	2151	981	2.60	2344
4000	747	1.64	1456	801	1.85	1639	857	2.10	1858	902	2.30	2032	948	2.51	2265	993	2.74	2469
4100	763	1.76	1560	816	1.97	1744	872	2.23	1971	916	2.44	2203	960	2.64	2380	1005	2.88	2596
4200	778	1.88	1665	831	2.10	1884	886	2.36	2084	929	2.58	2326	972	2.78	2505	1016	3.03	2735
4300	794	2.00	1770	846	2.23	1971	900	2.50	2256	943	2.73	2460	985	2.93	2642	1028	3.17	2866
4400	810	2.13	1884	861	2.37	2093	913	2.64	2380	958	2.89	2605	999	3.09	2791	1040	3.32	3010
4500	826	2.27	2006	876	2.52	2273	927	2.78	2505	973	3.04	2744	1012	3.26	2952	—	—	—
4600	842	2.41	2177	892	2.67	2406	940	2.92	2633	987	3.21	2904	—	—	—	—	—	—
4700	858	2.55	2300	907	2.83	2551	954	3.08	2782	1002	3.38	3068	—	—	—	—	—	—
4800	874	2.70	2433	922	2.99	2698	968	3.24	2933	—	—	—	—	—	—	—	—	—
4900	890	2.86	2578	938	3.16	2857	—	—	—	—	—	—	—	—	—	—	—	—
5000	906	3.03	2735	953	3.33	3020	—	—	—	—	—	—	—	—	—	—	—	—

580F120 (10 TONS)* (cont)												
Airflow (Cfm)	External Static Pressure (in. wg)											
	1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3000	924	1.73	1534	970	1.89	1736	1019	2.00	1828	1066	2.30	2082
3100	935	1.84	1695	977	2.00	1828	1026	2.17	1971	1070	2.44	2203
3200	946	1.95	1786	987	2.11	1920	1029	2.28	2065	1075	2.51	2265
3300	957	2.06	1878	998	2.23	2022	1037	2.40	2169	1082	2.58	2326
3400	967	2.17	1971	1009	2.35	2125	1047	2.53	2282	1087	2.70	2433
3500	976	2.29	2074	1020	2.48	2238	1058	2.66	2397	1095	2.84	2560
3600	986	2.41	2177	1030	2.61	2353	1069	2.80	2523	1106	2.98	2688
3700	998	2.54	2291	1039	2.74	2469	1081	2.94	2651	1117	3.13	2829
3800	1010	2.67	2406	1049	2.87	2587	1091	3.08	2782	1128	3.29	2981
3900	1022	2.81	2533	1060	3.02	2726	1100	3.23	2923	—	—	—
4000	1034	2.96	2670	1072	3.17	2866	1110	3.38	3068	—	—	—
4100	1046	3.11	2810	1084	3.32	3010	—	—	—	—	—	—
4200	1058	3.26	2952	—	—	—	—	—	—	—	—	—
4300	—	—	—	—	—	—	—	—	—	—	—	—
4400	—	—	—	—	—	—	—	—	—	—	—	—
4500	—	—	—	—	—	—	—	—	—	—	—	—
4600	—	—	—	—	—	—	—	—	—	—	—	—
4700	—	—	—	—	—	—	—	—	—	—	—	—
4800	—	—	—	—	—	—	—	—	—	—	—	—
4900	—	—	—	—	—	—	—	—	—	—	—	—
5000	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Standard drive range is 685 to 935 rpm. Alternate motor drive range is 835 to 1085 rpm. High-static motor drive range is 830 to 1130 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates optional high-static motor and drive are required.
2. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
3. Maximum continuous bhp is 2.4 for the standard motor, 2.9 for the alternate motor and 5.25 for the high-static motor. Maximum continuous watts are 2120 for the standard motor, 2615 for the alternate motor and 4400 for the high-static motor. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
4. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
5. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

580F150 (12 <sup>1</sup> / <sub>2</sub> TONS)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3750	737	1.41	1300	798	1.64	1486	854	1.84	1658	909	2.12	1893	961	2.35	2097	1014	2.61	2325
3800	745	1.46	1340	805	1.69	1531	861	1.89	1700	915	2.17	1940	967	2.41	2149	1019	2.67	2378
3900	761	1.56	1423	820	1.80	1624	875	2.01	1802	928	2.29	2044	979	2.55	2272	1029	2.80	2494
4000	777	1.67	1514	836	1.92	1725	889	2.14	1914	941	2.40	2140	991	2.68	2387	1040	2.94	2620
4100	793	1.79	1615	851	2.05	1836	904	2.27	2027	955	2.52	2246	1004	2.82	2512	1052	3.08	2746
4200	810	1.91	1717	867	2.18	1948	918	2.41	2149	968	2.65	2361	1017	2.96	2638	1064	3.23	2882
4300	826	2.04	1828	883	2.32	2070	933	2.55	2272	982	2.79	2485	1030	3.11	2773	1076	3.40	3037
4400	842	2.17	1940	898	2.46	2193	948	2.70	2405	996	2.93	2611	1043	3.25	2901	1088	3.56	3184
4500	859	2.31	2061	914	2.60	2316	962	2.85	2539	1010	3.09	2755	1056	3.40	3037	1101	3.73	3341
4600	876	2.45	2184	930	2.76	2459	977	3.01	2683	1024	3.26	2910	1070	3.55	3175	1114	3.90	3498
4700	892	2.60	2316	945	2.91	2593	992	3.18	2837	1039	3.43	3065	1083	3.71	3322	1126	4.07	3655
4800	909	2.77	2468	961	3.07	2737	1008	3.36	3001	1053	3.61	3230	1097	3.88	3479	1140	4.25	3822
4900	926	2.93	2611	977	3.24	2891	1024	3.54	3166	1068	3.80	3405	1111	4.06	3646	1153	4.41	3971
5000	942	3.11	2773	993	3.41	3047	1039	3.73	3341	1080	3.99	3581	1125	4.25	3822	1166	4.59	4139
5100	959	3.29	2937	1009	3.60	3221	1055	3.92	3516	1097	4.19	3767	1139	4.46	4018	1180	4.78	4316
5200	976	3.47	3101	1025	3.78	3387	1071	4.12	3702	1112	4.40	3962	1153	4.67	4214	1194	4.98	4503
5300	993	3.67	3285	1041	3.98	3572	1086	4.33	3897	1127	4.61	4158	1168	4.90	4428	1208	5.19	4698
5400	1010	3.87	3470	1057	4.18	3757	1102	4.54	4093	1142	4.84	4372	1182	5.13	4642	—	—	—
5500	1027	4.07	3655	1073	4.39	3953	1118	4.76	4298	1157	5.07	4586	—	—	—	—	—	—
5600	1043	4.29	3860	1090	4.61	4158	1133	4.99	4512	—	—	—	—	—	—	—	—	—
5700	1060	4.51	4065	1106	4.83	4363	1149	5.22	4726	—	—	—	—	—	—	—	—	—
5800	1077	4.74	4279	1122	5.07	4586	—	—	—	—	—	—	—	—	—	—	—	—
5900	1094	4.98	4503	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6000	1111	5.22	4726	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6100	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6250	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

580F150 (12 <sup>1</sup> / <sub>2</sub> TONS)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	1.4			1.6			1.8			2.0			2.0			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3750	1065	2.87	2557	1113	3.12	2783	1158	3.36	2997	1197	3.56	3180	—	—	—	—	—	—
3800	1070	2.94	2620	1118	3.19	2846	1163	3.44	3074	1203	3.65	3267	—	—	—	—	—	—
3900	1079	3.07	2737	1128	3.34	2983	1173	3.60	3221	1214	3.83	3433	—	—	—	—	—	—
4000	1089	3.22	2873	1137	3.49	3120	1183	3.76	3368	1225	4.00	3590	—	—	—	—	—	—
4100	1100	3.36	3001	1147	3.65	3267	1193	3.93	3525	1236	4.19	3767	—	—	—	—	—	—
4200	1110	3.51	3138	1157	3.81	3414	1202	4.09	3674	1245	4.38	3943	—	—	—	—	—	—
4300	1121	3.67	3285	1167	3.97	3562	1212	4.27	3841	1255	4.56	4111	—	—	—	—	—	—
4400	1133	3.84	3442	1178	4.14	3720	1222	4.44	3999	1265	4.74	4279	—	—	—	—	—	—
4500	1144	4.00	3590	1188	4.31	3878	1232	4.62	4167	1274	4.93	4456	—	—	—	—	—	—
4600	1157	4.19	3767	1199	4.49	4046	1242	4.81	4344	1284	5.13	4642	—	—	—	—	—	—
4700	1169	4.38	3943	1210	4.68	4223	1252	5.00	4521	—	—	—	—	—	—	—	—	—
4800	1181	4.58	4130	1222	4.87	4400	1263	5.20	4707	—	—	—	—	—	—	—	—	—
4900	1194	4.77	4307	1234	5.09	4605	—	—	—	—	—	—	—	—	—	—	—	—
5000	1207	4.97	4493	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5100	1220	5.18	4689	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5200	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5300	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5400	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5600	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5700	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5800	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5900	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6100	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6250	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

Bhp — Brake Horsepower Input to Fan

FIOP — Factory-Installed Option

Watts — Input Watts to Motor

\*Standard drive range is 860 to 1080 rpm. Alternate motor drive range is 900 to 1260 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates alternate motor and drive are required.
2. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

3. Maximum continuous bhp is 3.70 for the standard motor and 5.25 for the alternate motor. Maximum continuous watts are 3313 for the standard motor and 4400 for the alternate motor. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
4. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
5. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS

580F036 (3 TONS) — STANDARD MOTOR (DIRECT DRIVE)												
Airflow (Cfm)	Low Speed						High Speed					
	208 V			230, 460, 575 V			208 V			230, 460, 575 V		
	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts
900	0.54	0.21	253	0.57	0.23	277	0.55	0.26	307	0.60	0.31	363
1000	0.49	0.23	270	0.51	0.25	292	0.52	0.27	321	0.53	0.32	374
1100	0.43	0.24	287	0.45	0.26	307	0.46	0.28	335	0.49	0.33	385
1200	0.39	0.26	304	0.40	0.27	323	0.38	0.29	349	0.43	0.34	397
1300	0.33	0.27	321	0.35	0.29	338	0.35	0.31	364	0.36	0.34	408
1400	0.26	0.29	338	0.28	0.30	354	0.29	0.32	378	—	—	—
1500	0.21	0.30	355	0.23	0.31	369	0.24	0.33	392	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**Esp** — External Static Pressure (in. wg)  
**FIOP** — Factory-Installed Option

#### NOTES:

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

- Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for Additional information.

- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.

580F036 (3 TONS) — ALTERNATE MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.1			0.2			0.3			0.4			0.5			0.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	526	0.06	70	584	0.08	99	656	0.12	139	734	0.22	219	818	0.25	269	875	0.27	269
1000	570	0.09	109	627	0.13	149	738	0.19	189	800	0.26	259	848	0.29	288	895	0.31	308
1100	614	0.13	149	670	0.16	189	758	0.23	229	812	0.29	288	863	0.32	308	914	0.35	348
1200	658	0.16	189	710	0.23	229	780	0.28	279	840	0.32	318	889	0.36	358	938	0.40	398
1300	703	0.20	239	752	0.27	269	808	0.32	318	868	0.37	368	916	0.41	408	963	0.45	448
1400	725	0.29	288	776	0.31	308	845	0.38	378	891	0.42	418	937	0.47	467	983	0.51	507
1500	755	0.33	328	816	0.38	378	870	0.43	428	924	0.48	477	969	0.53	527	1014	0.58	577

580F036 (3 TONS) — ALTERNATE MOTOR (BELT DRIVE)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.7			0.8			0.9			1.0			1.1			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	924	0.32	308	953	0.35	348	989	0.38	388	1028	0.42	438	1074	0.45	487	1120	0.50	537
1000	936	0.35	348	977	0.39	388	1020	0.44	438	1064	0.48	477	1124	0.52	537	1185	0.55	597
1100	960	0.39	388	1005	0.43	428	1052	0.49	487	1100	0.52	527	1163	0.56	587	1225	0.60	647
1200	988	0.45	448	1038	0.50	497	1076	0.53	527	1136	0.59	577	1201	0.61	647	1266	0.64	716
1300	1012	0.51	507	1061	0.56	557	1094	0.61	607	1172	0.65	647	1239	0.69	716	1306	0.72	786
1400	1027	0.56	557	1071	0.60	597	1108	0.67	666	1208	0.70	706	1278	0.75	786	1347	0.79	865
1500	1056	0.63	627	1097	0.68	676	1117	0.70	696	1245	0.74	776	1315	0.80	865	1385	0.85	955

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 760 to 1000 rpm. All other rpms require a field-supplied drive.

#### NOTES:

- Boldface** indicates field-supplied drive is required.
- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

- Maximum continuous bhp is 1.00 and maximum continuous watts are 1000. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
- Interpolation is permissible. Do not extrapolate.

**PERFORMANCE DATA (cont)**  
**FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)**

580F036 (3 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	584	0.08	99	734	0.22	219	875	0.27	269	953	0.36	348	1028	0.42	438
1000	627	0.13	149	800	0.26	259	895	0.31	308	977	0.39	388	1064	0.48	477
1100	670	0.16	189	812	0.29	288	914	0.35	348	1005	0.43	428	1100	0.52	527
1200	710	0.23	229	840	0.32	318	938	0.40	398	1038	0.50	497	1136	0.59	577
1300	752	0.27	269	868	0.37	368	963	0.45	448	1061	0.56	557	1172	0.65	647
1400	776	0.31	308	891	0.42	418	983	0.51	507	1071	0.60	597	1208	0.70	706
1500	816	0.38	378	924	0.48	477	1014	0.58	577	1097	0.68	676	1245	0.74	776

580F036 (3 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
900	1120	0.54	537	1155	0.59	589	1186	0.64	639	1215	0.69	685	1240	0.73	730
1000	1185	0.60	597	1222	0.66	655	1255	0.71	709	1285	0.77	761	1312	0.82	811
1100	1225	0.65	647	1263	0.71	709	1298	0.77	769	1328	0.83	825	1357	0.88	879
1200	1266	0.72	716	1306	0.79	786	1341	0.86	851	1373	0.92	914	1402	0.98	973
1300	1306	0.79	786	1347	0.87	862	1383	0.94	934	1416	1.01	1003	1446	1.07	1068
1400	1347	0.87	865	1389	0.95	950	1427	1.03	1029	1461	1.11	1104	1492	1.18	1176
1500	1385	0.96	955	1428	1.05	1048	1467	1.14	1135	1502	1.22	1218	1534	1.30	1298

**LEGEND**

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1075 to 1455 rpm. All other rpms require a field-supplied drive.

**NOTES:**

1. **Boldface** indicates field-supplied drive is required.
2. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

3. Maximum continuous bhp is 2.4 and maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
4. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
5. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F048 (4 TONS) — STANDARD MOTOR (DIRECT DRIVE)												
Airflow (Cfm)	Low Speed						High Speed					
	208 V			230, 460, 575 V			208 V			230, 460, 575 V		
	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts
1200	0.75	0.41	458	0.81	0.45	506	0.87	0.51	572	0.92	0.56	632
1300	0.68	0.42	471	0.74	0.46	521	0.79	0.52	589	0.85	0.58	651
1400	0.60	0.45	503	0.66	0.49	556	0.71	0.54	616	0.77	0.60	681
1500	0.51	0.47	536	0.58	0.52	593	0.64	0.56	631	0.70	0.62	698
1600	0.42	0.49	557	0.49	0.54	616	0.56	0.58	654	0.63	0.64	723
1700	0.32	0.52	584	0.39	0.57	646	0.48	0.60	678	0.55	0.66	750
1800	0.21	0.54	610	0.29	0.60	674	0.41	0.62	698	0.48	0.68	772
1900	0.09	0.56	629	0.18	0.62	696	0.33	0.64	720	0.41	0.70	796
2000	—	—	—	0.06	0.65	731	0.26	0.66	744	0.33	0.73	823

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**Esp** — External Static Pressure (in. wg)  
**FIOP** — Factory-Installed Option

#### NOTES:

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

- Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for Additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.

580F048 (4 TONS) — ALTERNATE MOTOR (BELT DRIVE)*																					
Airflow (Cfm)	External Static Pressure (in. wg)																				
	0.1			0.2			0.3			0.4			0.6			0.7			0.8		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1200	569	0.18	189	641	0.23	242	701	0.29	299	761	0.34	357	859	0.46	483	901	0.52	546	943	0.58	609
1300	604	0.22	231	673	0.28	294	731	0.34	352	788	0.39	410	887	0.52	546	928	0.59	615	968	0.65	683
1400	640	0.27	284	705	0.33	347	761	0.39	410	817	0.45	473	914	0.59	620	955	0.66	688	996	0.72	757
1500	676	0.32	336	738	0.38	399	793	0.45	468	847	0.51	536	940	0.65	683	982	0.73	767	1024	0.81	851
1600	713	0.38	399	772	0.44	462	825	0.51	536	877	0.58	609	967	0.73	767	1009	0.81	851	1051	0.89	935
1700	750	0.45	473	806	0.51	536	857	0.59	615	908	0.66	693	997	0.81	851	1037	0.90	940	1077	1.01	1030
1800	788	0.52	546	841	0.59	620	890	0.67	704	939	0.75	788	1026	0.91	956	1065	1.01	1040	1104	1.07	1124
1900	826	0.60	630	876	0.68	714	924	0.76	799	971	0.84	883	1056	1.01	1061	1094	1.10	1151	1132	1.18	1240
2000	864	0.70	735	912	0.77	809	958	0.86	898	1004	0.94	988	1087	1.12	1177	1125	1.21	1271	1162	1.30	1366

580F048 (4 TONS) — ALTERNATE MOTOR (BELT DRIVE)* (cont)																					
Airflow (Cfm)	External Static Pressure (in. wg)																				
	0.9			1.0			1.1			1.2			1.4			1.6			1.8		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1200	987	0.64	652	1030	0.70	695	1068	0.79	792	1106	0.87	889	1134	0.98	998	1189	1.12	1138	1245	1.21	1358
1300	1006	0.71	709	1044	0.77	736	1086	0.84	833	1128	0.91	930	1183	1.10	1052	1226	1.23	1215	1297	1.35	1406
1400	1033	0.79	797	1069	0.86	838	1104	0.93	925	1139	1.01	1012	1218	1.14	1090	1286	1.34	1282	1320	1.48	1463
1500	1060	0.88	891	1095	0.95	930	1129	1.02	1022	1162	1.09	1114	1228	1.24	1186	1303	1.40	1339	1343	1.60	1530
1600	1087	1.01	1001	1123	1.05	1073	1156	1.13	1150	1185	1.20	1226	1250	1.35	1291	1319	1.51	1444	1382	1.68	1607
1700	1114	1.07	1108	1151	1.15	1185	1183	1.23	1262	1215	1.31	1339	1276	1.48	1415	1334	1.64	1569	1398	1.80	1722
1800	1141	1.17	1221	1178	1.26	1318	1211	1.35	1390	1243	1.43	1461	1303	1.61	1540	1359	1.78	1702	1418	1.95	1865
1900	1168	1.28	1371	1204	1.37	1502	1238	1.47	1548	1271	1.56	1594	1330	1.74	1664	1386	1.93	1846	1439	2.11	2018
2000	1197	1.39	1485	1231	1.48	1604	1265	1.59	1666	1298	1.69	1727	1358	1.89	1808	1413	2.08	1989	1466	2.27	2171

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 835 to 1185 rpm. All other rpms require a field-supplied drive.

#### NOTES:

- Boldface** indicates field-supplied drive is required.
- indicates field-supplied motor and drive are required.

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
- Maximum continuous bhp is 1.00 and the maximum continuous watts are 1000. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
- Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F048 (4 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1200	641	0.23	242	761	0.34	357	859	0.46	483	943	0.58	609	1030	0.70	695
1300	673	0.28	294	788	0.39	410	887	0.52	546	968	0.65	683	1044	0.77	736
1400	705	0.33	347	817	0.45	473	914	0.59	620	996	0.72	757	1069	0.86	838
1500	738	0.38	399	847	0.51	536	940	0.65	683	1024	0.81	851	1095	0.95	930
1600	772	0.44	462	877	0.58	609	967	0.73	767	1051	0.89	935	1123	1.05	1073
1700	806	0.51	536	908	0.66	693	997	0.81	851	1077	1.01	1030	1151	1.15	1185
1800	841	0.59	620	939	0.75	789	1026	0.91	956	1104	1.07	1124	1178	1.26	1318
1900	876	0.68	714	971	0.84	883	1056	1.01	1061	1132	1.18	1240	1204	1.37	1502
2000	912	0.77	809	1004	0.94	988	1087	1.12	1177	1162	1.30	1366	1231	1.48	1604

580F048 (4 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1200	1106	0.87	889	1134	0.98	998	1189	1.12	1138	1245	1.21	1358	1292	1.35	1345
1300	1128	0.91	930	1183	1.10	1052	1226	1.23	1215	1297	1.35	1406	1346	1.51	1500
1400	1139	1.01	1012	1218	1.14	1090	1286	1.34	1282	1320	1.48	1463	1370	1.65	1645
1500	1162	1.09	1114	1228	1.24	1186	1303	1.40	1339	1343	1.60	1530	1393	1.79	1778
1600	1185	1.20	1226	1250	1.35	1291	1319	1.51	1444	1382	1.68	1607	1434	1.88	1867
1700	1215	1.31	1339	1276	1.48	1415	1334	1.64	1569	1389	1.80	1722	1451	2.01	2001
1800	1243	1.43	1461	1303	1.61	1540	1359	1.78	1702	1418	1.95	1865	1471	2.18	2167
1900	1271	1.56	1594	1330	1.74	1664	1386	1.93	1846	1439	2.11	2018	1493	2.36	2345
2000	1298	1.69	1727	1358	1.89	1808	1413	2.08	1989	1468	2.27	2171	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1075 to 1455 rpm. All other rpms require a field-supplied drive.

#### NOTES:

- Boldface** indicates field-supplied drive is required.
- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

- Maximum continuous bhp is 2.4 and maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
- Interpolation is permissible. Do not extrapolate.

580F060 (5 TONS) — STANDARD MOTOR (DIRECT DRIVE)																		
Airflow (Cfm)	Low Speed						Medium Speed						High Speed					
	208V			230, 460, 575 V			208 V			230, 460, 575 V			208 V			230, 460, 575 V		
	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts	Esp	Bhp	Watts
1500	0.74	0.67	750	1.06	0.71	791	1.07	0.70	782	1.27	0.76	845	1.26	0.79	875	1.33	0.85	949
1600	0.54	0.70	780	0.90	0.74	824	0.92	0.74	821	1.13	0.79	883	1.14	0.82	913	1.22	0.89	988
1700	0.34	0.73	810	0.75	0.77	857	0.77	0.77	861	1.00	0.83	921	1.01	0.85	950	1.11	0.92	1027
1800	0.14	0.75	839	0.59	0.80	891	0.62	0.81	900	0.87	0.86	959	0.89	0.88	988	1.00	0.96	1066
1900	—	—	—	0.44	0.83	924	0.47	0.84	940	0.74	0.90	997	0.77	0.92	1025	0.89	0.99	1105
2000	—	—	—	0.28	0.86	957	0.32	0.88	979	0.61	0.93	1035	0.64	0.95	1063	0.78	1.03	1144
2100	—	—	—	0.13	0.89	990	0.17	0.91	1018	0.48	0.96	1073	0.51	0.99	1101	0.67	1.06	1183
2200	—	—	—	—	—	—	0.02	0.95	1058	0.35	1.00	1111	0.39	1.02	1138	0.56	1.10	1222
2300	—	—	—	—	—	—	—	—	—	0.22	1.03	1149	0.26	1.06	1176	0.45	1.13	1261
2400	—	—	—	—	—	—	—	—	—	0.09	1.07	1187	0.14	1.09	1213	0.34	1.17	1300
2500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	0.23	1.20	1340	

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**Esp** — External Static Pressure (in. wg)  
**FIOF** — Factory-Installed Option

#### NOTES:

- Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

- Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for Additional information.
- Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F060 (5 TONS) — ALTERNATE MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.1			0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1500	730	0.34	357	789	0.40	420	896	0.53	557	990	0.67	704	1072	0.83	872	1153	1.00	1051
1600	770	0.40	420	826	0.46	483	931	0.61	641	1020	0.75	788	1101	0.91	956	1178	1.09	1145
1700	811	0.47	494	865	0.54	567	966	0.69	725	1051	0.84	883	1133	1.01	1061	1205	1.18	1240
1800	852	0.55	578	905	0.62	651	1002	0.78	820	1084	0.93	977	1163	1.10	1156	1235	1.29	1355
1900	894	0.54	567	945	0.72	757	1037	0.88	925	1119	1.04	1093	1194	1.21	1271	1266	1.40	1471
2000	936	0.74	778	984	0.82	862	1072	0.98	1030	1154	1.16	1219	1226	1.33	1397	1297	1.53	1608
2100	978	0.85	893	1024	0.93	977	1108	1.10	1156	1192	1.29	1355	1259	1.47	1545	1327	1.66	1744
2200	1021	0.97	1019	1064	1.05	1103	1145	1.22	1282	1225	1.43	1503	1294	1.62	1702	1359	1.80	1902
2300	1064	1.10	1156	1104	1.18	1240	1183	1.36	1429	1260	1.57	1650	1330	1.78	1870	1392	1.97	2070
2400	1107	1.24	1303	1145	1.32	1387	1222	1.45	1524	1296	1.73	1818	1365	1.94	2038	1426	2.15	2259
2500	1150	1.39	1460	1186	1.48	1555	1262	1.68	1765	1331	1.89	1986	1400	2.12	2227	1461	2.34	2459

580F060 (5 TONS) — ALTERNATE MOTOR (BELT DRIVE)* (cont)																	
Airflow (Cfm)	External Static Pressure (in. wg)																
	1.2			1.4			1.6			1.8							
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp
1500	1221	1.17	1229	1256	1.30	1366	1283	1.32	1387	1303	1.22	1282					
1600	1252	1.27	1334	1311	1.45	1524	1340	1.58	1660	1330	1.61	1692					
1700	1278	1.37	1439	1345	1.57	1650	1397	1.76	1849	1424	1.89	1986					
1800	1303	1.48	1555	1371	1.69	1776	1433	1.90	1996	1480	2.09	2196					
1900	1330	1.59	1671	1396	1.80	1902	1460	2.03	2133	1517	2.25	2364					
2000	1362	1.73	1818	1422	1.94	2038	1485	2.16	2270	1544	2.40	2522					
2100	1393	1.87	1965	1452	2.08	2185	1510	2.31	2427	1570	2.55	2674					
2200	1423	2.02	2122	1483	2.24	2354	1538	2.46	2585	1594	2.71	2821					
2300	1454	2.18	2291	1515	2.41	2532	1571	2.64	2758	1623	2.88	2976					
2400	1485	2.36	2480	1544	2.59	2721	1604	2.84	2947	1657	3.07	3152					
2500	1518	2.55	2679	1574	2.78	2905	1633	3.03	3134	1692	3.28	3345					

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 900 to 1300 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **■** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 1.30 for single-phase units and 2.40 for 3-phase units and the maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F060 (5 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1500	789	0.40	420	896	0.53	557	990	0.67	704	1072	0.83	872	1153	1.00	1051	1221	1.17	1229
1600	826	0.46	483	931	0.61	641	1020	0.75	788	1101	0.91	956	1178	1.09	1145	1252	1.27	1334
1700	865	0.54	567	966	0.69	725	1051	0.84	883	1133	1.01	1061	1205	1.18	1240	1278	1.37	1439
1800	905	0.62	661	1002	0.78	820	1084	0.93	977	1163	1.10	1156	1235	1.29	1355	1303	1.48	1555
1900	945	0.72	757	1037	0.88	925	1119	1.04	1093	1194	1.21	1271	1266	1.40	1471	1330	1.59	1671
2000	984	0.82	862	1072	0.98	1030	1154	1.16	1219	1226	1.33	1397	1297	1.53	1608	1362	1.73	1818
2100	1024	0.93	977	1108	1.10	1156	1192	1.29	1355	1259	1.47	1545	1327	1.66	1744	1393	1.87	1965
2200	1064	1.05	1103	1145	1.22	1282	1225	1.43	1503	1294	1.62	1702	1359	1.80	1902	1423	2.02	2122
2300	1104	1.18	1240	1183	1.36	1429	1260	1.57	1650	1330	1.78	1870	1392	1.97	2070	1454	2.18	2291
2400	1145	1.32	1387	1222	1.45	1524	1296	1.73	1818	1365	1.94	2038	1426	2.15	2259	1485	2.36	2480
2500	1186	1.48	1555	1262	1.68	1765	1331	1.89	1986	1400	2.12	2227	1461	2.34	2459	1518	2.55	2679

580F060 (5 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	1.4			1.6			1.8			2.0			2.2			2.4		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1500	1256	1.30	1366	1283	1.32	1387	1303	1.22	1282	1345	1.34	1390	1400	1.46	1494	1450	1.63	1555
1600	1311	1.45	1524	1340	1.58	1660	1330	1.61	1692	1373	1.77	1834	1400	1.90	1902	1423	2.02	2122
1700	1345	1.57	1650	1397	1.76	1849	1424	1.89	1986	1470	2.08	2153	1450	2.21	2259	1485	2.36	2480
1800	1371	1.69	1776	1433	1.90	1996	1480	2.09	2196	1528	2.30	2381	1500	2.43	2459	1518	2.55	2679
1900	1396	1.80	1902	1460	2.03	2133	1517	2.25	2364	1566	2.47	2563	1550	2.59	2648	1562	2.71	2867
2000	1422	1.94	2038	1485	2.16	2270	1544	2.40	2522	1594	2.64	2734	1550	2.76	2811	1562	2.88	2905
2100	1452	2.08	2185	1510	2.31	2427	1570	2.55	2674	1620	2.80	2905	1550	2.91	2997	1562	3.03	3087
2200	1483	2.24	2354	1538	2.46	2585	1594	2.71	2821	1645	2.98	3087	1550	3.07	3076	1562	3.19	3266
2300	1515	2.41	2532	1571	2.64	2758	1623	2.88	2976	1675	3.17	3280	1550	3.25	3279	1562	3.37	3468
2400	1544	2.59	2721	1604	2.84	2947	1657	3.07	3152	1710	3.38	3497	1550	3.33	3496	1562	3.43	3685
2500	1574	2.78	2905	1633	3.03	3134	1692	3.28	3345	1746	3.61	3736	1550	3.48	3735	1562	3.58	3924

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1300 to 1685 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **[Grey Box]** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.9 and the maximum continuous watts are 2562. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

**PERFORMANCE DATA (cont)**  
**FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)**

580F072 (6 TONS) — STANDARD MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.1			0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	<b>885</b>	<b>0.63</b>	<b>623</b>	<b>942</b>	<b>0.73</b>	<b>700</b>	<b>1047</b>	<b>0.90</b>	<b>835</b>	<b>1139</b>	<b>1.05</b>	<b>956</b>	<b>1193</b>	<b>1.14</b>	<b>1031</b>	<b>1276</b>	<b>1.30</b>	<b>1165</b>
1900	<b>928</b>	<b>0.73</b>	<b>700</b>	<b>982</b>	<b>0.83</b>	<b>779</b>	<b>1084</b>	<b>1.02</b>	<b>932</b>	<b>1160</b>	<b>1.11</b>	<b>1006</b>	<b>1223</b>	<b>1.24</b>	<b>1114</b>	<b>1301</b>	<b>1.38</b>	<b>1233</b>
2000	<b>971</b>	<b>0.84</b>	<b>787</b>	<b>1022</b>	<b>0.94</b>	<b>867</b>	<b>1121</b>	<b>1.12</b>	<b>1014</b>	<b>1188</b>	<b>1.22</b>	<b>1097</b>	<b>1254</b>	<b>1.36</b>	<b>1216</b>	<b>1329</b>	<b>1.44</b>	<b>1284</b>
2100	<b>1015</b>	<b>0.97</b>	<b>891</b>	<b>1063</b>	<b>1.10</b>	<b>998</b>	<b>1140</b>	<b>1.18</b>	<b>1064</b>	<b>1196</b>	<b>1.27</b>	<b>1140</b>	<b>1272</b>	<b>1.45</b>	<b>1292</b>	<b>1354</b>	<b>1.58</b>	<b>1404</b>
2200	<b>1060</b>	<b>1.10</b>	<b>998</b>	1104	1.20	1081	1159	1.23	1106	1229	1.41	1258	1306	1.53	1361	1363	1.70	1508
2300	1104	1.25	1123	1130	1.27	1140	1196	1.37	1224	1264	1.56	1387	1340	1.66	1473	1397	1.86	1648
2400	1138	1.30	1165	1174	1.37	1224	1245	1.57	1396	1305	1.63	1447	1373	1.84	1630	1440	1.95	1726
2500	1183	1.43	1275	1201	1.50	1335	1284	1.65	1465	1338	1.75	1552	1402	1.99	1761	<b>1469</b>	<b>2.04</b>	<b>1805</b>
2600	1210	1.58	1404	1246	1.67	1482	1312	1.76	1560	1366	1.96	1735	1435	2.10	1858	<b>1494</b>	<b>2.19</b>	<b>1936</b>
2700	1254	1.76	1560	1285	1.80	1595	1354	1.95	1726	1403	2.14	1892	<b>1474</b>	<b>2.21</b>	<b>1954</b>	1536	2.46	2171
2800	1274	1.82	1613	1304	1.85	1639	1374	2.12	1875	1459	2.25	1989	<b>1514</b>	2.42	2136	1570	2.66	2343
2900	1318	1.95	1726	1345	2.05	1814	1412	2.32	2050	1496	2.54	2240	1529	2.61	2300	1603	2.87	2521
3000	1362	2.20	1945	1378	2.30	2032	1451	2.40	2119	1534	2.66	2343	1560	2.81	2470	1611	3.01	2648

580F072 (6 TONS) — STANDARD MOTOR (BELT DRIVE)* (cont)									
Airflow (Cfm)	External Static Pressure (in. wg)								
	1.2			1.4			1.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	1341	1.40	1250	1413	1.55	1378	<b>1474</b>	<b>1.58</b>	<b>1404</b>
1900	1374	1.53	1361	1437	1.62	1439	<b>1490</b>	<b>1.67</b>	<b>1482</b>
2000	1396	1.66	1473	1460	1.68	1491	<b>1509</b>	<b>1.77</b>	<b>1569</b>
2100	1413	1.75	1552	<b>1475</b>	<b>1.73</b>	<b>1534</b>	<b>1529</b>	<b>1.92</b>	<b>1700</b>
2200	1434	1.81	1604	<b>1487</b>	<b>1.85</b>	<b>1639</b>	<b>1554</b>	<b>2.07</b>	<b>1831</b>
2300	1459	1.88	1665	<b>1520</b>	<b>2.07</b>	<b>1831</b>	<b>1576</b>	<b>2.24</b>	<b>1980</b>
2400	<b>1502</b>	<b>2.06</b>	<b>1823</b>	<b>1552</b>	<b>2.24</b>	<b>1980</b>	<b>1604</b>	<b>2.42</b>	<b>2136</b>
2500	<b>1524</b>	<b>2.24</b>	<b>1980</b>	1585	2.42	2136	1638	2.60	2292
2600	<b>1552</b>	<b>2.40</b>	<b>2119</b>	1616	2.63	2317	1671	2.80	2462
2700	1584	2.61	2300	1646	2.83	2487	1706	2.97	2653
2800	1624	2.85	2504	1677	2.99	2661	—	—	—
2900	1671	3.03	2725	—	—	—	—	—	—
3000	—	—	—	—	—	—	—	—	—

**LEGEND**

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1070 to 1460 rpm. All other rpms require a field-supplied drive.

**NOTES:**

1. **Boldface** indicates field-supplied drive is required.
2.  indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.4 and maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F072 (6 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	942	0.73	700	1047	0.90	835	1139	1.05	956	1193	1.14	1031	1276	1.30	1165	1341	1.40	1250
1900	982	0.83	779	1084	1.02	932	1160	1.11	1006	1223	1.24	1114	1301	1.38	1233	1374	1.53	1361
2000	1022	0.94	867	1121	1.12	1014	1188	1.22	1097	1254	1.36	1216	1329	1.44	1284	1396	1.66	1473
2100	1063	1.10	998	1140	1.18	1064	1196	1.27	1140	1272	1.45	1292	1354	1.58	1404	1413	1.75	1552
2200	1104	1.20	1081	1159	1.23	1106	1229	1.41	1258	1306	1.53	1361	1363	1.70	1508	1434	1.81	1604
2300	1130	1.27	1140	1196	1.37	1224	1264	1.56	1387	1340	1.66	1473	1397	1.86	1648	1459	1.88	1665
2400	1174	1.37	1224	1245	1.57	1396	1305	1.63	1447	1373	1.84	1630	1440	1.95	1726	1502	2.06	1823
2500	1201	1.50	1335	1284	1.65	1465	1338	1.75	1552	1402	1.99	1761	1469	2.04	1805	1524	2.24	1980
2600	1246	1.67	1482	1312	1.76	1560	1366	1.96	1735	1435	2.10	1858	1494	2.19	1936	1552	2.40	2119
2700	1285	1.80	1595	1354	1.95	1726	1403	2.14	1892	1474	2.21	1954	1536	2.46	2171	1584	2.61	2300
2800	1304	1.85	1639	1374	2.12	1875	1459	2.25	1989	1514	2.42	2136	1570	2.66	2343	1624	2.85	2504
2900	1345	2.05	1814	1412	2.32	2050	1496	2.54	2240	1529	2.61	2300	1603	2.87	2521	1671	3.03	2725
3000	1378	2.30	2032	1451	2.40	2119	1534	2.66	2343	1560	2.81	2470	1611	3.01	2648	1692	3.49	3140

580F072 (6 TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.4			1.6			1.8			2.0			2.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
1800	1413	1.55	1378	1474	1.58	1404	1522	1.74	1564	1566	1.89	1704	—	—	—
1900	1437	1.62	1439	1490	1.67	1482	1538	1.84	1653	1583	2.00	1801	—	—	—
2000	1460	1.68	1491	1509	1.77	1569	1558	1.95	1752	1603	2.12	1909	—	—	—
2100	1475	1.73	1534	1529	1.92	1700	1578	2.11	1901	1624	2.30	2070	—	—	—
2200	1478	1.85	1639	1554	2.07	1831	1604	2.28	2049	1651	2.48	2232	—	—	—
2300	1520	2.07	1831	1576	2.24	1980	1627	2.46	2218	1674	2.68	2415	—	—	—
2400	1552	2.24	1980	1604	2.42	2136	1656	2.66	2396	1704	2.90	2609	—	—	—
2500	1585	2.42	2136	1638	2.60	2292	1691	2.86	2574	1740	3.12	2804	—	—	—
2600	1616	2.63	2317	1671	2.80	2462	1725	3.08	2772	1775	3.35	3019	—	—	—
2700	1646	2.83	2487	1706	2.97	2653	1761	3.27	2941	—	—	—	—	—	—
2800	1677	2.99	2661	1739	3.33	2998	1795	3.67	3299	—	—	—	—	—	—
2900	1742	3.43	3090	—	—	—	—	—	—	—	—	—	—	—	—
3000	1764	3.95	3558	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 1300 to 1685 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **■** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.9 and the maximum continuous watts are 2562. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

**PERFORMANCE DATA (cont)**  
**FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)**

580F090 (7½ TONS) — STANDARD MOTOR AND DRIVE AND ALTERNATE DRIVE (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			0.9			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	507	0.53	547	586	0.73	700	658	0.97	891	722	1.22	1097	752	1.34	1199	783	1.46	1301
2300	513	0.55	562	592	0.76	723	663	1.00	916	727	1.26	1131	756	1.38	1224	786	1.49	1327
2400	528	0.60	600	606	0.83	779	674	1.06	965	738	1.34	1199	766	1.46	1301	795	1.58	1404
2500	542	0.66	646	619	0.90	835	686	1.13	1022	748	1.41	1258	777	1.55	1370	806	1.68	1491
2550	550	0.69	669	627	0.94	867	692	1.17	1056	754	1.45	1292	783	1.60	1413	812	1.74	1543
2600	557	0.72	692	634	0.97	891	698	1.21	1089	759	1.49	1327	787	1.64	1456	816	1.79	1587
2700	573	0.79	747	648	1.05	956	711	1.29	1156	770	1.58	1404	798	1.73	1534	827	1.88	1665
2800	588	0.86	803	662	1.13	1022	723	1.38	1233	782	1.66	1473	809	1.82	1613	837	1.98	1753
2900	604	0.94	867	676	1.21	1089	737	1.48	1318	794	1.76	1560	821	1.92	1700	848	2.08	1840
3000	620	1.02	932	690	1.30	1165	750	1.58	1404	806	1.86	1648	832	2.02	1788	849	2.18	1927
3100	636	1.11	1006	704	1.39	1241	764	1.69	1499	818	1.97	1744	844	2.13	1884	870	2.29	2023
3200	652	1.21	1089	718	1.49	1327	778	1.80	1595	831	2.09	1849	856	2.25	1980	882	2.40	2119
3300	668	1.31	1173	732	1.59	1413	793	1.92	1700	844	2.21	1954	869	2.37	2093	894	2.53	2232
3400	684	1.41	1258	747	1.70	1508	807	2.04	1805	857	2.35	2076	882	2.51	2206	907	2.66	2343
3500	701	1.53	1361	762	1.82	1613	821	2.16	1910	871	2.48	2188	895	2.64	2326	919	2.80	2462
3600	717	1.65	1465	777	1.94	1718	835	2.29	2023	885	2.63	2317	908	2.79	2453	932	2.95	2587
3700	733	1.77	1569	792	2.07	1831	849	2.42	2136	899	2.78	2445	922	2.95	2579	945	3.11	2718
3750	742	1.84	1630	800	2.14	1892	856	2.49	2197	907	2.86	2512	929	3.03	2653	952	3.20	2719

580F090 (7½ TONS) — STANDARD MOTOR AND DRIVE AND ALTERNATE DRIVE (BELT DRIVE)* (cont)									
Airflow (Cfm)	External Static Pressure (in. wg)								
	1.2			1.4			1.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	843	1.81	1604	908	2.25	1989	955	2.59	2283
2300	846	1.84	1630	910	2.25	2015	959	2.61	2300
2400	853	1.88	1665	912	2.31	2041	967	2.68	2360
2500	859	1.94	1718	919	2.37	2093	971	2.73	2403
2550	864	1.99	1761	920	2.39	2110	974	2.76	2428
2600	868	2.04	1805	921	2.41	2136	976	2.78	2445
2700	878	2.16	1910	928	2.45	2162	983	2.88	2529
2800	889	2.29	2023	937	2.57	2266	986	2.91	2554
2900	900	2.41	2128	947	2.70	2377	993	3.01	2637
3000	910	2.52	2223	958	2.85	2504	1002	3.15	2751
3100	920	2.64	2326	968	2.99	2620	1012	3.30	2870
3200	931	2.76	2428	979	3.13	2735	1023	3.47	3002
3300	942	2.89	2537	989	3.26	2839	1034	3.63	3121
3400	954	3.02	2645	1000	3.40	2948	1044	3.79	3237
3500	966	3.15	2751	1011	3.55	3062	1054	3.94	3340
3600	978	3.30	2870	1022	3.69	3165	1065	4.10	3445
3700	990	3.45	2987	1034	3.84	3272	1076	4.26	3544
3750	997	3.54	3055	1040	3.93	3333	—	—	—

**LEGEND**

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Standard drive range is 590 to 840 rpm. Alternate drive range is 685 to 935 rpm. All other rpms require a field-supplied drive.

**NOTES:**

1. **Boldface** indicates field-supplied drive is required.
2. **■** indicates high-static motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.4 and maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F090 (7½ TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	507	0.53	547	586	0.73	700	658	0.97	891	722	1.22	1097	783	1.46	1301	843	1.81	1604
2300	513	0.55	562	592	0.76	723	663	1.00	916	727	1.26	1131	786	1.49	1327	846	1.84	1630
2400	528	0.60	600	606	0.83	779	674	1.06	965	738	1.34	1199	795	1.58	1404	853	1.88	1665
2500	542	0.66	646	619	0.90	835	686	1.13	1022	748	1.41	1258	806	1.68	1491	859	1.94	1718
2550	550	0.69	669	627	0.94	867	692	1.17	1056	754	1.45	1292	812	1.74	1543	864	1.99	1761
2600	557	0.72	692	634	0.97	891	698	1.21	1089	759	1.49	1327	816	1.79	1587	868	2.04	1805
2700	573	0.79	747	649	1.05	956	711	1.29	1156	770	1.58	1404	827	1.88	1665	878	2.16	1910
2800	588	0.86	803	662	1.13	1022	723	1.38	1233	782	1.66	1473	837	1.98	1753	889	2.29	2023
2900	604	0.94	867	676	1.21	1089	737	1.48	1318	794	1.76	1560	848	2.08	1840	900	2.41	2128
3000	620	1.02	932	690	1.30	1165	750	1.58	1404	806	1.86	1648	849	2.18	1927	910	2.52	2223
3100	636	1.11	1006	704	1.39	1241	764	1.69	1499	818	1.97	1744	870	2.29	2023	920	2.64	2326
3200	652	1.21	1089	718	1.49	1327	778	1.80	1595	831	2.09	1849	882	2.40	2119	931	2.76	2428
3300	668	1.31	1173	732	1.59	1413	793	1.92	1700	844	2.21	1954	894	2.53	2232	942	2.89	2537
3400	684	1.41	1258	747	1.70	1508	807	2.04	1805	857	2.35	2076	907	2.66	2343	954	3.02	2645
3500	701	1.53	1361	762	1.82	1613	821	2.16	1010	871	2.48	2188	919	2.80	2462	966	3.15	2751
3600	717	1.65	1465	777	1.94	1718	835	2.29	2023	885	2.63	2317	932	2.95	2587	978	3.30	2870
3700	733	1.77	1569	792	2.07	1831	849	2.42	2136	899	2.78	2445	945	3.11	2718	990	3.45	2987
3750	742	1.84	1630	800	2.14	1892	856	2.49	2197	907	2.86	2512	952	3.20	2719	997	3.54	3055

580F090 (7½ TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	1.4			1.6			1.8			2.0			2.4			2.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2250	908	2.25	1989	955	2.59	2283	991	2.89	2543	1023	3.19	2805	—	—	—	—	—	—
2300	910	2.25	2015	959	2.61	2300	995	2.91	2563	1028	3.21	2827	—	—	—	—	—	—
2400	912	2.31	2041	967	2.68	2360	1003	2.99	2631	1036	3.30	2902	—	—	—	—	—	—
2500	919	2.37	2093	971	2.73	2403	1007	3.05	2681	1041	3.36	2956	—	—	—	—	—	—
2550	920	2.39	2110	974	2.76	2428	1010	3.08	2710	1044	3.40	2989	—	—	—	—	—	—
2600	921	2.41	2136	976	2.78	2445	1012	3.10	2730	1046	3.42	3011	—	—	—	—	—	—
2700	928	2.45	2162	983	2.88	2529	1020	3.21	2828	1053	3.54	3119	—	—	—	—	—	—
2800	937	2.57	2266	986	2.91	2554	1023	3.25	2857	1057	3.58	3151	—	—	—	—	—	—
2900	947	2.70	2377	993	3.01	2637	1030	3.36	2955	1064	3.70	3260	—	—	—	—	—	—
3000	958	2.85	2504	1002	3.15	2751	1039	3.51	3093	1074	3.88	3411	—	—	—	—	—	—
3100	968	2.99	2620	1012	3.30	2870	1050	3.68	3240	1084	4.06	3574	—	—	—	—	—	—
3200	979	3.13	2735	1023	3.47	3002	1061	3.87	3407	—	—	—	—	—	—	—	—	—
3300	989	3.26	2839	1034	3.63	3121	1072	4.05	3564	—	—	—	—	—	—	—	—	—
3400	1000	3.40	2948	1044	3.79	3237	—	—	—	—	—	—	—	—	—	—	—	—
3500	1011	3.55	3062	1054	3.94	3340	—	—	—	—	—	—	—	—	—	—	—	—
3600	1022	3.69	3165	1065	4.10	3445	—	—	—	—	—	—	—	—	—	—	—	—
3700	1034	3.84	3272	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
3750	1040	3.93	3333	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 860 to 1080 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **Gray** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 3.7 and the maximum continuous watts are 3313. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

**PERFORMANCE DATA (cont)**  
**FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)**

580F102 (8½ TONS) — STANDARD MOTOR (BELT DRIVE)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			0.9			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	550	0.69	669	627	0.94	867	692	1.17	1056	754	1.45	1292	783	1.60	1413	812	1.74	1543
2600	557	0.72	692	634	0.97	891	698	1.21	1089	759	1.49	1327	787	1.64	1456	816	1.79	1587
2700	573	0.79	747	648	1.05	956	711	1.29	1156	770	1.58	1404	798	1.73	1534	827	1.88	1665
2800	588	0.86	803	662	1.13	1022	723	1.38	1233	782	1.66	1473	809	1.82	1613	837	1.98	1753
2900	604	0.94	867	676	1.21	1089	737	1.48	1318	794	1.76	1560	821	1.92	1700	848	2.08	1840
3000	620	1.02	932	690	1.30	1165	750	1.58	1404	806	1.86	1648	832	2.02	1788	849	2.18	1927
3100	636	1.11	1006	704	1.39	1241	764	1.69	1499	818	1.97	1744	844	2.13	1884	870	2.29	2023
3200	652	1.21	1089	718	1.49	1327	778	1.80	1595	831	2.09	1849	856	2.25	1980	882	2.40	2119
3300	668	1.31	1173	732	1.59	1413	793	1.92	1700	844	2.21	1954	869	2.37	2093	894	2.53	2232
3400	684	1.41	1258	747	1.70	1508	807	2.04	1805	857	2.35	2076	882	2.51	2206	907	2.66	2343
3500	701	1.53	1361	762	1.82	1613	821	2.16	1910	871	2.48	2188	895	2.64	2326	919	2.80	2462
3600	717	1.65	1465	777	1.94	1718	835	2.29	2023	885	2.63	2317	908	2.79	2453	932	2.95	2587
3700	733	1.77	1569	792	2.07	1831	849	2.42	2136	899	2.78	2445	922	2.95	2579	945	3.11	2718
3750	742	1.84	1630	800	2.14	1892	856	2.49	2197	907	2.86	2512	929	3.03	2653	952	3.20	2719
3800	750	1.90	1683	807	2.21	1954	863	2.56	2257	914	2.93	2571	936	3.11	2847	958	3.28	2854
3900	767	2.04	1805	822	2.35	2076	877	2.71	2386	928	3.09	2702	950	3.27	2979	972	3.45	2987
4000	783	2.18	1927	838	2.50	2206	891	2.86	2512	942	3.26	2839	964	3.45	3187	986	3.63	3121
4100	800	2.34	2067	854	2.66	2343	905	3.02	2645	956	2.43	2971	978	3.62	3244	1000	3.81	3251
4200	817	2.49	2197	869	2.82	2479	920	3.19	2783	970	3.60	3099	992	3.80	3258	1015	4.00	3380
4250	826	2.58	2275	877	2.91	2554	928	3.28	2854	977	3.69	3165	999	3.90	3306	1022	4.10	3445

580F102 (8½ TONS) — STANDARD MOTOR (BELT DRIVE)* (cont)									
Airflow (Cfm)	External Static Pressure (in.wg)								
	1.2			1.4			1.6		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	864	1.99	1761	920	2.39	2110	974	2.76	2428
2600	868	2.04	1805	921	2.41	2136	976	2.78	2445
2700	878	2.16	1910	928	2.45	2162	983	2.88	2529
2800	889	2.29	2023	937	2.57	2266	986	2.91	2554
2900	900	2.41	2128	947	2.70	2377	993	3.01	2637
3000	910	2.52	2223	958	2.85	2504	1002	3.15	2751
3100	920	2.64	2326	968	2.99	2620	1012	3.30	2870
3200	931	2.76	2428	979	3.13	2735	1023	3.47	3002
3300	942	2.89	2537	989	3.26	2839	1034	3.63	3121
3400	954	3.02	2645	1000	3.40	2948	1044	3.79	3237
3500	966	3.15	2751	1011	3.55	3062	1054	3.94	3340
3600	978	3.30	2870	1022	3.69	3165	1065	4.10	3445
3700	990	3.45	2987	1034	3.84	3272	1076	4.26	3544
3750	997	3.54	3055	1040	3.93	3333	1082	5.27	3609
3800	1003	3.62	3114	1045	4.01	3387	1087	4.43	3643
3900	1015	3.80	3244	1057	4.18	3495	1098	4.60	3733
4000	1028	3.99	3373	1070	4.36	3603	1110	4.78	3820
4100	1042	4.18	3495	1082	4.56	3713	1122	4.97	3902
4200	1055	4.38	3614	1095	4.76	3811	1134	5.16	3971
4250	1062	4.49	3676	1102	4.87	3860	—	—	—

**LEGEND**

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 685 to 935 rpm. All other rpms require a field-supplied drive.

**NOTES:**

1. **Boldface** indicates field-supplied drive is required.
2.  indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 2.4 and the maximum continuous watts are 2120. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F102 (8½ TONS) — HIGH-STATIC MOTOR (BELT DRIVE)*															
Airflow (Cfm)	External Static Pressure (in. wg)														
	0.2			0.4			0.6			0.8			1.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	550	0.69	669	627	0.94	867	692	1.17	1056	754	1.45	1292	812	1.74	1543
2600	557	0.72	692	634	0.97	891	698	1.21	1089	759	1.49	1327	816	1.79	1587
2700	573	0.79	747	648	1.05	956	711	1.29	1156	770	1.59	1404	827	1.88	1665
2800	688	0.86	803	662	1.13	1022	723	1.38	1233	782	1.68	1473	837	1.98	1753
2900	604	0.94	867	676	1.21	1089	737	1.48	1318	794	1.76	1560	848	2.08	1840
3000	620	1.02	932	690	1.30	1165	750	1.58	1404	806	1.86	1648	849	2.18	1927
3100	636	1.11	1006	704	1.39	1241	764	1.69	1499	818	1.97	1744	870	2.29	2023
3200	652	1.21	1089	718	1.49	1327	778	1.80	1595	831	2.09	1849	882	2.40	2119
3300	668	1.31	1173	732	1.59	1413	793	1.92	1700	844	2.21	1954	894	2.53	2232
3400	684	1.41	1258	747	1.70	1508	807	2.04	1805	857	2.35	2076	907	2.66	2343
3500	701	1.53	1361	762	1.82	1613	821	2.16	1910	871	2.48	2188	919	2.80	2462
3600	717	1.65	1465	777	1.94	1718	835	2.29	2023	885	2.36	2317	932	2.95	2587
3700	733	1.77	1569	792	2.07	1831	849	2.42	2136	899	2.78	2445	945	3.11	2718
3750	742	1.84	1630	800	2.14	1892	856	2.49	2197	907	2.86	2512	952	3.20	2719
3800	750	1.90	1683	807	2.21	1954	863	2.56	2257	914	2.93	2571	958	3.28	2854
3900	767	2.04	1805	822	2.35	2076	877	2.71	2386	928	3.09	2702	972	3.45	2987
4000	783	2.18	1927	838	2.50	2206	891	2.86	2512	942	3.26	2839	986	3.63	3121
4100	800	2.34	2067	854	2.66	2343	905	3.02	2645	956	3.43	2971	1000	3.81	3251
4200	817	2.49	2197	869	2.82	2479	920	3.19	2783	970	3.60	3099	1015	4.00	3380
4250	826	2.58	2275	877	2.91	2554	928	3.28	2854	977	3.69	3165	1022	4.10	3445

580F102 (8½ TONS) — HIGH-STATIC MOTOR (BELT DRIVE)* (cont)															
Airflow (Cfm)	External Static Pressure (in. wg)														
	1.2			1.4			1.6			1.8			2.0		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
2550	864	1.99	1761	920	2.39	2110	974	2.76	2428	1005	3.04	2672	1034	3.31	2910
2600	868	2.04	1805	921	2.41	2136	976	2.78	2445	1008	3.06	2691	1037	3.33	2931
2700	878	2.16	1910	928	2.45	2162	893	2.88	2529	1015	3.17	2788	1044	3.45	3036
2800	889	2.92	2023	937	2.57	2266	986	2.91	2554	1018	3.20	2817	1047	3.49	3068
2900	900	2.41	2128	947	2.70	2377	993	3.01	2637	1025	3.31	2914	1055	3.61	3174
3000	910	2.52	2223	958	2.85	2504	1002	3.15	2751	1034	3.47	3049	1064	3.77	3321
3100	920	2.64	2326	968	2.99	2620	1012	3.30	2870	1045	3.63	3195	1075	3.95	3479
3200	931	2.76	2428	979	3.13	2735	1023	3.47	3002	1056	3.82	3359	1087	4.16	3659
3300	942	2.89	2537	989	3.26	2839	1034	3.63	3121	1067	3.99	3514	—	—	—
3400	954	3.02	2645	1000	3.40	2948	1044	3.79	3237	1078	4.17	3669	—	—	—
3500	966	3.15	2751	1011	3.55	3062	1054	3.94	3340	—	—	—	—	—	—
3600	978	3.30	2870	1022	3.69	3165	1065	4.10	3445	—	—	—	—	—	—
3700	990	3.45	2987	1034	3.84	3272	—	—	—	—	—	—	—	—	—
3750	997	3.54	3055	1040	3.93	3333	—	—	—	—	—	—	—	—	—
3800	1003	3.62	3114	1045	4.01	3387	—	—	—	—	—	—	—	—	—
3900	1015	3.80	3244	1057	4.18	3495	—	—	—	—	—	—	—	—	—
4000	1028	3.99	3373	—	—	—	—	—	—	—	—	—	—	—	—
4100	1042	4.28	3495	—	—	—	—	—	—	—	—	—	—	—	—
4200	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4250	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Motor drive range is 860 to 1080 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **Gray** indicates field-supplied motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

4. Maximum continuous bhp is 3.7 and the maximum continuous watts are 3313. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.

5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.

6. Interpolation is permissible. Do not extrapolate.

**PERFORMANCE DATA (cont)**  
**FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)**

580F120 (10 TONS)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3000	552	0.68	661	632	0.87	810	701	1.05	956	761	1.22	1097	816	1.36	1216	871	1.54	1370
3100	565	0.74	708	644	0.93	859	711	1.12	1014	772	1.31	1173	825	1.45	1292	879	1.63	1447
3200	578	0.81	763	656	1.00	916	723	1.20	1081	782	1.39	1241	835	1.55	1378	887	1.71	1517
3300	591	0.88	818	668	1.08	973	734	1.28	1148	793	1.47	1310	845	1.65	1465	895	1.80	1595
3400	605	0.96	883	680	1.16	1047	745	1.36	1216	803	1.56	1387	856	1.75	1552	904	1.91	1691
3500	619	1.04	948	691	1.23	1106	755	1.44	1284	813	1.65	1465	867	1.86	1648	914	2.03	1796
3600	633	1.13	1022	703	1.31	1173	766	1.52	1353	824	1.74	1543	877	1.97	1744	924	2.15	1901
3700	648	1.23	1106	714	1.39	1241	777	1.61	1430	835	1.85	1639	887	2.07	1831	935	2.28	2015
3800	662	1.33	1190	726	1.51	1310	789	1.72	1526	846	1.95	1726	897	2.18	1927	946	2.40	2169
3900	677	1.44	1284	738	1.61	1387	801	1.82	1613	857	2.06	1823	908	2.29	2023	956	2.53	2282
4000	692	1.55	1378	750	1.73	1473	813	1.94	1718	868	2.17	1919	918	2.40	2119	967	2.66	2397
4100	707	1.67	1482	762	1.84	1560	825	2.05	1814	878	2.28	2015	929	2.53	2282	977	2.78	2505
4200	722	1.80	1595	775	1.97	1656	837	2.16	1910	889	2.40	2119	941	2.66	2397	987	2.91	2624
4300	737	1.94	1718	787	2.09	1761	848	2.27	2006	900	2.52	2273	952	2.80	2523	999	3.04	2744
4400	752	2.08	1840	800	2.21	1875	860	2.39	2110	912	2.66	2397	962	2.93	2642	1008	3.19	2885
4500	768	2.24	1980	814	2.35	1989	871	2.51	2265	924	2.80	2523	973	3.07	2772	1019	3.34	3029
4600	783	2.40	2119	827	2.50	2121	883	2.64	2380	937	2.95	2661	983	3.21	2904	—	—	—
4700	799	2.56	2309	841	2.64	2291	894	2.77	2496	949	3.10	2800	994	3.36	3049	—	—	—
4800	814	2.74	2469	855	2.80	2424	906	2.91	2624	961	3.26	2952	—	—	—	—	—	—
4900	—	—	—	868	2.90	2578	918	3.05	2754	972	3.40	3088	—	—	—	—	—	—
5000	—	—	—	883	3.10	2735	931	3.21	2904	—	—	—	—	—	—	—	—	—

580F120 (10 TONS)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	1.4			1.6			1.8			2.0			2.2			2.4		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3000	918	1.67	1482	967	1.89	1736	1010	2.09	1903	1063	2.46	2221	—	—	—	—	—	—
3100	928	1.78	1478	973	1.94	1778	1018	2.17	1971	1070	2.51	2265	—	—	—	—	—	—
3200	937	1.90	1745	981	2.04	1861	1026	2.26	2048	1075	2.57	2318	—	—	—	—	—	—
3300	946	2.00	1828	991	2.16	1963	1032	2.32	2099	1080	2.64	2380	—	—	—	—	—	—
3400	953	2.10	1912	1000	2.29	2074	1041	2.44	2203	1083	2.65	2389	—	—	—	—	—	—
3500	961	2.20	1997	1009	2.41	2177	1051	2.57	2318	1090	2.74	2469	—	—	—	—	—	—
3600	970	2.32	2099	1017	2.53	2282	1061	2.72	2451	1099	2.88	2596	—	—	—	—	—	—
3700	980	2.45	2212	1024	2.64	2380	1069	2.87	2587	1109	3.03	2735	—	—	—	—	—	—
3800	989	2.58	2326	1033	2.76	2487	1077	2.99	2698	1118	3.20	2895	—	—	—	—	—	—
3900	1000	2.73	2460	1042	2.91	2624	1085	3.12	2819	1127	3.36	3049	—	—	—	—	—	—
4000	1010	2.87	2587	1052	3.06	2763	1093	3.24	2933	—	—	—	—	—	—	—	—	—
4100	1021	3.02	2726	1062	3.22	2914	1102	3.41	3097	—	—	—	—	—	—	—	—	—
4200	1032	3.17	2866	1072	3.38	2971	—	—	—	—	—	—	—	—	—	—	—	—
4300	1042	3.32	3010	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4400	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4600	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4700	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4800	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
4900	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

**LEGEND**

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Standard motor drive range is 695 to 935 rpm. Alternate motor drive range is 835 to 1085 rpm. High-static motor drive range is 830 to 1130 rpm. All other rpms require a field-supplied drive.

**NOTES:**

1. **Boldface** indicates field-supplied drive is required.
2. **Gray** indicates optional high-static motor and drive are required.
3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.

4. Maximum continuous bhp is 2.4 for the standard motor, 2.9 for the alternate motor and 5.25 for the high-static motor. Maximum continuous watts are 2120 for the standard motor, 2615 for the alternate motor and 4400 for the high-static motor. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

580F150 (12 <sup>1</sup> / <sub>2</sub> TONS)*																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	0.2			0.4			0.6			0.8			1.0			1.2		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3750	684	1.24	1162	755	1.48	1353	816	1.70	1540	875	1.94	1738	933	2.23	1988	989	2.49	2219
3800	691	1.28	1194	761	1.52	1390	822	1.75	1582	880	1.98	1776	937	2.28	2035	993	2.55	2272
3900	705	1.37	1267	773	1.62	1473	834	1.86	1674	891	2.08	1862	947	2.39	2131	1002	2.66	2370
4000	720	1.47	1349	786	1.71	1548	847	1.97	1768	902	2.19	1957	957	2.50	2228	1011	2.79	2485
4100	734	1.56	1423	800	1.82	1641	860	2.09	1871	914	2.31	2061	967	2.60	2316	1021	2.91	2593
4200	749	1.66	1506	813	1.92	1725	873	2.21	1974	926	2.44	2175	978	2.71	2414	1030	3.04	2710
4300	764	1.77	1598	826	2.04	1828	886	2.33	2079	938	2.57	2290	989	2.83	2521	1040	3.18	2837
4400	779	1.88	1691	840	2.16	1931	899	2.46	2193	951	2.71	2414	1000	2.96	2638	1050	3.31	2955
4500	793	1.99	1785	854	2.28	2035	912	2.59	2307	963	2.86	2548	1012	3.09	2755	1061	3.43	3065
4600	808	2.11	1888	868	2.42	2158	925	2.73	2459	975	3.00	2674	1024	3.25	2901	1071	3.56	3184
4700	822	2.24	2000	882	2.56	2281	937	2.86	2548	988	3.16	2819	1036	3.42	3056	1082	3.70	3313
4800	837	2.37	2114	896	2.71	2414	950	3.00	2674	1001	3.32	2964	1048	3.59	3212	1093	3.86	3461
4900	852	2.51	2237	910	2.86	2548	963	3.15	2810	1014	3.48	3111	1060	3.76	3368	1105	4.02	3609
5000	867	2.65	2361	924	3.01	2683	977	3.30	2946	1027	3.65	3267	1073	3.94	3535	1117	4.20	3776
5100	882	2.79	2485	938	3.17	2828	990	3.46	3092	1040	3.82	3424	1085	4.12	3702	1129	4.40	3962
5200	896	2.95	2629	952	3.33	2973	1003	3.63	3248	1053	4.00	3590	1098	4.30	3869	1141	4.60	4148
5300	911	3.11	2773	967	3.50	3129	1017	3.80	3405	1066	4.18	3757	1111	4.50	4055	1153	4.80	4335
5400	926	3.27	2919	981	3.68	3294	1030	3.98	3572	1079	4.35	3916	1124	4.70	4270	1166	5.01	4531
5500	940	3.44	3074	995	3.86	3461	1044	4.17	3748	1092	4.54	4093	1137	4.91	4437	1178	5.22	4726
5600	955	3.62	3239	1010	4.04	3627	1058	4.38	3943	1105	4.73	4270	1150	5.12	4633	—	—	—
5700	970	3.80	3405	1024	4.23	3804	1072	4.59	4139	1118	4.93	4456	—	—	—	—	—	—
5800	985	3.99	3581	1039	4.42	3981	1086	4.80	4335	1131	5.14	4652	—	—	—	—	—	—
5900	1000	4.18	3757	1053	4.62	4167	1100	5.02	4540	—	—	—	—	—	—	—	—	—
6000	1015	4.39	3953	1068	4.83	4363	—	—	—	—	—	—	—	—	—	—	—	—
6100	1030	4.59	4139	1083	5.04	4558	—	—	—	—	—	—	—	—	—	—	—	—
6250	1062	5.02	4560	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

580F150 (12 <sup>1</sup> / <sub>2</sub> TONS)* (cont)																		
Airflow (Cfm)	External Static Pressure (in. wg)																	
	1.4			1.6			1.8			2.0			2.2			2.4		
	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts	Rpm	Bhp	Watts
3750	1041	2.75	2445	1086	2.98	2634	1122	3.16	2819	1146	3.28	2928	—	—	—	—	—	—
3800	1046	2.81	2503	1092	3.05	2719	1129	3.25	2901	1156	3.39	3028	—	—	—	—	—	—
3900	1055	2.94	2620	1102	3.20	2855	1143	3.42	3056	1174	3.59	3212	—	—	—	—	—	—
4000	1064	3.07	2737	1112	3.34	2983	1155	3.59	3212	1190	3.80	3405	—	—	—	—	—	—
4100	1072	3.20	2855	1121	3.49	3120	1165	3.76	3368	1203	3.99	3581	—	—	—	—	—	—
4200	1081	3.34	2983	1130	3.64	3258	1175	3.92	3516	1215	4.18	3757	—	—	—	—	—	—
4300	1090	3.48	3111	1139	3.79	3396	1185	4.08	3664	1226	4.36	3925	—	—	—	—	—	—
4400	1100	3.63	3248	1148	3.94	3535	1194	4.25	3822	1236	4.54	4093	—	—	—	—	—	—
4500	1109	3.78	3387	1157	4.09	3674	1203	4.42	3981	1246	4.72	4260	—	—	—	—	—	—
4600	1119	3.93	3525	1166	4.26	3832	1212	4.58	4130	1255	4.91	4437	—	—	—	—	—	—
4700	1129	4.09	3674	1175	4.43	3990	1221	4.76	4298	1264	5.09	4605	—	—	—	—	—	—
4800	1139	4.24	3813	1185	4.60	4148	1230	4.93	4456	—	—	—	—	—	—	—	—	—
4900	1150	4.38	3943	1194	4.77	4307	1239	5.12	4633	—	—	—	—	—	—	—	—	—
5000	1161	4.54	4093	1204	4.95	4475	—	—	—	—	—	—	—	—	—	—	—	—
5100	1172	4.71	4251	1214	5.13	4642	—	—	—	—	—	—	—	—	—	—	—	—
5200	1183	4.91	4419	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5300	1194	5.08	4596	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5400	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5600	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5700	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5800	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5900	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6100	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6250	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

#### LEGEND

**Bhp** — Brake Horsepower Input to Fan  
**FIOP** — Factory-Installed Option  
**Watts** — Input Watts to Motor

\*Standard motor drive range is 860 to 1080 rpm. Alternate motor drive range is 900 to 1260 rpm. All other rpms require a field-supplied drive.

#### NOTES:

1. **Boldface** indicates field-supplied drive is required.
2. **Gray Box** indicates alternate motor and drive are required.

3. Values include losses for filters, unit casing, and wet coils. See page 47 for accessory/FIOP static pressure information.
4. Maximum continuous bhp is 3.7 for the standard motor, and 5.25 for the alternate motor. The maximum continuous watts are 3313 for the standard motor and 4400 for the alternate motor. Extensive motor and electrical testing on these units ensures that the full range of the motor can be utilized with confidence. Using your fan motors up to the wattage ratings shown will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected. See Evaporator-Fan Motor Performance table on page 50 for additional information.
5. Use of a field-supplied motor may affect wire sizing. Contact your Bryant representative for details.
6. Interpolation is permissible. Do not extrapolate.

## PERFORMANCE DATA (cont)

### AIR QUANTITY LIMITS

UNIT 580F	MINIMUM CFM	MAXIMUM CFM
036	900	1500
048	1200	2000
060	1500	2500
072	1800	3000
090	2250	3750
102	2550	4250
120	3000	5000
150	3750	6250

### SOUND POWER (Total Unit)

UNIT 580F	SOUND RATING 60 Hz	A-WEIGHTED (dB)	OCTAVE BANDS							
			63	125	250	500	1000	2000	4000	8000
036-072	81 dB	80.5	56.8	75.8	72.4	72.9	74.8	75.4	71.3	69.1
090,102	87 dB	86.4	83.2	87.4	83.5	82.8	83.0	77.7	71.8	67.0
120	88 dB	87.6	97.6	90.4	85.7	84.8	83.9	77.5	71.3	65.8
150	87 dB	86.4	83.7	87.2	83.4	82.8	83.0	77.7	71.8	67.0

### ACCESSORY/FIOP STATIC PRESSURE\* (in.wg) — 580F036-072

COMPONENT	CFM									
	900	1200	1400	1600	1800	2000	2200	2400	2600	3000
Durablaide Economizer	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05
EconoMi\$er	0.05	0.09	0.13	0.17	0.22	0.27	0.32	0.39	0.45	0.53

#### LEGEND

**FIOP** — Factory-Installed Option

\*The static pressure must be added to external static pressure. The sum and the evaporator entering-air cfm should then be used in conjunction with the Fan Performance tables to determine blower rpm and watts.

### ACCESSORY/FIOP STATIC PRESSURE\* (in.wg) — 580F090-150

COMPONENT	CFM									
	2200	2500	3000	3500	4000	4500	5000	5500	6000	6250
Durablaide Economizer	0.02	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.09	0.09
EconoMi\$er	0.07	0.09	0.13	0.18	0.23	0.30	0.36	—	—	—

#### LEGEND

**FIOP** — Factory-Installed Option

\*The static pressure must be added to external static pressure. The sum and the evaporator entering-air cfm should then be used in conjunction with the Fan Performance tables to determine blower rpm and watts.

**PERFORMANCE DATA (cont)**  
**FAN RPM AT MOTOR PULLEY SETTINGS\***

UNIT 580F	MOTOR PULLEY TURNS OPEN												
	0	1 $\frac{1}{2}$	1	1 $\frac{1}{2}$	2	2 $\frac{1}{2}$	3	3 $\frac{1}{2}$	4	4 $\frac{1}{2}$	5	5 $\frac{1}{2}$	6
036†	1000	976	952	928	904	880	856	832	808	784	760	—	—
036**	1455	1423	1392	1360	1328	1297	1265	1233	1202	1170	1138	1107	1075
048†	1185	1150	1115	1080	1045	1010	975	940	905	870	835	—	—
048**	1455	1423	1392	1360	1328	1297	1265	1233	1202	1170	1138	1107	1075
060†	1300	1260	1220	1180	1140	1100	1060	1020	980	940	900	—	—
060**	1685	1589	1557	1525	1493	1460	1428	1396	1364	1332	1300	—	—
072††	1460	1420	1380	1345	1305	1265	1225	1185	1150	1110	1070	—	—
072**	1685	1589	1557	1525	1493	1460	1428	1396	1364	1332	1300	—	—
090††	840	815	790	765	740	715	690	665	635	615	590	—	—
090 II	935	910	885	860	835	810	785	760	735	710	685	—	—
090**	1080	1025	1007	988	970	952	933	915	897	878	860	—	—
102††	935	910	885	860	835	810	785	760	735	710	685	—	—
102**	1080	1025	1007	988	970	952	933	915	897	878	860	—	—
120††	935	910	885	860	835	810	785	760	735	710	685	—	—
120†	1085	1060	1035	1010	985	960	935	910	885	860	835	—	—
120**	1130	1112	1087	1062	1037	1012	987	962	937	912	887	862	830
150††	1080	1060	1035	1015	990	970	950	925	905	880	860	—	—
150†	1260	1220	1185	1155	1130	1100	1075	1045	1015	990	960	930	900

\*Approximate fan rpm shown.

†Indicates alternate motor and drive package.

\*\*Indicates high-static motor and drive package.

††Indicates standard motor and drive package.

II Indicates alternate drive package only.

**ALTITUDE COMPENSATION\* —**  
**580F036-072**

ELEVATION (ft)	72,000 AND 115,000/ 60,000 AND 90,000 BTUH NOMINAL INPUT		150,000/120,000 BTUH NOMINAL INPUT	
	Natural Gas Orifice Size†	Liquid Propane Orifice Size†	Natural Gas Orifice Size†	Liquid Propane Orifice Size†
0-2,000	33/38	43/45	30/32	38/42
2,000	34/39	43/46	30/33	39/42
3,000	35/40	44/47	31/34	40/43
4,000	36/41	44/47	32/35	41/43
5,000	36/41	44/48	33/35	42/43
6,000	37/42	45/48	34/36	43/44
7,000	37/42	45/48	35/37	43/44
8,000	38/43	46/49	36/37	44/45
9,000	39/43	47/50	37/38	44/46
10,000	41/44	48/50	38/40	45/47
11,000	43/45	48/51	39/41	45/48
12,000	44/45	49/51	40/42	46/49
13,000	44/46	49/52	41/43	47/49
14,000	45/47	50/52	42/43	47/50

\*As the height above sea level increases, there is less oxygen per cubic foot of air. Therefore, heat input rate should be reduced at higher altitudes.

†Orifices available through your local distributor.


**ALTITUDE COMPENSATION\* —**  
**580F090-150**

ELEVATION (ft)	125,000,180,000, AND 224,000 BTUH NOMINAL INPUT		250,000 BTUH NOMINAL INPUT	
	Natural Gas Orifice Size†	Liquid Propane Orifice Size†	Natural Gas Orifice Size†	Liquid Propane Orifice Size†
0-2,000	31	41	30	38
2,000	32	42	30	39
3,000	32	42	31	40
4,000	32	42	32	41
5,000	33	43	33	42
6,000	34	43	34	43
7,000	35	44	35	43
8,000	36	44	36	44
9,000	37	45	37	44
10,000	38	46	38	45
11,000	39	47	39	45
12,000	40	47	40	46
13,000	41	48	41	47
14,000	42	48	42	47


\*As the height above sea level increases, there is less oxygen per cubic foot of air. Therefore, heat input rate should be reduced at higher altitudes.

†Orifices available through your local distributor.


## PERFORMANCE DATA (cont)

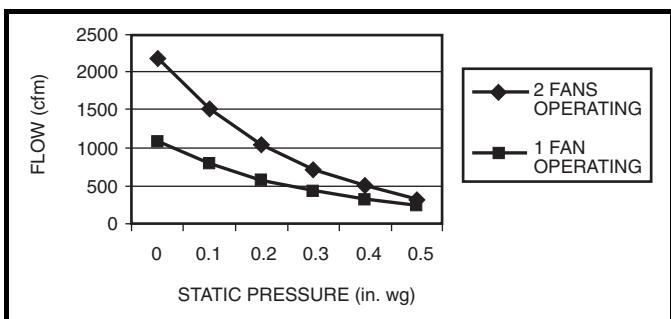


EconoMi\$er Power Exhaust  
Performance (580F036-072)

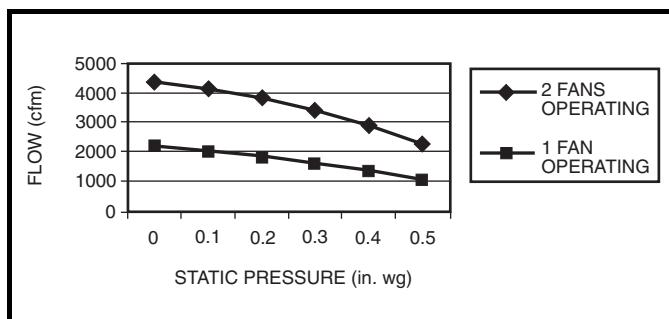


EconoMi\$er Power Exhaust  
Performance (580F090-150)

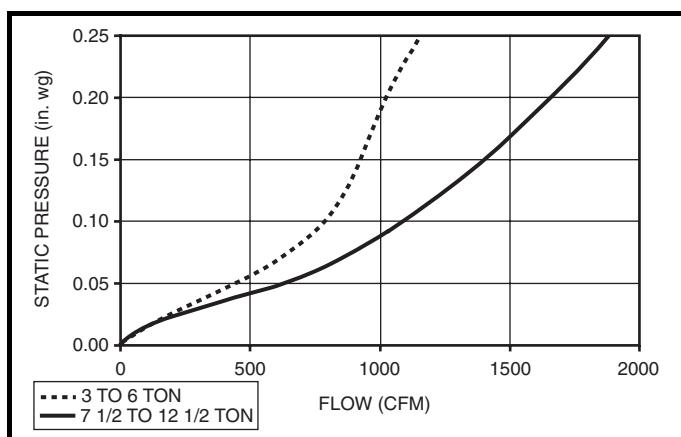


EconoMi\$er Barometric Flow

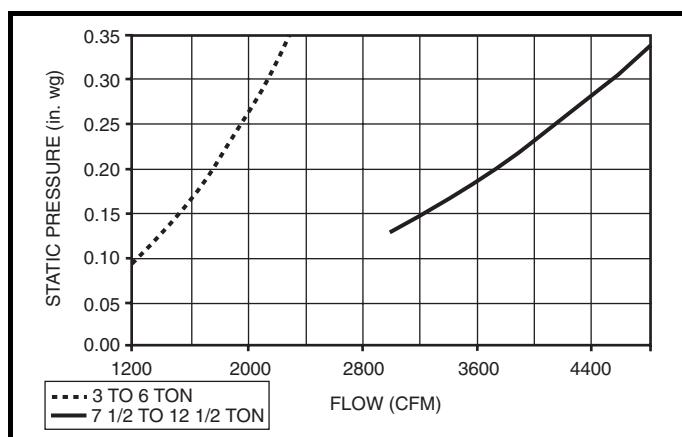

EconoMi\$er Return Air Pressure Drop

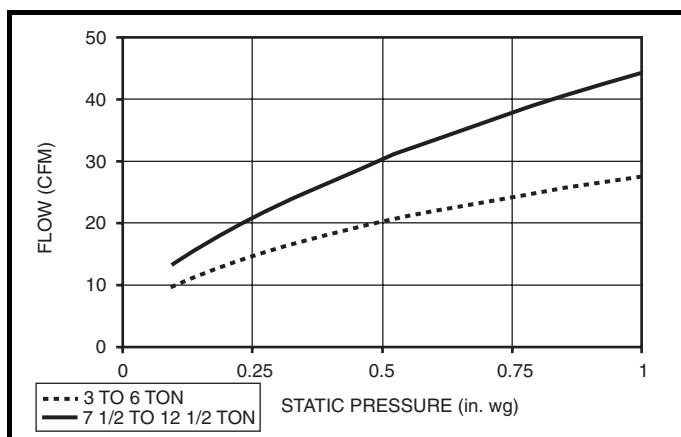

EconoMi\$er Outdoor Air Leakage

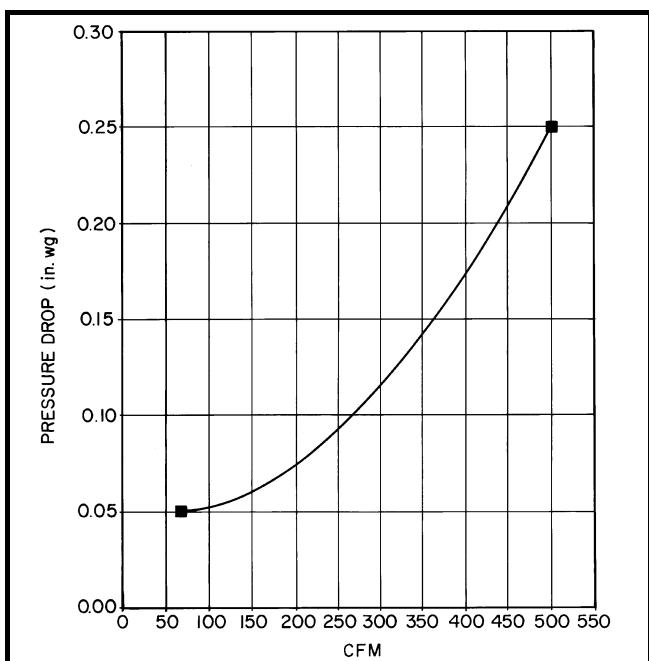

Durablade Economizer Barometric  
Relief Damper Characteristic —  
580F036-150

## PERFORMANCE DATA (cont)

### EVAPORATOR-FAN MOTOR EFFICIENCY

UNIT 580F	MOTOR EFFICIENCY (%)
036,048	75
060	74/84*
072	84
090-120	80
150	87

\*Single phase/three-phase.

NOTE: All indoor-fan motors 5 hp and larger meet the minimum efficiency requirements as established by the Energy Policy Act of 1992 (EPACT) effective October 24, 1997.

### ALTITUDE DERATING FACTOR\*

ELEVATION (ft)	MAXIMUM HEATING VALUE (Btu/ft <sup>3</sup> )
0-2,000	1,100
2,001-3,000	1,050
3,001-4,000	1,000
4,001-5,000	950
5,001-6,000	900

\*Derating of the unit is not required unless the heating value of the gas exceeds the values listed in the table above, or if the elevation exceeds 6000 ft. Derating conditions must be 4% per thousand ft above sea level. For example, at 4000 ft, if the heating value of the gas exceeds 1000 Btu/ft<sup>3</sup>, the unit will require a 16% derating. For elevations above 6000 ft, the same formula applies. For example, at 7000 ft, the unit will require a 28% derating of the maximum heating value per the National Fuel Gas Code.

### EVAPORATOR-FAN MOTOR PERFORMANCE

UNIT 580F	EVAPORATOR-FAN MOTOR	UNIT VOLTAGE	MAXIMUM ACCEPTABLE CONTINUOUS BHP*	MAXIMUM ACCEPTABLE OPERATING WATTS	MAXIMUM AMP DRAW
036	Standard	208/230	0.34	440	2.8
		460			1.3
		575			1.3
	Alternate	208/230	1.00	1000	4.9
		460			2.1
		575			2.1
	High Static	208/230	2.40	2120	6.0
		460			3.0
		575			3.0
		208/230			6.0
		460			3.0
		575			3.0
048	Standard	208/230	0.75	850	3.5
		460			1.8
		575			1.8
	Alternate	208/230	1.00	1000	4.9
		460			2.1
		575			2.1
	High Static	208/230	2.40	2120	6.0
		460			3.0
		575			3.0
		208/230			6.0
		460			3.0
		575			3.0
060	Standard	208/230	1.20	1340	5.9
		460			3.2
		575			3.2
	Alternate	208/230	1.30/2.40†	2120	10.1/6.7†
		460			3.0
		575			3.0
	High Static	208/230	2.90	2562	8.6
		460			3.9
		575			3.9
		208/230			6.7
		460			3.0
		575			3.0
072	Standard	208/230	2.40	2120	6.7
		460			3.0
		575			3.0
	High Static	208/230	2.90	2562	8.6
		460			3.9
		575			3.9
	Standard, Alternate	208/230	2.40	2120	6.7
		460			3.0
		575			3.0
		208/230			12.2
		460			5.5
		575			5.5
090	Standard, Alternate	208/230	2.40	2120	6.7
		460			3.0
		575			3.0
	High Static	208/230	3.70	3313	12.2
		460			5.5
		575			5.5
	Standard	208/230	2.40	2120	6.7
		460			3.0
		575			3.0
		208/230			12.2
		460			5.5
		575			5.5
102	Standard	208/230	2.40	2120	6.7
		460			3.0
		575			3.0
	High Static	208/230	3.70	3313	12.2
		460			5.5
		575			5.5
	Standard	208/230	2.40	2120	6.7
		460			3.0
		575			3.0
		208/230			12.2
		460			5.5
		575			5.5
120	Standard	208/230	2.40	2120	6.7
		460			3.0
		575			3.0
	Alternate	208/230	2.90	2615	8.6
		460			3.9
		575			3.9
	High Static	208/230	5.25	4400	17.3
		460			8.5
		575			8.5
		208/230			17.3
		460			8.5
		575			8.5
150	Standard	208/230	3.70	3313	12.2
		460			5.5
		575			5.5
	Alternate	208/230	5.25	4400	17.3
		460			8.5
		575			8.5

#### LEGEND

BHP — Brake Horsepower

\*Extensive motor and electrical testing on these units ensures that the full horsepower range of the motors can be utilized with confidence. Using your fan motors up to the horsepower ratings shown in this table will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected.

†Single phase/three-phase.

#### NOTES:

- All indoor-fan motors 5 hp and larger meet the minimum efficiency requirements as established by the Energy Policy Act of 1992 (EPACT) effective October 24, 1997.
- High-static motor not available on single-phase units.

**ELECTRICAL DATA (Without Convenience Outlet)**

UNIT 580F	NOMINAL VOLTAGE	IFM TYPE	VOLTAGE RANGE		COMPR (ea)		OFM (ea)		IFM	COMBUSTION FAN MOTOR FLA	POWER SUPPLY		DISCONNECT SIZE*	
			Min	Max	RLA	LRA	Hp	FLA			MCA	MOCPT†	FLA	LRA
036 (3 Tons)	208/230-1-60	Std	187	254	16.2	96.0	1/4	1.4	3.5	.6	25.2/25.2	30/30	24/24	106/106
		Alt							4.9		26.6/26.6	35/35	26/26	111/111
	208/230-3-60	Std	187	254	10.2	75.0	1/4	1.4	3.5	.6	17.7/17.7	25/25	17/17	85/85
		Alt							4.9		19.1/19.1	25/25	19/19	90/90
		High							5.2		19.4/19.4	25/25	19/19	109/109
	460-3-60	Std	414	508	4.4	40.0	1/4	0.8	1.3	.3	7.6	15	7	44/44
		Alt							2.1		8.4	15	8	48/48
		High							2.6		8.9	15	9	57/57
	575-3-60	Std	518	632	3.7	31.0	1/4	0.8	1.3	.3	6.7	15	7	35
		Alt							2.1		7.5	15	8	39
		High							2.6		8.0	15	8	63
048 (4 Tons)	208/230-1-60	Std	187	254	23.3	118.0	1/4	1.4	3.5	.6	34.0/34.0	40/40	32/32	129/129
		Alt							4.9		35.4/35.4	45/45	34/34	133/133
	208/230-3-60	Std	187	254	15.4	90.0	1/4	1.4	3.5	.6	24.2/24.2	30/30	23/23	101/101
		Alt							4.9		25.6/25.6	30/30	25/25	105/105
		High							5.2		25.9/25.9	30/30	25/25	124/124
	460-3-60	Std	414	508	8.3	45.0	1/4	0.8	1.8	.3	13.0	20	13	51
		Alt							2.1		13.3	20	13	53
		High							2.6		13.8	20	13	62
	575-3-60	Std	518	632	6.4	36.0	1/4	0.8	1.8	.3	10.6	15	10	42
		Alt							2.1		10.9	15	11	44
		High							2.6		11.4	15	11	53
060 (5 Tons)	208/230-1-60	Std	187	254	28.8	147.0	1/4	1.4	5.9	.6	43.3/43.3	60/60	42/42	161/161
		Alt							6.6		44.0/44.0	60/60	42/42	184/184
	208/230-3-60	Std	187	254	16.3	114.0	1/4	1.4	5.9	.6	27.3/27.3	35/35	27/27	128/128
		Alt							5.2		26.6/26.6	35/35	26/26	148/148
		High							7.5		28.9/28.9	35/35	29/29	174/174
	460-3-60	Std	414	508	7.4	64.0	1/4	0.8	3.1	.3	13.2	20	13	72
		Alt							2.6		12.7	15	12	81
		High							3.4		13.5	20	13	93
	575-3-60	Std	518	632	6.2	62.0	1/4	0.8	3.1	.3	11.7	15	12	59
		Alt							3.0		11.2	15	11	69
		High							3.4		12.0	15	12	81
072 (6 Tons)	208/230-3-60	Std	187	254	23.6	146.0	1/4	1.4	5.2	.6	32.4/32.4	40/40	31/31	180/180
		High							7.5		34.7/34.7	40/40	32/32	205/205
	460-3-60	Std	414	508	10.6	73.0	1/4	0.6	2.6	.3	15.4	20	15	90
		High							3.4		16.2	20	16	103
	575-3-60	Std	518	632	8.5	58.4	1/4	0.6	2.6	.3	13.0	15	13	75
		High							3.4		13.8	20	14	88
090 (7½ Tons)	208/230-3-60	Std	187	254	14.0	91.0	1/4	1.4	5.8	.6	40.1/40.1	45/45	42/42	229/229
		Alt							5.8		40.1/40.1	45/45	42/42	229/229
		High							10.6		44.9/44.9	50/50	48/48	273/273
	460-3-60	Std	414	508	6.4	42.0	1/4	0.7	2.6	.3	18.4	25	19	107
		Alt							2.6		18.4	25	19	107
		High							4.8		20.6	25	22	129
	575-3-60	Std	518	632	5.2	39.0	1/4	0.7	2.6	.3	14.9	20	16	97
		Alt							2.6		14.9	20	16	97
		High							4.8		16.7	20	18	114
102 (8½ Tons)	208/230-3-60	Std	187	254	16.0	137.0	1/4	1.4	5.8	.6	44.6/44.6	50/50	47/47	321/321
		High							10.6		49.4/49.4	60/60	52/52	365/365
	460-3-60	Std	414	508	8.3	69.0	1/4	0.7	2.6	.3	22.7	25	24	161
		High							4.8		24.9	30	26	138
	575-3-60	Std	518	632	6.4	58.0	1/4	0.7	2.6	.3	17.6	20	18	135
		High							4.8		19.4	25	20	152

See Legend and Notes on page 52.

## ELECTRICAL DATA (Without Convenience Outlet) (cont)

UNIT 580F	NOMINAL VOLTAGE	IFM TYPE	VOLTAGE RANGE		COMPR (ea)		OFM (ea)		IFM	COMBUSTION FAN MOTOR FLA	POWER SUPPLY		DISCONNECT SIZE*	
			Min	Max	RLA	LRA	Hp	FLA			MCA	MOCPT†	FLA	LRA
120 (10 Tons)	208/230-3-60	Std	187	254	15.8	130.0	1/4	1.4	5.8	.6	43.1/43.1	50/50	45/45	307/307
		Alt							7.5		44.8/44.8	50/50	47/47	326/326
		High							15.0		52.3/52.3	60/60	56/56	374/374
	460-3-60	Std	414	508	7.9	64.0	1/4	0.7	2.6	.3	21.0	25	22	151
		Alt							3.4		21.8	25	23	191
		High							7.4		25.8	30	27	185
	575-3-60	Std	518	632	6.6	52.0	1/4	0.7	2.6	.3	17.9	20	19	107
		Alt							3.4		18.5	25	19	138
		High							7.4		21.7	25	23	133
150 (12½ Tons)	208/230-3-60	Std	187	254	23.0	146.0	1/4	1.4	10.6	.6	65.2/65.2	80/80**	68/68	383/383
		Alt							15.0		69.6/69.6	80/80**	73/73	406/406
	460-3-60	Std	414	508	10.4	73.0	1/4	0.7	4.8	.3	29.6	40	31	192
		Alt							7.4		32.2	45	34	203
	575-3-60	Std	518	632	8.3	58.4	1/4	0.7	4.8	.3	23.6	30	25	153
		Alt							7.4		25.7	30	27	162

### LEGEND

**FLA** — Full Load Amps  
**HACR**— Heating, Air Conditioning and Refrigeration  
**IFM** — Indoor (Evaporator) Fan Motor  
**LRA** — Locked Rotor Amps  
**MCA** — Minimum Circuit Amps  
**MOCPT**— Maximum Overcurrent Protection  
**NEC** — National Electrical Code  
**OFM** — Outdoor (Condenser) Fan Motor  
**RLA** — Rated Load Amps

\*Used to determine minimum disconnect per NEC.

†Fuse or HACR circuit breaker

\*\*Fuse only.



### NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.


### 2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percent of voltage imbalance.

% Voltage Imbalance

$$= 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 460-3-60.



$$\begin{aligned} AB &= 452 \text{ v} \\ BC &= 464 \text{ v} \\ AC &= 455 \text{ v} \\ \text{Average Voltage} &= \frac{452 + 464 + 455}{3} \\ &= \frac{1371}{3} \\ &= 457 \end{aligned}$$

Determine maximum deviation from average voltage.

$$(AB) 457 - 452 = 5 \text{ v}$$

$$(BC) 464 - 457 = 7 \text{ v}$$

$$(AC) 457 - 455 = 2 \text{ v}$$

Maximum deviation is 7 v.

Determine percent of voltage imbalance.

$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{7}{457} \\ &= 1.53\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

**IMPORTANT:** If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

**ELECTRICAL DATA (With Convenience Outlet)**

UNIT 580F	NOMINAL VOLTAGE	IFM TYPE	VOLTAGE RANGE		COMPR (ea)		OFM (ea)		IFM	COMBUSTION FAN MOTOR FLA	POWER SUPPLY		DISCONNECT SIZE*	
			Min	Max	RLA	LRA	Hp	FLA			MCA	MOCPT†	FLA	LRA
036 (3 Tons)	208/230-1-60	Std	187	254	16.2	96.0	1/4	1.4	3.5	.6	31.2/31.2	35/35	30/30	111/111
		Alt							4.9		32.6/32.6	40/35	31/31	116/116
	208/230-3-60	Std	187	254	10.2	75.0	1/4	1.4	3.5	.6	22.5/22.5	30/25	23/23	90/ 90
		Alt							4.9		23.9/23.9	30/30	25/25	95/ 95
		High							5.2		24.2/24.2	30/30	25/25	114/114
	460-3-60	Std	414	508	4.4	40.0	1/4	0.8	1.3	.3	9.8	15	10	47
		Alt							2.1		10.6	15	11	50
		High							2.6		11.1	15	11	59
	575-3-60	Std	518	632	3.7	31.0	1/4	0.8	1.3	.3	8.5	15	9	37
		Alt							2.1		9.3	15	10	40
		High							2.6		9.8	15	10	65
048 (4 Tons)	208/230-1-60	Std	187	254	23.3	118.0	1/4	1.4	3.5	.6	40.0/40.0	45/45	38/38	134/134
		Alt							4.9		41.4/41.4	50/50	40/40	138/138
	208/230-3-60	Std	187	254	15.4	90.0	1/4	1.4	3.5	.6	29.0/29.0	35/35	29/29	106/106
		Alt							4.9		30.4/30.4	35/35	30/30	110/110
		High							5.2		30.7/30.7	35/35	31/31	129/129
	460-3-60	Std	414	508	8.3	45.0	1/4	0.8	1.8	.3	15.2	20	15	53
		Alt							2.1		15.5	20	15	55
		High							2.6		16.0	20	16	64
	575-3-60	Std	518	632	6.4	36.0	1/4	0.8	1.8	.3	12.3	15	12	43
		Alt							2.1		12.6	15	13	45
		High							2.6		13.1	15	13	54
060 (5 Tons)	208/230-1-60	Std	187	254	28.8	147.0	1/4	1.4	5.9	.6	49.3/49.3	60/60	47/47	166/166
		Alt							6.6		50.0/50.0	60/60	48/48	188/188
	208/230-3-60	Std	187	254	16.3	114.0	1/4	1.4	5.9	.6	32.1/32.1	40/40	32/32	133/133
		Alt							5.2		31.4/31/4	40/35	32/32	153/153
		High							7.5		28.9/28.9	35/35	29/29	174/174
	460-3-60	Std	414	508	7.4	64.0	1/4	0.8	3.1	.3	15.3	20	15	74
		Alt							2.6		14.8	20	15	83
		High							3.4		15.6	20	16	96
	575-3-60	Std	518	632	6.2	62.0	1/4	0.8	3.1	.3	13.4	15	14	61
		Alt							3.0		12.9	15	13	70
		High							3.4		13.7	20	14	83
072 (6 Tons)	208/230-3-60	Std	187	254	23.6	146.0	1/4	1.4	5.2	.6	37.2/37.2	45/45	37/37	184/184
		High							7.5		39.5/39.5	45/45	39/39	210/210
	460-3-60	Std	414	508	10.6	73.0	1/4	0.6	2.6	.3	17.6	20	17	92
		High							3.4		18.4	25	18	105
	575-3-60	Std	518	632	8.5	58.4	1/4	0.6	2.6	.3	14.7	20	15	77
		High							3.4		15.5	20	16	90
090 (7½ Tons)	208/230-3-60	Std	187	254	14.0	91.0	1/4	1.4	5.8	.6	46.1/46.1	50/50	48/48	233/233
		Alt							5.8		46.1/46.1	50/50	48/48	233/233
		High							10.6		50.9/50.9	60/60	53/53	277/277
	460-3-60	Std	414	508	6.4	42.0	1/4	0.7	2.6	.3	21.1	25	22	110
		Alt							2.6		21.1	25	22	110
		High							4.8		23.3	25	24	132
	575-3-60	Std	518	632	5.2	39.0	1/4	0.7	2.6	.3	17.6	20	18	99
		Alt							2.6		17.6	20	18	99
		High							4.8		19.4	25	20	117
102 (8½ Tons)	208/230-3-60	Std	187	254	16.0	137.0	1/4	1.4	5.8	.6	50.6/50.6	60/60	52/52	325/325
		High							10.6		55.4/55.4	60/60	58/58	369/369
	460-3-60	Std	414	508	8.3	69.0	1/4	0.7	2.6	.3	25.4	30	26	164
		High							4.8		27.6	30	29	138
	575-3-60	Std	518	632	6.4	58.0	1/4	0.7	2.6	.3	20.3	25	20	137
		High							4.8		22.1	25	22	155

See Legend and Notes on page 54.

## ELECTRICAL DATA (With Convenience Outlet) (cont)

UNIT 580F	NOMINAL VOLTAGE	IFM TYPE	VOLTAGE RANGE		COMPR (ea)		OFM (ea)		IFM	COMBUSTION FAN MOTOR FLA	POWER SUPPLY		DISCONNECT SIZE*	
			Min	Max	RLA	LRA	Hp	FLA			MCA	MOCPT†	FLA	LRA
120 (10 Tons)	208/230-3-60	Std	187	254	15.8	130.0	1/4	1.4	5.8	.6	49.1/49.1	60/60	50/50	311/311
		Alt							7.5		50.8/50.8	60/60	52/52	330/330
		High							15.0		58.3/58.3	70/70	61/61	378/378
	460-3-60	Std	414	508	7.9	64.0	1/4	0.7	2.6	.3	23.7	30	24	154
		Alt							3.4		24.5	30	25	193
		High							7.4		28.5	30	30	187
	575-3-60	Std	518	632	6.6	52.0	1/4	0.7	2.6	.3	20.6	25	21	109
		Alt							3.4		21.2	25	21	141
		High							7.4		24.4	30	25	136
150 (12½ Tons)	208/230-3-60	Std	187	254	23.0	146.0	1/4	1.4	10.6	.6	71.2/71.2	80/80**	74/74	387/387
		Alt							15.0		75.6/75.6	90/80**	79/79	410/410
	460-3-60	Std	414	508	10.4	73.0	1/4	0.7	4.8	.3	32.3	45	34	194
		Alt							7.4		34.9	45	37	205
	575-3-60	Std	518	632	8.3	58.4	1/4	0.7	4.8	.3	26.3	30	27	156
		Alt							7.4		28.4	30	29	165

### LEGEND

**FLA** — Full Load Amps  
**HACR**— Heating, Air Conditioning and Refrigeration  
**IFM** — Indoor (Evaporator) Fan Motor  
**LRA** — Locked Rotor Amps  
**MCA** — Minimum Circuit Amps  
**MOCPT**— Maximum Overcurrent Protection  
**NEC** — National Electrical Code  
**OFM** — Outdoor (Condenser) Fan Motor  
**RLA** — Rated Load Amps

\*Used to determine minimum disconnect per NEC.

†Fuse or HACR circuit breaker

\*\*Fuse only.



### NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.


### 2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percent of voltage imbalance.

% Voltage Imbalance

$$= 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 460-3-60.



$$\begin{aligned} AB &= 452 \text{ v} \\ BC &= 464 \text{ v} \\ AC &= 455 \text{ v} \\ \text{Average Voltage} &= \frac{452 + 464 + 455}{3} \\ &= \frac{1371}{3} \\ &= 457 \end{aligned}$$

Determine maximum deviation from average voltage.

$$(AB) 457 - 452 = 5 \text{ v}$$

$$(BC) 464 - 457 = 7 \text{ v}$$

$$(AC) 457 - 455 = 2 \text{ v}$$

Maximum deviation is 7 v.


Determine percent of voltage imbalance.

$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{7}{457} \\ &= 1.53\% \end{aligned}$$


This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

**IMPORTANT:** If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

## TYPICAL PIPING AND WIRING

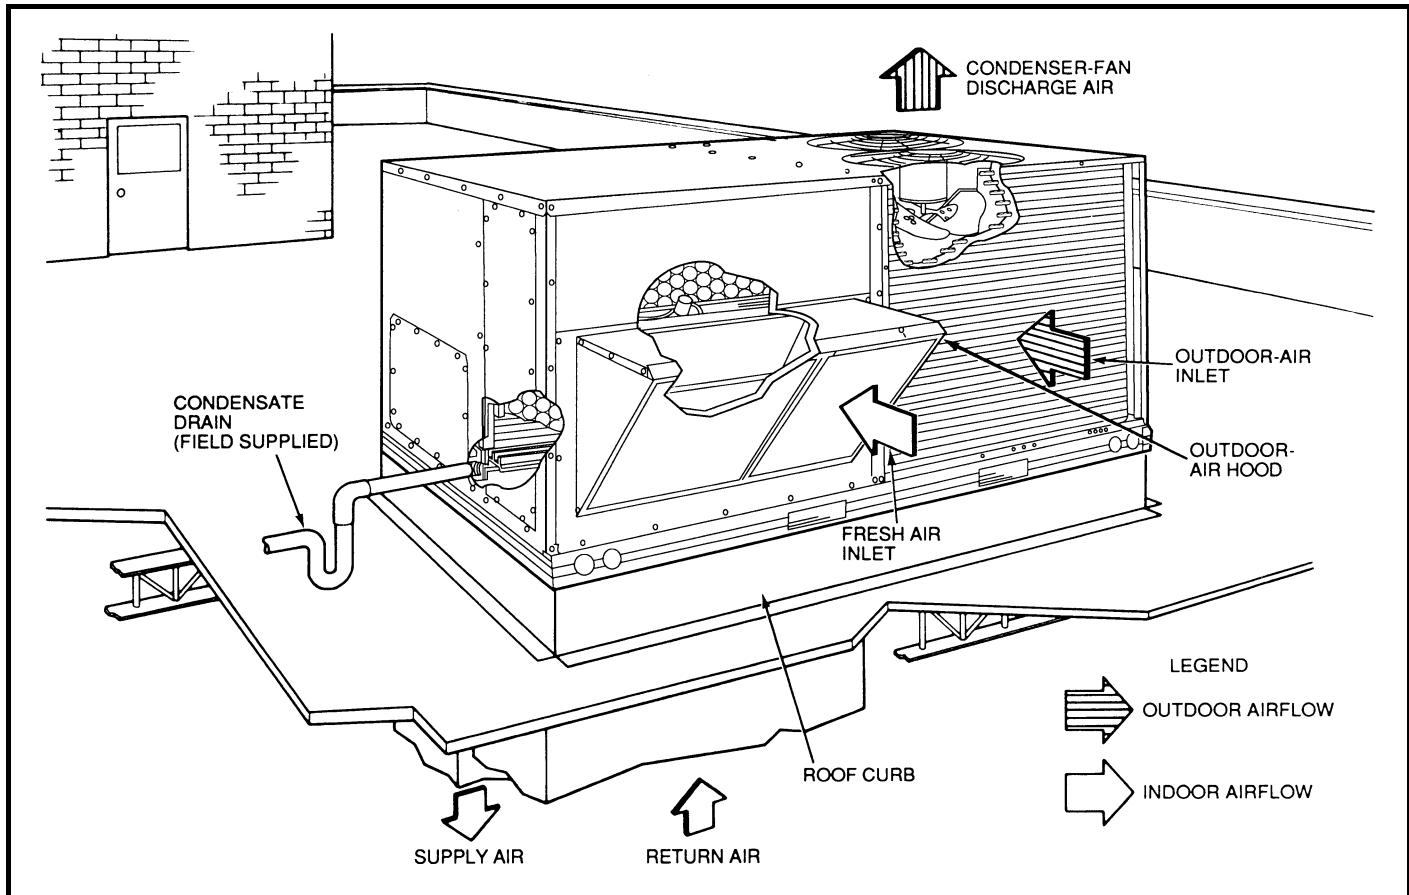

**Vertical Discharge Ducting**

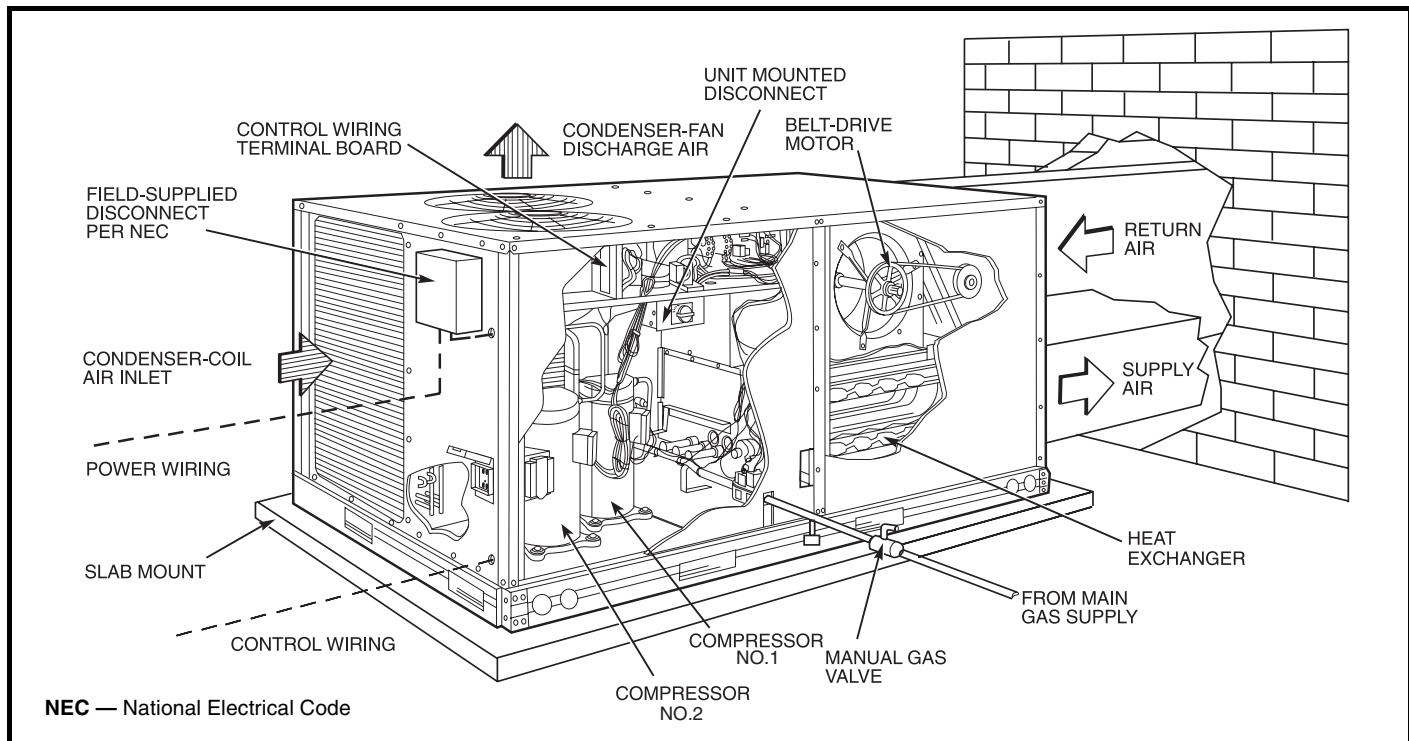

**Horizontal Discharge Ducting**

## CONTROLS

### OPERATING SEQUENCE

**Cooling, Units Without Economizer** — When thermostat calls for cooling, terminals G and Y1 are energized. The indoor (evaporator) fan contactor (IFC), compressor contactor no. 1 (C1) and outdoor-fan contactor (OFC) are energized, and evaporator-fan motor, compressor no. 1, and both condenser fans start. The condenser-fan motors run continuously while unit is cooling. If the thermostat calls for a second stage of cooling by energizing Y2, compressor contactor no. 2 (C2) is energized and compressor no. 2 starts.

When the thermostat is satisfied, C1 and C2 are deenergized and the compressors and outdoor (condenser) fan motors (OFM) shut off. After a 30-second delay, the indoor (evaporator) fan motor (IFM) shuts off. If the thermostat fan selector switch is in the ON position, the evaporator-fan motor will run continuously.

**Heating, Units Without Economizer** — When the thermostat calls for heating, terminal W1 is energized. In order to prevent thermostat short-cycling, the unit is locked into the Heating mode for at least 1 minute when W1 is energized. The induced-draft motor (IDM) is then energized and the burner ignition sequence begins. The indoor (evaporator) fan motor (IFM) is energized 45 seconds after a flame is ignited. On units equipped for two stages of heat, when additional heat is needed, W2 is energized and the high-fire solenoid on the main gas valve (MGV) is energized. When the thermostat is satisfied and W1 and W2 are deenergized, the IFM stops after a 45-second time-off delay.

**Cooling, Units With Durablade Economizer** — When the outdoor-air temperature is above the OAT (outdoor-air thermostat) setting and the room thermostat calls for cooling, compressor contactor no. 1 and outdoor-fan contactor (OFC) are energized to start compressor no. 1 and the outdoor (condenser) fan motors (OFM). The indoor (evaporator) fan motor (IFM) is energized and the economizer damper moves to the minimum position. Upon a further call for cooling, compressor contactor no. 2 will be energized, starting compressor no. 2 (090-150 only). After the thermostat is satisfied, the damper moves to the fully closed position when using an auto fan or to the minimum position when using a continuous fan.

When the outdoor-air temperature is below the OAT setting and the thermostat calls for cooling, the economizer dampers move to the minimum position. If the supply-air temperature is above 57 F, the damper continues to open until it reaches the fully open position or until the supply-air temperature drops below 52 F.

When the supply-air temperature falls to between 57 F and 52 F, the damper will remain at an intermediate open position. If the supply-air temperature falls below 52 F, the damper will modulate closed until it reaches the minimum position or until the supply-air temperature is above 52 F. When the thermostat is satisfied, the damper will move to the fully closed position when using an auto fan or to the minimum position when using a continuous fan.

If the outdoor air alone cannot satisfy the cooling requirements of the conditioned space, economizer cooling is integrated with mechanical cooling, providing second-stage cooling. Compressor no. 1 and the condenser fans will be energized and the position of the economizer damper will be determined by the supply-air temperature. Compressor no. 2 is locked out.

When the second stage of cooling is satisfied, the compressor and OFM will be deenergized. The damper position will be determined by the supply-air temperature.

After a 30-second delay, the IFM shuts off. If the thermostat fan selector switch is in the ON position, the IFM will run continuously.

**Cooling Units With EconoMi\$er** — When the OAT is above the ECON SP set point and the room thermostat calls for Stage 1 cooling (R to G + Y1), the indoor-fan motor (IFM) is energized and the EconoMi\$er damper modulates to minimum position. The compressor contactor and OFC are energized to start the compressor and outdoor-fan motor (OFM). After the thermostat is satisfied, the damper modulates to the fully closed position when the IFM is deenergized.

When the OAT is below the ECON SP setting and the room thermostat calls for Stage 1 cooling (R to G + Y1), the EconoMi\$er modulates to the minimum position when the IFM is energized. The EconoMi\$er provides Stage 1 of cooling by modulating the return and outdoor air dampers to maintain a 55 F supply air set point. If the supply-air temperature (SAT) is greater than 57 F, the EconoMi\$er modulates open, allowing a greater amount of outdoor air to enter the unit. If the SAT drops below 53 F, the outdoor air damper modulates closed to reduce the amount of outdoor air. When the SAT is between 53 and 57 F, the EconoMi\$er maintains its position.

If outdoor air alone cannot satisfy the cooling requirements of the conditioned space, and the OAT is above the MECH CLG LOCKOUT set point, the EconoMi\$er integrates free cooling with mechanical cooling. This is accomplished by the strategies below.

**NOTE:** Compressors have a two-minute Minimum On, Minimum Off, and interstage delay timer.

1. If Y1 is energized, and the room thermostat calls for Y2 (2-stage thermostat), the compressor and OFC are energized. The position of the EconoMi\$er damper is maintained at its current value.
2. If Y1 is energized for more than 20 minutes, and Y2 is not energized (whether or not a 2-stage thermostat is used), the compressor and OFC are energized. The position of the EconoMi\$er damper is maintained at its current value.
3. If Y1 is energized, and compressor no. 1 is already energized (see Step 2) and the room thermostat calls for Y2, compressor no. 1 continues to operate. If Y2 remains energized for more than 20 minutes, compressor no. 2 is energized (090-150 only).

**NOTE:** Compressor no. 2 cannot be energized unless there is a signal for Y2 from the space thermostat.

4. If compressor no. 2 is energized, and the Y2 signal from the thermostat is satisfied, compressors 1 and 2 are deenergized. Re-asserting Y2 will start compressor no. 1 and (after a 20-minute interstage delay) compressor no. 2.
5. If compressor no. 1 is energized and the thermostat is satisfied, compressor no. 1, the OFM, and IFM are deenergized and the EconoMi\$er modulates closed.


When the OAT is below the MECH CLG LOCKOUT set point, the compressors remain off.

## APPLICATION DATA


1. **DUCTWORK** — Secure vertical discharge ductwork to roof curb. For horizontal discharge applications, attach ductwork to unit, or field-supplied flanges can be attached to horizontal discharge openings and all ductwork attached to flanges.
2. **TO CONVERT DURABLADE ECONOMIZER FROM VERTICAL DISCHARGE TO HORIZONTAL DISCHARGE:**
  - a. Remove economizer to gain access to return duct opening.
  - b. Move the horizontal discharge duct opening covers to the vertical discharge openings.
  - c. Rotate economizer 90 degrees (until the economizer motor faces the condenser section).
  - d. Rotate the barometric relief damper 90 degrees (economizer only).
  - e. Install block-off plate over the opening on the access panel.
3. **THRU-THE-BOTTOM UTILITY CONNECTIONS** — An accessory kit is required for proper installation of thru-the-bottom connections.
4. **THERMOSTAT** — Use of 2-stage cooling thermostat is recommended for all units. A 2-stage cooling thermostat is required on units with accessory economizer to provide integrated cooling.
5. **HEATING-TO-COOLING CHANGEOVER** — All units are automatic changeover from heating to cooling when automatic changeover thermostat and subbase are used.
6. **AIRFLOW** — Units are draw-thru on cooling and blow-thru on heating.
7. **HORIZONTAL ECONOMISER** — A field-installed accessory for horizontal discharge applications. Field-installed power exhaust accessory also available for vertical or horizontal EconoMi\$er applications.
8. **MAXIMUM AIRFLOW** — To minimize the possibility of condensate blow-off from evaporator, airflow through units should not exceed 500 cfm/ton.
9. **MINIMUM AIRFLOW** — The minimum airflow for cooling is 300 cfm/ton.
10. **MINIMUM AMBIENT COOLING OPERATION TEMPERATURE** — The cooling temperature for size 036-150 standard units is 25 F. With accessory Motormaster® IV control and field-supplied wind baffles, units can operate at outdoor temperatures down to -20 F.
11. **MAXIMUM OPERATING OUTDOOR-AIR TEMPERATURE** — For cooling, this temperature is 115 F.
12. **HIGH ALTITUDE** — A change to the gas orifice may be required at high altitudes. Refer to Altitude Compensation charts on page 48.
13. **MINIMUM TEMPERATURE** — Air entering the heat exchanger in heating must be a minimum of 50 F continuous and 45 F intermittent.
14. **INTERNAL UNIT DESIGN** — Due to Bryant's internal unit design (draw-thru over the motor), air path, and specially designed motors, the full horsepower (maximum continuous bhp) listed in the Physical Data table and the notes following each Fan Performance table can be utilized with extreme confidence.

Using Bryant motors with the values listed in the Physical and Fan Performance Data tables *will not* result in nuisance tripping or premature motor failure. The unit warranty will not be affected.

## TYPICAL WIRING SCHEMATIC

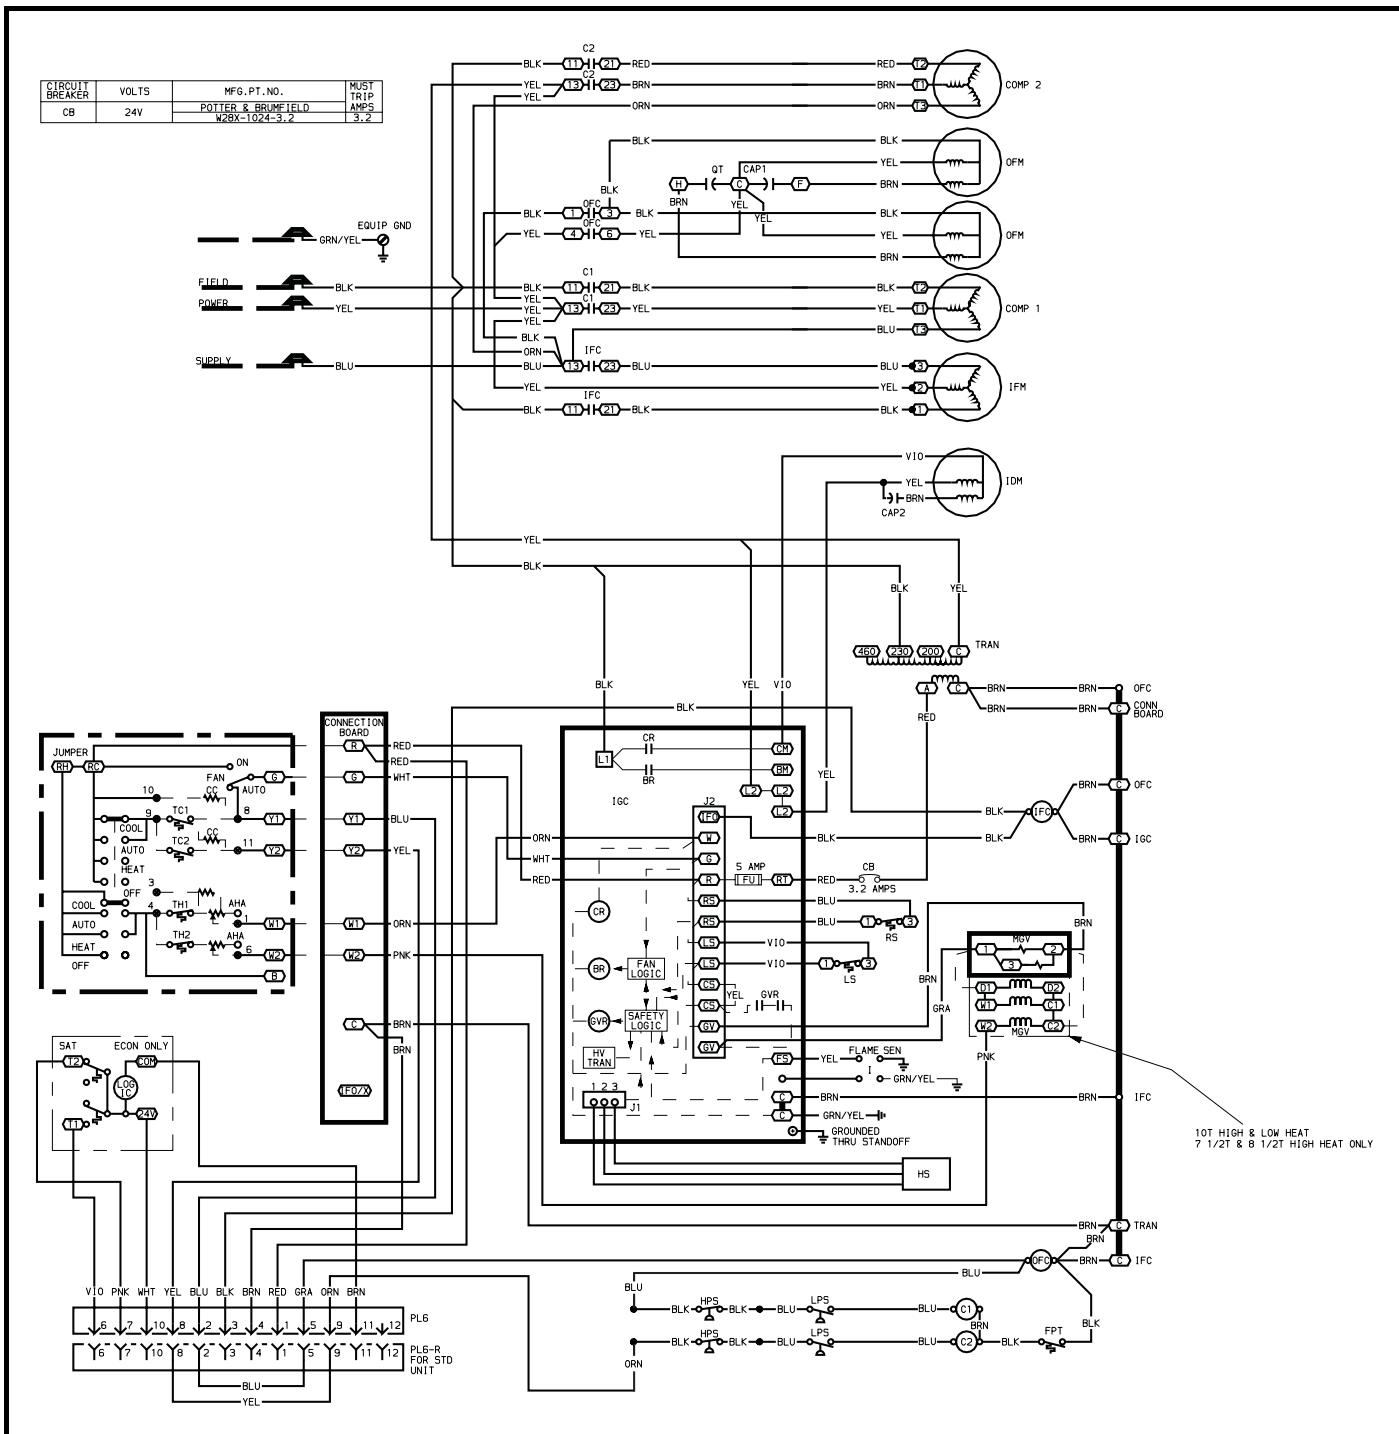

## TYPICAL WIRING SCHEMATIC (cont)

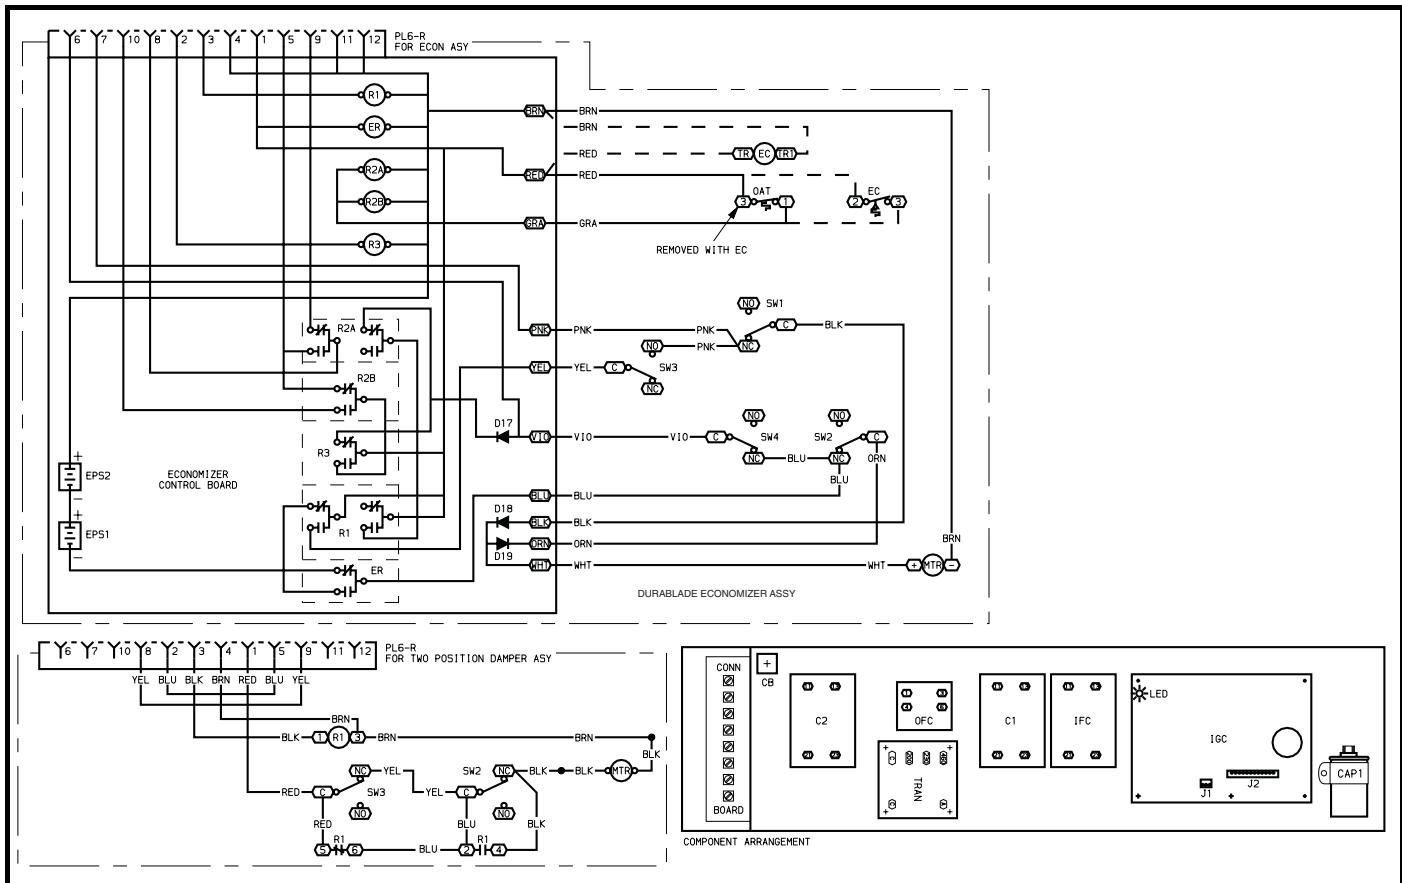

### LEGEND FOR TYPICAL WIRING SCHEMATIC

AHA	Adjustable Heat Anticipator	OFM	Outdoor (Condenser) Fan Relay
C	Contactor, Compressor	PL	Plug Assembly
CAP	Capacitor	QT	Quadruple Terminal
CB	Circuit Breaker	R	Relay
CC	Cooling Compensator	RS	Rollout Switch
COM	Common	SAT	Supply-Air Thermostat
COMP	Compressor Motor	SEN	Sensor
D	Diode	SW	Switch
EC	Enthalpy Control	SW1	Switch Fully Open
ECON	Economizer	SW2	Switch Fully Closed
EPS	Emergency Power Supply (9-Volt Battery)	SW3	Switch Minimum Vent Position
EQUIP	Equipment	SW4	Switch Maximum Vent Position
ER	Economizer Relay	TC	Thermostat, Cooling
FPT	Freeze-Protection Thermostat	TH	Thermostat, Heating
FU	Fuse	TRAN	Transformer
GND	Ground		Field Splice
GVR	Gas Valve Relay		Marked Wire
HPS	High-Pressure Switch		Terminal (Marked)
HS	Hall Effect Sensor		Terminal (Unmarked)
HV	High Voltage	X	Terminal Block
I	Ignitor		Splice
IDM	Induced-Draft Motor		Splice (Marked)
IFC	Indoor (Evaporator) Fan Contactor		Factory Wiring
IFM	Indoor (Evaporator) Fan Motor		Field Control Wiring
IGC	Integrated Gas Unit Controller		Field Power Wiring
LED	Light-Emitting Diode		Accessory or Optional Wiring
LPS	Low-Pressure Switch/Loss-of-Charge		To indicate common potential only. Not to represent wiring.
LS	Limit Switch		
MGV	Main Gas Valve		
MTR	Motor		
NC	Normally Closed		
NO	Normally Open		
OAT	Outdoor-Air Thermostat		
OFC	Outdoor (Condenser) Fan Contactor		

## GUIDE SPECIFICATIONS

### **PACKAGED ROOFTOP ELECTRIC COOLING UNIT WITH GAS HEAT — CONSTANT VOLUME APPLICATION**

#### HVAC GUIDE SPECIFICATIONS

SIZE RANGE: 3 TO 121/2 TONS, NOMINAL (COOLING)  
60,000 TO 250,000 BTUH, NOMINAL (INPUT HEATING)

MODEL NUMBER: 580F

#### **PART 1 — GENERAL**

##### **1.01 SYSTEM DESCRIPTION**

Outdoor rooftop mounted, electrically controlled heating and cooling unit utilizing a hermetic compressor(s) for cooling duty and gas combustion for heating duty. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.

##### **1.02 QUALITY ASSURANCE**

- A. Unit shall be rated in accordance with ARI Standards 210/240 or 360 and 270. Designed in accordance with UL Standard 1995.
- B. Unit shall be designed to conform to ASHRAE 15, latest revision.
- C. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
- D. Roof curb shall be designed to conform to NRCA Standards.
- E. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- F. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
- G. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered to ISO 9002/BS5750, Part 2.
- H. Each 580F unit is subjected to completely automated run testing on the assembly line. Each unit contains a factory-supplied printout indicating tested pressures, amperages, data, and inspectors; providing certification of the unit status at the time of manufacture.

##### **1.03 DELIVERY, STORAGE, AND HANDLING**

Unit shall be stored and handled per manufacturer's recommendations.

#### **PART 2 — PRODUCTS**

##### **2.01 EQUIPMENT (STANDARD)**

###### **A. General:**

Factory assembled, single-piece heating and cooling unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, refrigerant charge (R-22), and special features required prior to field start-up.

###### **B. Unit Cabinet:**

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
2. Evaporator fan compartment interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, flexible fiberglass insulation, coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the gas heat compartment.
3. Cabinet panels shall be easily removable for servicing.
4. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
5. Unit shall have a factory-installed, sloped condensate drain pan made of a non-corrosive material, providing a minimum 5/8-in. connection with both vertical

and horizontal drains, and shall comply with ASHRAE Standard 62.

6. Unit shall have a factory-installed filter access panel to provide filter access with tool-less removal.
7. Unit shall have standard thru-the-bottom gas and power connection capability (accessory kit is required).

###### **C. Fans:**

1. Evaporator Fan:
  - a. Fan shall be direct or belt driven as shown on the equipment drawings. Belt drive shall include an adjustable-pitch motor pulley.
  - b. Fan wheel shall be double-inlet type with forward-curved blades.
  - c. Bearings shall be sealed, permanently lubricated ball-bearing type for longer life and lower maintenance.
2. Evaporator fan shall be made from steel with a corrosion-resistant finish and shall be dynamically balanced.
3. Condenser fan shall be of the direct-driven propeller type and shall discharge air vertically.
4. Condenser fan shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.
5. Induced-draft blower shall be of the direct-driven, single inlet, forward-curved centrifugal type, made from steel with a corrosion-resistant finish and shall be dynamically balanced.

###### **D. Compressor(s):**

1. Fully hermetic type, internally protected.
2. Factory mounted on rubber grommets and internally spring mounted for vibration isolation.
3. On independent circuits (090-150).

###### **E. Coils:**

1. Evaporator and condenser coils shall have aluminum plate fins mechanically bonded to copper tubes with all joints brazed.
2. Tube sheet openings shall be belled to prevent tube wear.
3. Evaporator coil shall be of the full face active design (036-072) or face-split design (090-150) which proves effective in removing additional moisture from the supply air.

###### **F. Heating Section:**

1. Induced-draft negative pressure combustion type with energy saving direct-spark ignition system and redundant main gas valve.
2. The heat exchanger shall be of the tubular-section type constructed of a minimum of 20-gage steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance. Low NO<sub>x</sub> models have 409 stainless steel primary firing tubes.
3. Burners shall be of the in-shot type constructed of aluminum-coated steel.
4. All gas piping shall enter the unit cabinet at a single location.
5. The integrated gas controller (IGC) board shall include gas heat operation fault notification using an LED (light-emitting diode).
6. Unit shall be equipped with anti-cycle protection with one short cycle on unit flame rollout switch or 4 continuous short cycles on the high-temperature limit switch. Fault indication shall be made using an LED.

## GUIDE SPECIFICATIONS (cont)

7. The IGC board shall contain algorithms that modify evaporator-fan operation to prevent future cycling on high-temperature limit switch.
8. The LED shall be visible without removal of control box access panel.
- G. Refrigerant Components:**
- Refrigerant circuit components shall include:
- 1. Fixed orifice metering system.
  - 2. Refrigerant filter drier.
  - 3. Service gage connections on suction, discharge, and liquid lines.
- H. Filter Section:**
- 1. Standard filter section shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
  - 2. Filter face velocity shall not exceed 320 fpm at nominal airflows.
  - 3. Filter section should use only one size filter.
  - 4. Filters shall be accessible through an access panel with "no-tool" removal.
- I. Controls and Safeties:**
- 1. Unit Controls:  
Unit shall be complete with self-contained low-voltage control circuit protected by an auto-reset device.
  - 2. Refrigerant Controls:  
Unit shall contain high-pressure, loss-of-charge (low pressure) and freeze protection switches.
  - 3. Safeties:
    - a. Unit shall incorporate compressor overtemperature and overcurrent safety devices to shut off compressor.
    - b. Heating section shall be provided with the following minimum protections:
      - 1) High-temperature limit switch.
      - 2) Induced-draft motor speed sensor.
      - 3) Flame rollout switch.
      - 4) Flame proving controls.
- J. Operating Characteristics:**
- 1. Unit shall be capable of starting and running at 115 F ambient outdoor temperature, meeting maximum load criteria of ARI Standard 210/240 or 360.
  - 2. Compressor with standard controls shall be capable of operation down to 25 F ambient outdoor temperature.
- K. Electrical Requirements:**
- All unit power wiring shall enter unit cabinet at a single factory-predrilled location.
- L. Motors:**
- 1. Compressor motors shall be cooled by refrigerant gas passing through motor windings and shall have line break thermal and current overload protection.
  - 2. Evaporator-fan motor shall have permanently lubricated bearings and inherent automatic-reset thermal overload protection.
  - 3. Totally enclosed condenser-fan motor shall have permanently lubricated bearings, and inherent automatic-reset thermal overload protection.
  - 4. Induced-draft motor shall have permanently lubricated sealed bearings and inherent automatic-reset thermal overload protection.
- M. Special Features:**
- Certain features are not applicable when the features designated \* are specified. For assistance in amending the specifications, contact your local Bryant Sales Office.
- \*
1. Roof Curbs (Horizontal and Vertical):
- a. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - b. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
2. Integrated Economizers:
- a. Integrated integral modulating type capable of simultaneous economizer and compressor operation.
  - b. Includes all hardware and controls to provide cooling with outdoor air.
  - c. Equipped with low-leakage dampers, not to exceed 3% leakage at 1 in. wg pressure differential (Durablade economizer only).
  - d. Capable of introducing up to 100% outdoor air.
  - e. EconoMi\$er shall be equipped with a barometric relief damper with up to 100% of return air (036-072) or 90% of return air (090-150) relief. The Durablade economizer is equipped with 30% of return-air relief (036-150).
  - f. Designed to close damper during loss-of-power situations with emergency power supply (Durablade economizer) or spring return built into actuator (EconoMi\$er).
  - g. Dry bulb outdoor-air temperature sensor shall be provided as standard. Enthalpy control shall be provided as an option.
  - h. Durablade economizer is a guillotine-style damper, and the EconoMi\$er is a gear-driven parallel blade design.
  - i. EconoMi\$er shall provide control of internal building pressure through its accessory two-stage power exhaust function.
  - j. EconoMi\$er shall be capable of exhausting up to 100% outdoor air.
- \*
- NOTE:** EconoMi\$er is available with field-installed power exhaust accessory for vertical or horizontal ductwork applications.
3. Manual Outdoor-Air Damper:
- Manual damper package shall consist of damper, birdscreen, and rainhood which can be preset to admit up to 50% outdoor air for year-round ventilation.
- \*
4. 100% Two-Position Damper:
- a. Two-position damper package shall include single blade damper and motor. Admits up to 100% outdoor air.
  - b. Damper shall close upon indoor (evaporator) fan shutoff.
  - c. Designed to close damper during loss of power situations.
  - d. Equipped with 15% barometric relief damper.
- \*
5. 25% Two-Position Damper:
- a. Two-position damper package shall include single blade damper and motor. Admits up to 25% outdoor air.
  - b. Damper shall close upon indoor (evaporator) fan shutoff.
- \*
6. Solid-State Enthalpy Control:
- a. For use with Durablade economizer package only.
  - b. Capable of sensing outdoor-air enthalpy content (temperature and humidity) and controlling economizer cut-in point to have minimum heat content air passing over the evaporator coil for most efficient system operation.

## GUIDE SPECIFICATIONS (cont)

7. Head Pressure Control Package:  
Consists of solid-state control and condenser-coil temperature sensor to maintain condensing temperature between 90 F and 110 F at outdoor ambient temperatures down to -20 F by condenser-fan speed modulation or condenser-fan cycling.
8. LP (Liquid Propane) Conversion Kit:  
Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane.
9. Electronic Programmable Thermostat:  
Capable of using deluxe full-featured electronic thermostat. Shall use built-in compressor cycle delay control for both heating and cooling duty.
10. Light Commercial Thermidistat:  
Shall regulate temperature and display humidity from one location. Displays outdoor temperature from outdoor temperature sensor.
11. Flue Shield:  
Provides protection from the hot sides of the gas flue hood.
12. Thermostat and Subbase:  
Provides staged cooling and heating automatic (or manual) changeover, fan control, and indicator light.
13. Condenser Coil Hail Guard Assembly:  
Hail guard shall protect against damage from hail and flying debris.
- \* 14. Unit-Mounted, Non-Fused Disconnect Switch:  
Shall be factory-installed, internally mounted. NEC and UL approved non-fused switch shall provide unit power shutoff. Shall be accessible from outside the unit and shall provide power off lockout capability. Not to be used when rooftop electrical rating exceeds 80 amperes.
- \* 15. Convenience Outlet:  
Shall be factory-installed and internally-mounted with easily accessible 115-v female receptacle. Shall include 15 amp GFI receptacle with independent fuse protection. Voltage required to operate convenience outlet shall be provided by a factory-installed step-down transformer. Shall be accessible from outside the unit.
- \* 16. Alternate Motor(s) and/or Drive(s) (036-060, 090, 120, 150):  
Alternate motor(s) and drive(s) shall be factory-installed to provide additional performance range of indoor blower.
- \* 17. High-Static Motor(s) and Drive(s) (036-120):  
High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range of indoor blower.
18. Flue Discharge Deflector:  
Flue discharge deflector directs unit exhaust vertically instead of horizontally.
19. Condenser Coil Grille:  
The grille protects the condenser coil from damage by large objects without increasing unit clearances.
20. Compressor Cycle Delay:  
Unit shall be prevented from restarting for minimum of 5 min. after shutdown.
21. Thru-the-Bottom Utility Connectors:  
Kit shall provide connectors to permit gas and electrical connections to be brought to the unit through the basepan.
22. Fan/Filter Status Switch:  
Provides status of indoor (evaporator) fan (ON/OFF) or filter (CLEAN/DIRTY). Status shall be displayed when used with an indicator light at the thermostat.
23. EconoMi\$er and Power Exhaust:  
Package shall provide control of internal building pressure. The two-stage system shall exhaust up to 100% of return air. (Accessory for vertical applications only.)
24. Two-Stage Power Exhaust Accessory for EconoMi\$er:  
Power exhaust shall be used in conjunction with EconoMi\$er to provide system exhaust of up to 100% of return air. The power exhaust is a field-installed accessory (vertical and horizontal applications).
25. Outdoor Air Enthalpy Sensor:  
The outdoor air enthalpy sensor shall be used with the EconoMi\$er device to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the EconoMi\$er device will provide differential enthalpy control. The sensor allows the EconoMi\$er controller to determine if outside air is suitable for free cooling.
26. Return Air Enthalpy Sensor:  
The return air enthalpy sensor shall be used with the EconoMi\$er device. When used in conjunction with an outdoor air enthalpy sensor, the EconoMi\$er device will provide differential enthalpy control.
27. Return Air Temperature Sensor:  
The return air temperature sensor shall be used with the EconoMi\$er device. When used in conjunction with the standard outdoor air temperature sensor, the EconoMi\$er device will provide differential temperature control.
28. Indoor Air Quality (CO<sub>2</sub>) Sensor:
  - a. Shall have the ability to provide demand ventilation indoor air quality (IAQ) control through the economizer with a CO<sub>2</sub> sensor.
  - b. The CO<sub>2</sub> sensor shall be available in wall mount with LED display. The CO<sub>2</sub> sensor can be duct mounted with accessory aspirator box. The set point shall have adjustment capability.



