


ECLIPSE™

#88 Sampling Station

- Allows for safe, secure, quality samples
- 100% serviceable from above ground – no digging!
- Unthreaded nozzle
- Lockable cast-aluminum enclosure
- All brass waterway



- No drain hole to prevent cross-contamination
- 3/4" inlet
- O-ring valve design
- Any depth of bury
- Freeze-proof (with use of hand pump and built-in evacuation line during freezing seasons)



Optional
Casted
Door Logo



Protective
Caps On
All Outlets



Evacuation
Hand Pump
(sold separately)



Optional
Pedestal



Revised Total Coliform Rule

The EPA allows for collection of samples from sampling stations for the following benefits:

- To reduce potential contamination of the sampling taps
- To facilitate access to sampling taps
- To improve sampling representation of the distribution system



Eclipse #88-SS
Stainless Steel
Model Also
Available



Meets the Requirements of
NSF/ANSI 372



Optional Plastic
Enclosure



All About Kupferle




youtube.com/kupferle1857

2511 North 9th Street, St. Louis, MO 63102

www.hydrants.com / 800-231-3990

ECLIPSE NO. #88 SAMPLING STATION

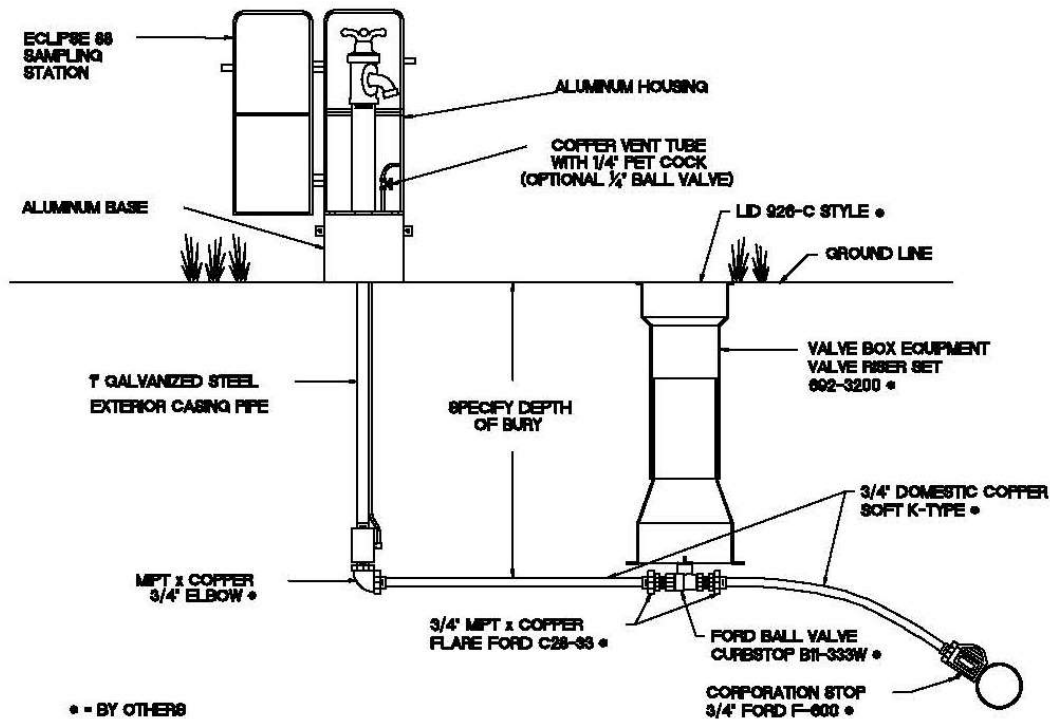

Sampling Stations shall be ' bury, with a 3/4" FIP Inlet, and a (3/4" hose or unthreaded) nozzle.

All stations shall be enclosed in a lockable, nonremovable, aluminum-cast housing.

When opened, the station shall require no key for operation, and the water will flow in an all brass waterway.

All working parts will also be of brass and be removable from above ground with no digging. Exterior piping shall be brass or galvanized.

A copper vent tube will enable each station to be pumped free of standing water to prevent freezing and to minimize bacteria growth.

Eclipse No. #88 Sampling Station shall be manufactured by Kupferle Foundry, St. Louis, MO 63102.

DRAWN
F.M.
APPROVED

DATE
11-07-12
MAT'L

THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.


ECLIPSE
Since 1857



KUPFERLE FOUNDRY COMPANY
2511 NORTH 9TH STREET, ST. LOUIS, MO 63102
314-231-8738 800-231-3990 FAX 314-231-2820
<http://www.hydrants.com>

DATE	REVISION	PART NO. #88 SAMPLING STATION	SHEET 1 OF 1
------	----------	-------------------------------	--------------

ECLIPSE NO. #88 SAMPLING STATION

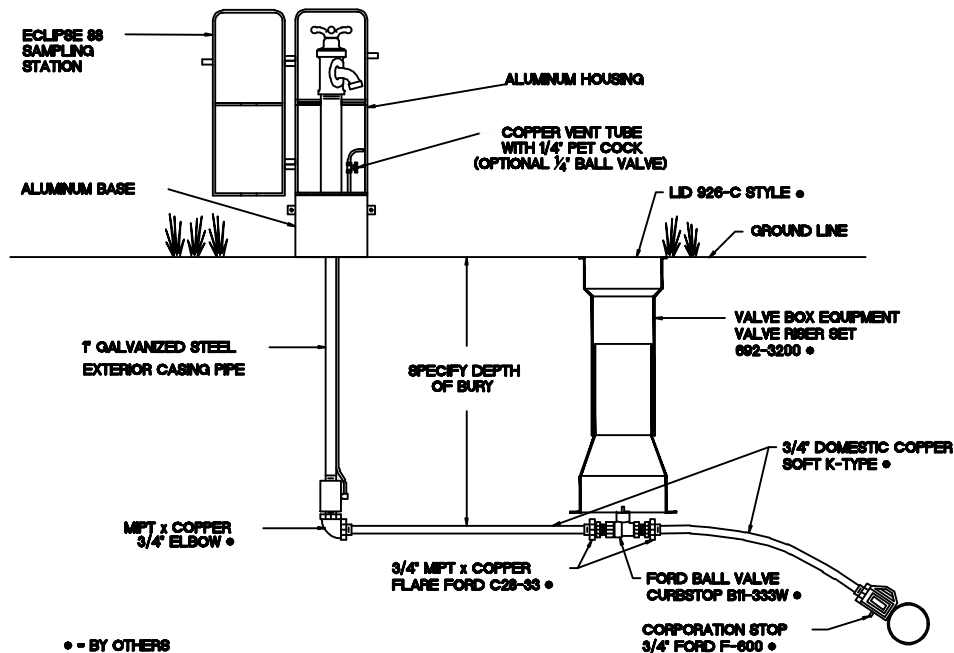

• - BY OTHERS

Sampling Stations shall be ' bury, with a 3/4" FIP inlet, and a (3/4" hose or unthreaded) nozzle.


All stations shall be enclosed in a lockable, nonremovable, aluminum-cast housing.

When opened, the station shall require no key for operation, and the water will flow in an all brass waterway.

All working parts will also be of brass and be removable from above ground with no digging. Exterior piping shall be brass or galvanized.

A copper vent tube will enable each station to be pumped free of standing water to prevent freezing and to minimize bacteria growth.

Eclipse No. #88 Sampling Station shall be manufactured by Kupferle Foundry, St. Louis, MO 63102.

		DRAWN F.M. APPROVED		 KUPFERLE FOUNDRY COMPANY 2511 NORTH 9TH STREET, ST. LOUIS, MO 63102 314-231-8738 800-231-3880 FAX 314-231-2820 http://www.hydrants.com
		DATE 11-07-12 MAT'L		
		THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.		
		PART NO. #88 SAMPLING STATION SHEET 1 OF 1		
DATE	REVISION			