

G5025 Drench Hose Unit, Wall Mounted **G5025BP** Drench Hose Unit, Wall Mounted, with Backflow Preventer

Application: Drench hose unit for wall mounting. Ideal for rinsing any part of user's eye, face or body. Note: Under ANSI *Z*358.1-2014, drench hose units supplement, but do not replace, other types of emergency equipment.

Spray Head: Single FS-Plus[™] spray head. Spray head has "flip top" dust cover, internal flow control and filter to remove impurities from the water flow.

Valve: Forged brass squeeze valve activated by stainless steel lever handle. Valve has replaceable stainless steel seat for exceptional durability. Valve closes when lever handle is released.

Hose: 8' reinforced PVC hose. 300 PSI maximum working pressure.

mounting: Wall mounted hook holds unit on wall.

Backflow Preventer: In-line dual check backflow preventer installed on inlet of hose (G5025BP only). Note: Check with code authority for compliance with local plumbing code.

Supply: 3/8" NPT male swivel-type inlet.

Sign: ANSI-compliant identification sign.

Quality Assurance: Unit is completely assembled and water tested prior to shipment.

Available Options

- **DC** Stainless steel dust cover for spray head.
- **FSH** 8 ft. flexible stainless steel hose in place of PVC hose.
- LC Locking clip for valve handle. Valve stays open until locking clip is released.
- **VB** In-line vacuum breaker for installation between valve and spray head.

TMV G3600LF thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as required by ANSI Z358.1-2014. Refer to "Tempering Units" section for complete technical and product selection information.



312 447 8100 телерноме gesafety.com

Listed 8116. Units have been tested to and comply with ANSI 7358.1-2014 and the Uniform Plumbing Code. C






ETL Listed 101496. Units have been tested to and comply with ANSI 7358.1-2014.



□ **G5025** Drench Hose Unit, Wall Mounted

G5025BP Drench Hose Unit, Wall Mounted, with Backflow Preventer

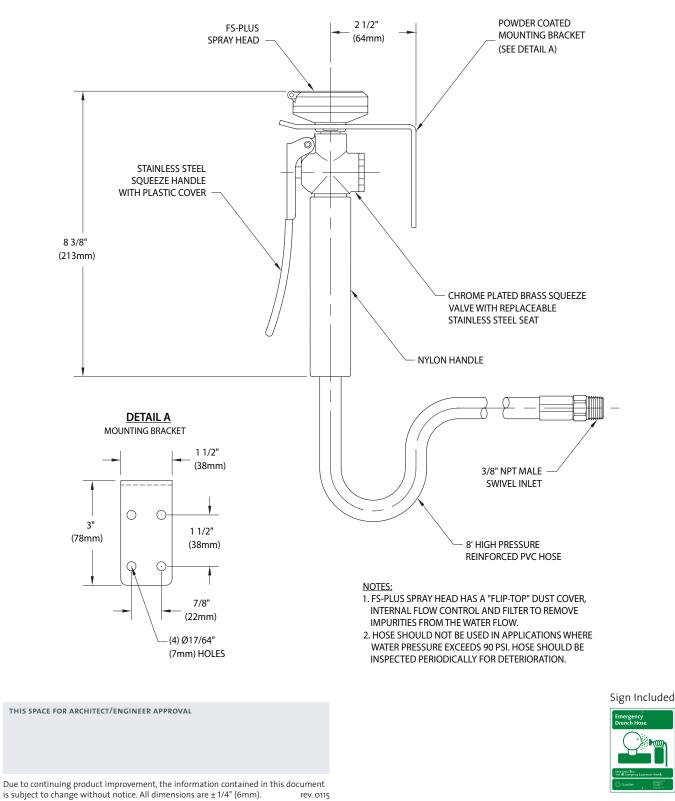

Guardian Equipment 1140 N North Branch St 312 447 8101 FACSIMILE Chicago, IL 60642

312 447 8100 теlephone gesafety.com

Listed 8116. Units have been tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code.







Units have been tested to and comply with ANSI Z358.1-2014.