


Installation of ICM Controller on MU-A12WA unit



1. Break the White lead to the condenser fan
2. Connect the line side to terminal L2 of the controller
3. Connect the load side to M2 of the controller
4. Field install wiring from Black lead of fan motor to terminal L1(120VAC) of controller
5. Attach sensor to u-bend on upper 1/3 of the condenser
6. Set up controller as per manufactures recommendations.

*It is recommended that a crankcase heater be field installed for low ambient operation. Units should be installed in areas with no prevailing winds.

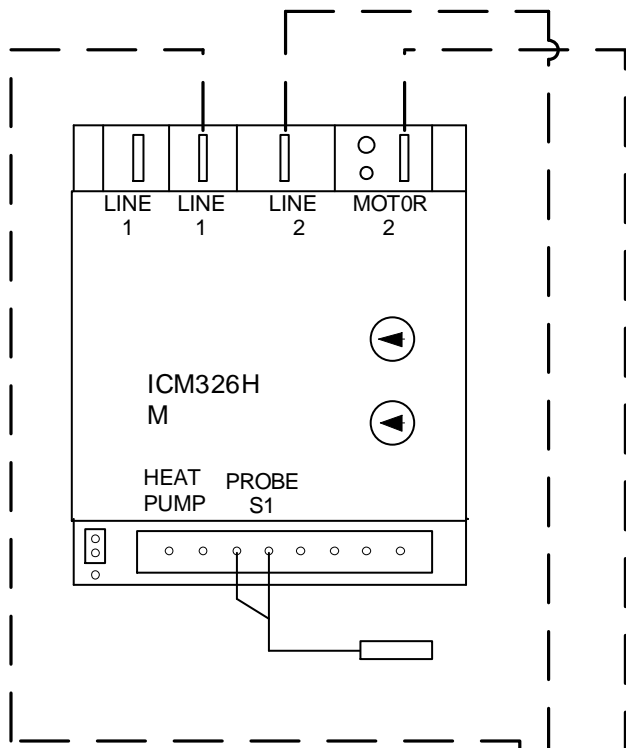