




P.O. Box 3365 South El Monte, CA 91733 626.444.0541 Fax 626.444.3887 www.Afcon.org

**410**

## SWAY BRACE FITTING

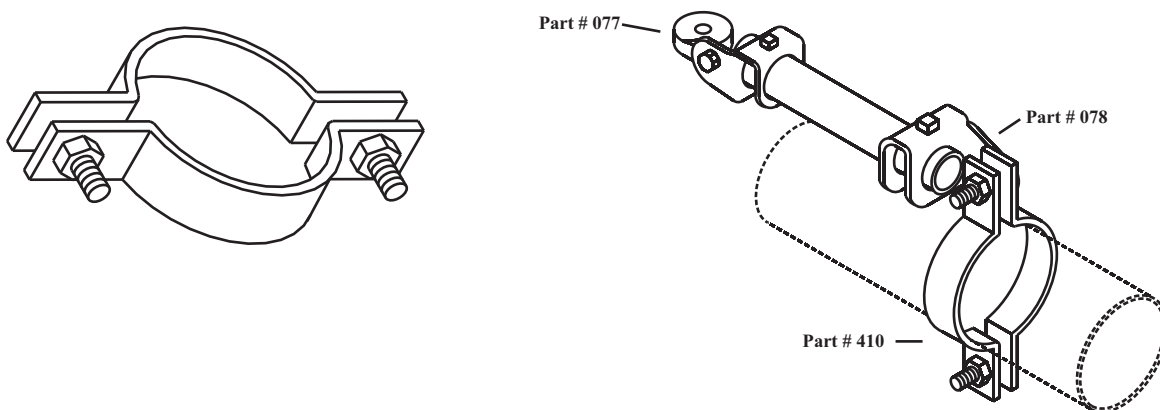

**SIZE - SYSTEM PIPE:** Nominal Pipe Size

**Sch. 40 Steel** 1" thru 8"

**Sch. 10 Steel** 1 1/4" thru 8"

**MATERIAL** - Carbon Steel

**FINISH** - Plain or E.G.

**LISTING/APPROVAL** -



**203A-EX 2625**

**203-EX 2551 (4"-8" Only)**

**Listed only for use with other AFCON bracing products.**

**OSHPD** OPA-0601 See Website.

| Horizontal Load Ratings |      |
|-------------------------|------|
| Size                    | UL   |
| 1" - 4"                 | 1000 |
| 6" - 8"                 | 2015 |

**FUNCTION** - Longitudinal fitting of an **AFCON** sway brace assembly.

Sway brace assemblies are intended to be installed in accordance with NFPA 13 and the manufacturer's installation instructions.

**INSTALLATION** - Per NFPA 13 and these instructions.

**Load rating** - see chart.

Align brace pipe parallel to system pipe.

**ASSEMBLY** - See drawing.

Combine with proper **AFCON** components.

Tighten bolts to minimum required torque of 40 ft. lbs.

*078 is a preferred assembly component.*

**ORDERING** - Part #, pipe size and finish.



Specific **AFCON** products are exclusively designed to be compatible **ONLY** with other **AFCON** products including parts and fasteners, resulting in a listed sway brace, restrainer or hanger assembly. **Be advised** the following warranty restriction will apply. **DISCLAIMER** - **AFCON** will **NOT** warrant against the failure of its products when used in combination with other products, parts or systems not manufactured or sold by **AFCON**. **AFCON** shall **NOT** be liable under any circumstances whatsoever for any direct or indirect, incidental or consequential damages of any kind, including but not limited to loss of business or profit, when non-**AFCON** products have been, or are used.